

**SIEMENS**



**SENTRON**

# Air Circuit Breakers and Molded Case Circuit Breakers with UL Certification

Catalog  
LV 18

Edition  
04/2021

[siemens.com/lowvoltage](https://www.siemens.com/lowvoltage)

# Making sure power makes its way

Consistent, safe and intelligent low-voltage power distribution and electrical installation technology

Whether industries, infrastructures or buildings: Each environment depends on a reliable power supply.

Which is why products and systems featuring maximum safety and optimum efficiency are in demand. This comprehensive portfolio for low-voltage power distribution and electrical installation technology covers every requirement – from the switchboard to the socket outlet.

We are there when you need us

Your personal contact can be found at  
[www.siemens.com/lowvoltage/contact](http://www.siemens.com/lowvoltage/contact)

Catalog LV 18 · 04/2021

You will find the latest edition and all future editions in the Siemens Industry Online Support at  
[www.siemens.com/lowvoltage/catalogs](http://www.siemens.com/lowvoltage/catalogs)

Refer to the Industry Mall for current prices  
[www.siemens.com/lowvoltage/mall](http://www.siemens.com/lowvoltage/mall)


The products and systems listed in this catalog are developed and manufactured using a certified quality management system in accordance with DIN EN ISO 9001:2008.

Technical data

The technical specifications are for general information purposes only. Always heed the operating instructions and notices on individual products during assembly, operation and maintenance.

All illustrations are not binding.

© Siemens 2021

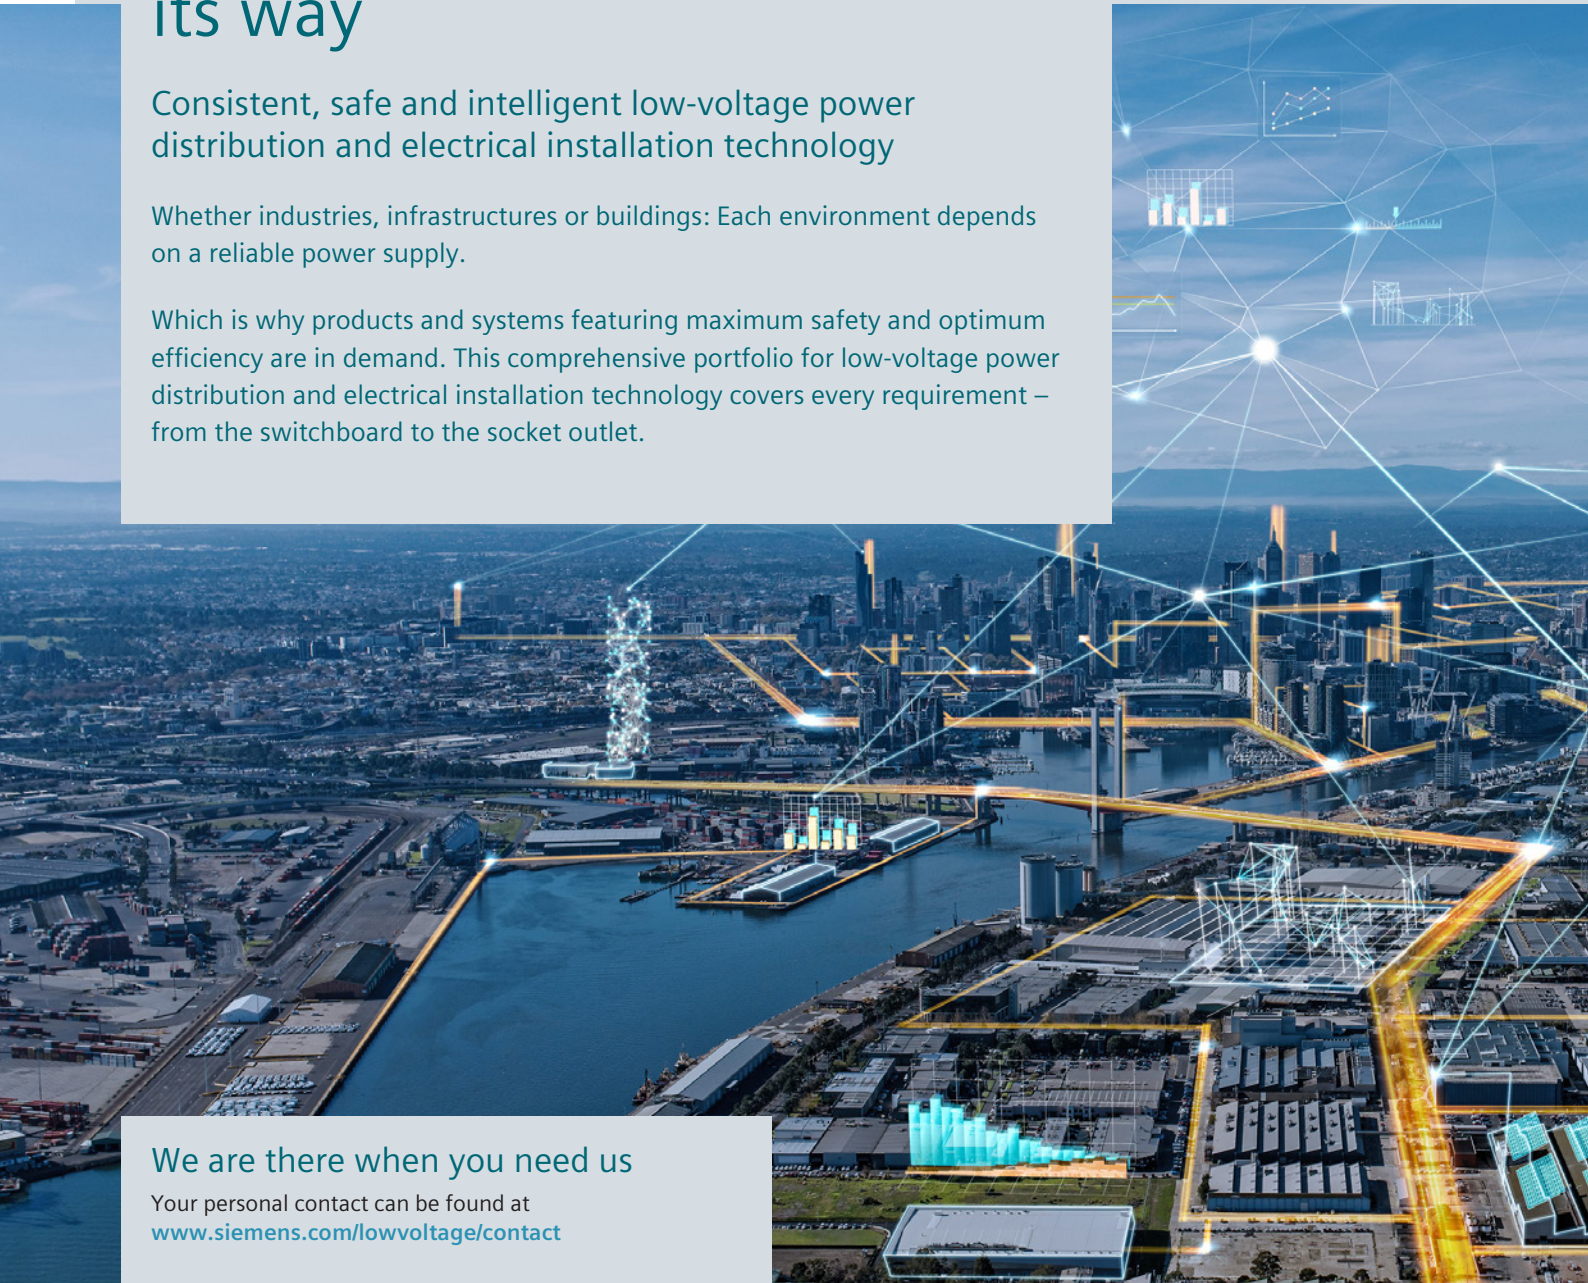

# Air Circuit Breakers and Molded Case Circuit Breakers with UL Certification

Protecting

Introduction .....	I/2
Air Circuit Breakers .....	1/1
Molded Case Circuit Breakers .....	2/1
Appendix .....	A/1

I

1

2

A

# The fast route to the product

## Overview of configurable products for better understanding

Molded Case Circuit Breakers | 3VA1 - 3VA6

### Structure of the article numbers

Basic configuration for line protection

The structure shown below is intended as an overview of each position and its meaning. For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ol-configurator](http://www.siemens.com/lowvoltage/3va-ol-configurator)

3VA		4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100	101	102	103	104	105	106	107	108	109	110	111	112	113	114	115	116	117	118	119	120	121	122	123	124	125	126	127	128	129	130	131	132	133	134	135	136	137	138	139	140	141	142	143	144	145	146	147	148	149	150	151	152	153	154	155	156	157	158	159	160	161	162	163	164	165	166	167	168	169	170	171	172	173	174	175	176	177	178	179	180	181	182	183	184	185	186	187	188	189	190	191	192	193	194	195	196	197	198	199	200
3VA	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100	101	102	103	104	105	106	107	108	109	110	111	112	113	114	115	116	117	118	119	120	121	122	123	124	125	126	127	128	129	130	131	132	133	134	135	136	137	138	139	140	141	142	143	144	145	146	147	148	149	150	151	152	153	154	155	156	157	158	159	160	161	162	163	164	165	166	167	168	169	170	171	172	173	174	175	176	177	178	179	180	181	182	183	184	185	186	187	188	189	190	191	192	193	194	195	196	197	198	199	200	

AAO

2

3VA

4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100 101 102 103 104 105 106 107 108 109 110 111 112 113 114 115 116 117 118 119 120 121 122 123 124 125 126 127 128 129 130 131 132 133 134 135 136 137 138 139 140 141 142 143 144 145 146 147 148 149 150 151 152 153 154 155 156 157 158 159 160 161 162 163 164 165 166 167 168 169 170 171 172 173 174 175 176 177 178 179 180 181 182 183 184 185 186 187 188 189 190 191 192 193 194 195 196 197 198 199 200

AAO

2

2022 Siemens LV 18 - 04/2021

System overview, pages 248 and 212

System overview, pages 248 and 212

Siemens LV 18 - 04/2021 2023

### Configurable products

For products which are conveniently configurable online, the structure of the article numbers is clearly displayed. A link takes you directly to the configurator which permits complete and valid configuration.

### Clickable article numbers

Direct forwarding to the individual products in the Industry Mall by clicking on the Article No. in the catalog

3VA9137-0EK11




or by entering this web address incl. Article No.  
[www.siemens.com/product?Article No.](http://www.siemens.com/product?Article No.)

### **new** Search function

Search for new products by entering new in the text field of the search function:




# Overview of the key US standards

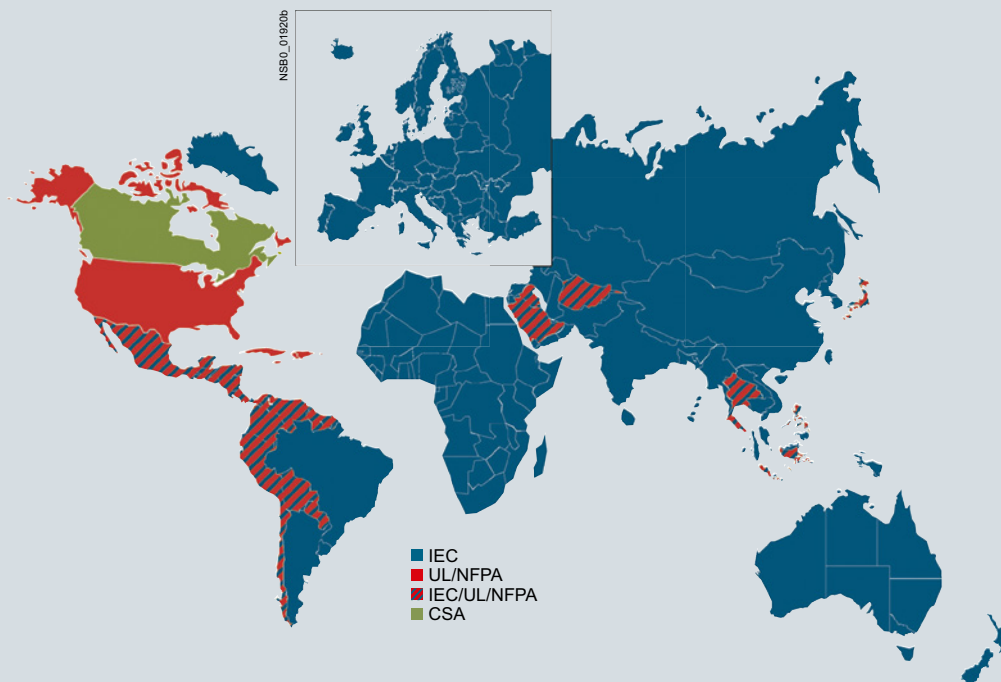

UL and IEC are fundamentally different. The IEC standards for the IEC market merely define the minimum safety requirements for a device or system. The technical details relating to how safety requirements are to be implemented are in practice a matter for the manufacturer. Every electrical machine or system in the USA is investigated by an inspector, the so-called Authority Having Jurisdiction (AHJ), prior to commissioning. The National Electrical Code (NEC), respective application-specific standards as well as local standards and specifications form the basis for acceptance.



## The following standards are of essential importance to mechanical engineers and panel builders:

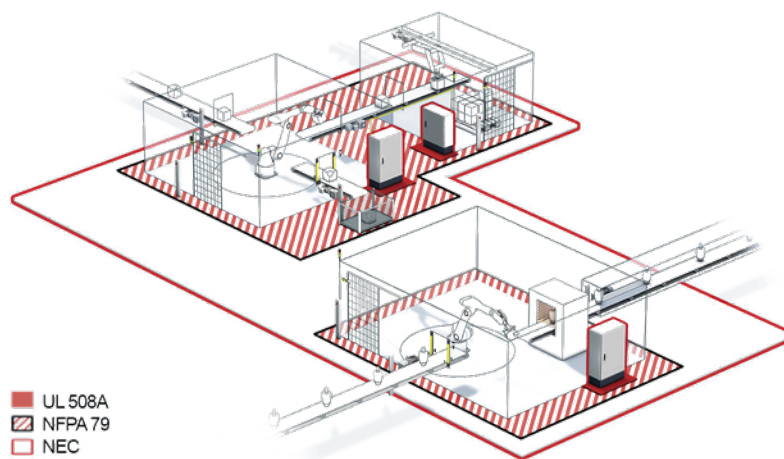- UL 508A for industrial control panels
- NFPA 79 (Electrical Standard for Industrial Machinery) for industrial machines
- NEC (National Electrical Code, NFPA 70) for electrical on-site installation



You will find further information at: [www.siemens.com/controlpanel](http://www.siemens.com/controlpanel)

Marks	Applications
	The <b>UL Listing Mark</b> is the most frequently used symbol. Products (e.g. washing machines, computers, electrical switchgear, fire extinguishers, personal flotation devices, etc.) which carry this mark meet all UL's safety requirements and are allowed to be installed universally and without further instruction or restriction of use. Our own portfolio, for example, offers contactors in accordance with UL 508 or circuit breakers in accordance with UL 489.
	<b>C-UL Listing Mark:</b> This mark is applied to products for the Canadian market. You will see this mark on appliances and computer equipment, vending machines, household burglar alarm systems, lighting fixtures, and many other types of products.
	<b>C-UL US Listing Mark:</b> Introduced in 1998, this mark indicates compliance of the products with both Canadian and U.S. requirements. The Canada/U.S. UL mark is optional. UL encourages those manufacturers with products certified for both countries to use this combined mark, but they may continue using separate UL marks for the United States and Canada.
	<b>Recognized Component Mark:</b> This mark is used on components and devices that are incorporated in machines, systems or products such as washing machines. These components may have restrictions on their performance or may be incomplete in construction. The Component Recognition Mark is found on a wide range of products, including some switches, power supplies, printed wiring boards, some kinds of industrial control equipment and many other products. They are allowed to be installed only by properly qualified personnel, as the "Conditions of Acceptability (CoA)" apply to these devices in all cases. Examples of our products that bear the UR mark include our miniature circuit breakers which meet UL 1077, our time switches which meet UL 917, and our SITOR fuses.
	<b>Canadian Recognized Component Mark</b> (similar to the Recognized Component Mark – see above): Components approved for the Canadian market carry this mark.
	<b>Recognized Component Mark for Canada and the United States:</b> Components carrying this mark, which became effective in 1998, meet the requirements of the US and Canadian markets for Recognized Components. Although UL had not originally planned to introduce a combined Recognized Component Mark, the popularity of Canada/U.S. listing marks among clients led to the new mark.

Certifications such as  and  are issued by the so-called NRTLs (Nationally Recognized Testing Laboratories) after successful testing. The OSHA (Occupational Safety and Health Administration) has accredited Underwriters Laboratories Inc. as an NRTL.

# Overcurrent protection according to network standards


## Overcurrent protection

The term "overcurrent" refers to the overload, short circuit and ground-fault current. Overcurrent protection is understood to be a device designed to open a circuit when the rated current is exceeded. The ampere rating of the device is selected for a circuit to terminate a condition where the current exceeds the rating of conductors and equipment due to overloads, short circuits and faults to ground.

UL 508A distinguishes between straight rating and slash rating. Which of these two ratings applies depends on the existing system type.

### Slash rating

There are two voltages (phase – phase / phase – ground) in a solidly grounded wye network. These two voltages are also specified along with the rating, e.g. 480 Y/277 V. A switching device suitable for this network has a slash rating.



**3 phases,  
4 conductors**

Solidly grounded wye, 3 phases, 4 conductors


**Notice:** The PE must not carry any current.  
There is no PEN conductor --> N = grounded conductor (white or gray);  
separate conductors must be used for PE and N.

#### Usable line voltages:

600Y/347 V <sup>1)</sup>  
480Y/277 V <sup>1)</sup>  
240Y/131 V <sup>1)</sup>  
208Y/120 V <sup>1)</sup>


### Straight rating

In the common industrial networks (see table) there is only one voltage. Such networks are called "straight networks". When choosing short-circuit protection devices, attention must be paid to whether devices are approved for straight or slash rating.




**3 phases,  
3 conductors**

Corner grounded delta,  
3 phases, 3 conductors



**3 phases,  
3 conductors**

Ungrounded wye,  
3 phases, 3 conductors



**3 phases,  
3 conductors**

Ungrounded delta,  
3 phases, 3 conductors

#### Usable line voltages:


600 V  
480 V  
240 V

<sup>1)</sup> Y describes the "Solidly grounded circuit". The value "Y" indicates the voltage between the phases (e.g. 480 V), and the value behind the slash indicates the voltage between the phase and the grounding or the neutral conductor (e.g. 277 V with 480 V voltage between the phases).



# Brief code comparison of UL vs. IEC standards

## Interaction of the most important US standards

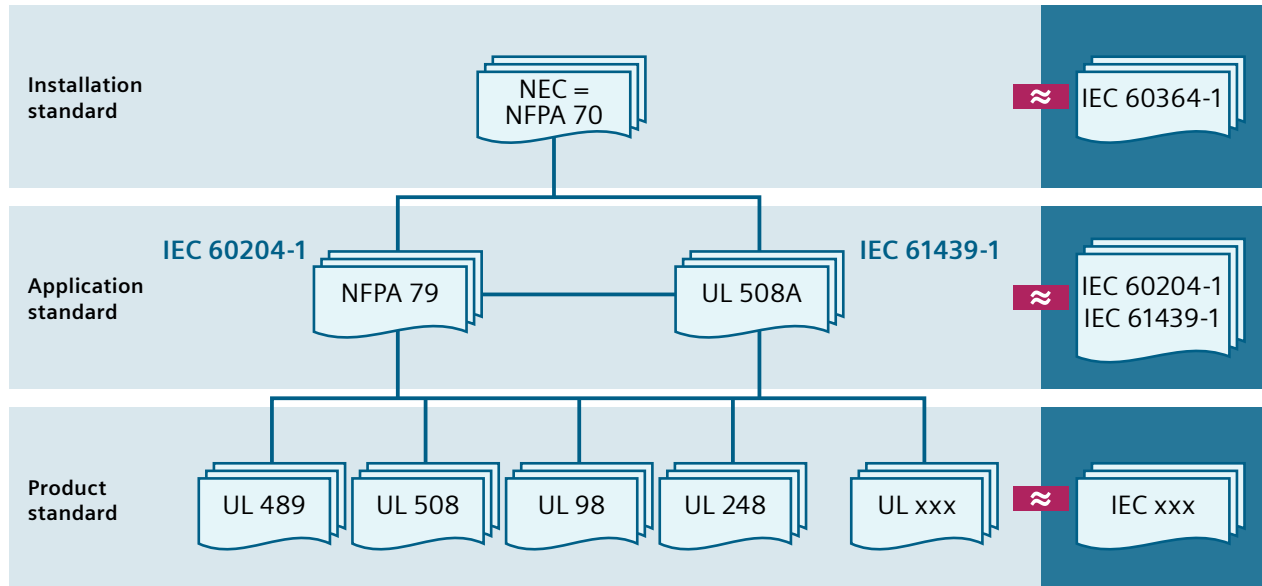

NEC = NFPA70 vs. IEC 60364-1: Electrical on-site installation

NFPA 79 vs. IEC 60204-1: Industrial machines

UL 508A vs. IEC 61439-1: Industrial control panels


Contact our Support at [www.siemens.com/lowvoltage/certificates](http://www.siemens.com/lowvoltage/certificates) to find out which products (please specify the article number) are approved according to which standard.

The table below contains a summary of the available products and details of the UL, CSA and IEC standards with which the 3WL5 air circuit breaker and the 3VA5 and 3VA6 molded case circuit breakers comply. However, the table only contains product groups. The product groups mentioned might include individual products which are not approved according to UL or CSA. It is essential therefore to research each individual product via our Support.

			UL			CSA		IEC	
			Standard	CCN UL listed	CCN UL recognized	UL File No.	Standard	CSA Class No.	Standard
<b>Air Circuit Breakers</b>									
3WL5	≤5000 A	ACB	UL 489	DIVQ	–	E231263	C22.2 No. 5	101003	IEC 60947-2
<b>Molded Case Circuit Breakers</b>									
3VA5	≤800 A	Circuit breaker / Circuit Breaker CB	UL 489	DIVQ	–	E364397	C22.2 No. 5	267698	IEC 60947-2
		Circuit breaker for starter combinations / Motor Circuit Protector MCP	UL 489	–	DKPU2	E482699	C22.2 No. 5	267698	IEC 60947-2
		Nonautomatic circuit breakers / Molded Case Switch MCS	UL 489	WJAZ	–	E482701	C22.2 No. 5	267698	IEC 60947-2
3VA6	≤1000 A	Circuit breaker / Circuit Breaker CB	UL 489	DIVQ	–	E364397	C22.2 No. 5	267698	IEC 60947-2
		Circuit breaker for starter combinations / Motor Circuit Protector MCP	UL 489	–	DKPU2	E482699	C22.2 No. 5	267698	IEC 60947-2
		Nonautomatic circuit breakers / Molded Case Switch MCS	UL 489	WJAZ	–	E482701	C22.2 No. 5	267698	IEC 60947-2
3VA9		Circuit breaker accessories	UL 489	DISHS7	DIHS2 DIHS8	E354102	C22.2 No. 5	–	IEC 60947-2

# Applications


## Circuit breaker for line protection / Inverse time circuit breaker for line protection (CB, CCN code: DIVQ)

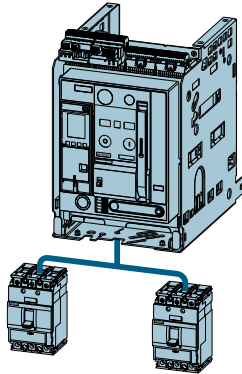

The trip units are designed to provide overload and short-circuit protection for:

- Cables
- Leads
- Non-motor loads


## Molded case switch (MCS, CCN code: WJAZ)



These molded case switches can be used as feeder switches, main switches or non-automatic circuit breakers without overload protection.

They incorporate an integrated short-circuit self-protection system.

## Motor circuit protector / Instantaneous trip circuit breaker / Protective circuit breaker for motor starter combinations (CCN code: DKPU2)

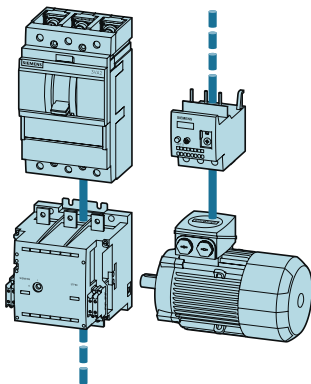

Starter combinations consist of:

Motor circuit protector + contactor + overload relay

The motor circuit protector handles short-circuit protection and the isolating function. The task of the contactor is the operational switching of the feeder. The overload relay handles overload protection that can be specially matched to the motor.

The motor circuit protector is therefore equipped with an adjustable and instantaneous short-circuit release.

# Product approvals in control panel according to UL / NEC

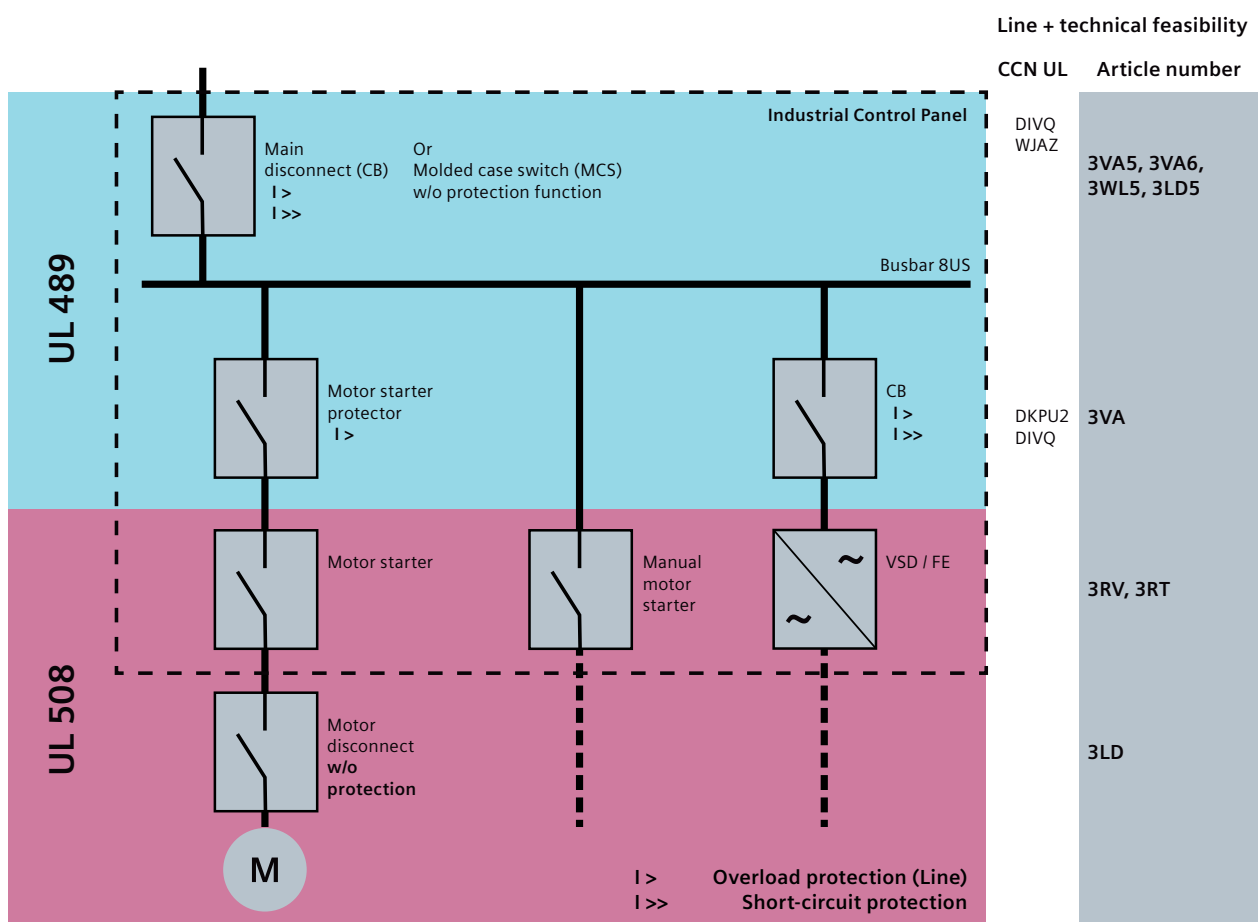


Diagram showing which product approvals may be used at which position in the feeder / supply line according to UL / NEC.

## Reliable, versatile and perfectly integrated

All power distribution systems rely on a secure infeed of electrical energy. The 3WL air circuit breakers reliably protect electrical equipment from damage or fire resulting from short circuit, ground fault or overload failures.

The 3WL air circuit breakers are used as incoming-feeder, tie, and outgoing-feeder circuit breakers in electrical installations in industry, buildings and infrastructure applications. They have the ability to communicate and can easily be integrated into higher-level control and energy management systems.

The 3WL air circuit breakers switch and protect motors, capacitors, generators, transformers, busbars and cables. The modular design and standardized range of accessories enable the circuit breakers to be adapted flexibly to different applications. UL 489-compliant versions are available for international use.

The 3WL air circuit breakers can optionally be equipped with a communication module and integrated into higher-level energy management systems. Auxiliary, signaling and position switches report status and fault diagnostics remotely to higher-level control systems.



# Air Circuit Breakers

1

All the information you need .....	1/2
Quick selection guide .....	1/4
Switching devices for AC and DC .....	1/4
Switching devices for AC .....	1/6
Switching devices for DC .....	1/10
Electronic trip units ETU .....	1/14
Connection .....	1/16
Operating mechanism, auxiliary release, auxiliary switch .....	1/17
3WL5 .....	1/18
System overview .....	1/18
Online configurator highlights .....	1/20
Structure of the article numbers .....	1/22
Accessory options .....	1/26
Guide frames for AC .....	1/36
Accessories and spare parts .....	1/37

# A multitude of additional information ...

## Information + ordering

### All the important things at a glance

For information about air circuit breakers, please visit our website [www.siemens.com/3WL](http://www.siemens.com/3WL)

### Siemens YouTube channel

- 3WL air circuit breakers (general) [bit.ly/2ZH1rXH](https://bit.ly/2ZH1rXH)

### Everything you need for your order

Refer to the Industry Mall for an overview of your products

- 3WL air circuit breakers/non-automatic air circuit breakers for AC up to 5000 A, UL [sie.ag/2ScRZK7](https://sie.ag/2ScRZK7)

Direct forwarding to the individual products in the Industry Mall by clicking on the Article No. in the catalog or by entering this web address incl. Article No. [www.siemens.com/product?Article No.](http://www.siemens.com/product?Article No.)

### Configurators

The configurator reduces the time and effort required in the planning and ordering process, and allows for individual adaptations. Configure your 3WL air circuit breaker at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

For your configured 3WL air circuit breaker, you can additionally find

- 3D views
- CAD data
- Unit wiring diagrams
- Dimension drawings

### The fast track to the experts

#### Contact persons in your region

We offer a comprehensive portfolio of services. You can find your local contacts at [www.siemens.com/lowvoltage/components/contact](http://www.siemens.com/lowvoltage/components/contact)

You can find further information on services at [www.siemens.com/service-catalog](http://www.siemens.com/service-catalog)

Competent expert advice on technical questions with a wide range of demand-optimized services for all our products and systems.

Assistance with technical queries is provided at [www.siemens.com/lowvoltage/support-request](http://www.siemens.com/lowvoltage/support-request)

# ... can be found in our online services

## Commissioning + operation

### SENTRON powerconfig

The combined commissioning and service tool SENTRON powerconfig for communication-capable measuring devices and circuit breakers from the SENTRON portfolio:  
[www.siemens.com/powerconfig](http://www.siemens.com/powerconfig)

Free download SENTRON powerconfig mobile via:  
[App Store](#) and [Play Store](#)

### Your product in detail

The Siemens Industry Online Support (SIOS) provides detailed technical information  
[www.siemens.com/lowvoltage/product-support](http://www.siemens.com/lowvoltage/product-support)

- Operating instructions
- Characteristic curves
- Certificates

Comprehensive mobile support via the Siemens Industry Online Support app available for download from the [App Store](#) and [Play Store](#)

You will find further information under:  
[www.siemens.com/support-app](http://www.siemens.com/support-app)

Provision of 3D data (step and u3d data formats)

- Siemens Industry Mall  
[www.siemens.com/lowvoltage/mall](http://www.siemens.com/lowvoltage/mall)
- Image database  
[www.siemens.com/lowvoltage/picturedb](http://www.siemens.com/lowvoltage/picturedb)

Engineering data for CAD or CAE systems are available in the CAx Download Manager at  
[www.siemens.com/lowvoltage/cax](http://www.siemens.com/lowvoltage/cax)

### Manuals

Manuals are available for downloading in Siemens Industry Online Support (SIOS) at  
[www.siemens.com/lowvoltage/manuals](http://www.siemens.com/lowvoltage/manuals)

- Configuration manual – 3WL5 air circuit breakers / non-automatic air circuit breakers (**109775570**)
- System manual – 3WL/3VL circuit breakers with communication capability – Modbus (**39850157**)
- System manual – 3WL/3VL circuit breakers with communication capability – PROFIBUS (**12560390**)
- Communication manual – 3WL air circuit breakers via COM35 – PROFINET IO, Modbus TCP (**109757987**)

### Classroom or online training

Our training courses can be found at  
[www.siemens.com/sitrain-lowvoltage](http://www.siemens.com/sitrain-lowvoltage)

- Protection systems in low-voltage power distribution (WT-LVAPS)
- 3WL air circuit breakers, sizes 1-3 (WT-LVA3WL)
- Communication with SENTRON components (LV-COM)
- Maintenance and operation of 3WL circuit breakers (LV-CBMAIN)
- Project planning and selection of SENTRON circuit breakers (LV-CBPROJ)

Video tutorial on the 3WL air circuit breaker – descriptive supplement to Operating Instructions  
[www.lowvoltage.siemens.com/wcms/3wl-tutorial](http://www.lowvoltage.siemens.com/wcms/3wl-tutorial)

## Technical overview – Air circuit breakers



### The fast way to get you to our online services

This page provides you with comprehensive information and links on air circuit breakers  
[www.siemens.com/lowvoltage/product-support](http://www.siemens.com/lowvoltage/product-support) (**109766020**)

# Switching devices for AC and DC

UL 489

AC



3WL51

3WL52

Basic data					
Rated operational voltage $U_e$	V	600 Y / 347		600	
Rated current $I_n$	A	630 ... 1600		2000 ... 3200	
Size		1		2	
Type of mounting		Withdrawable	Fixed-mounted	Withdrawable	Fixed-mounted
Number of poles		3/4-pole	3/4-pole	3/4-pole	3/4-pole
Dimensions					
Width (3-pole   4-pole)	mm	320 410	320 410	460 590	460 590
Height (standard   A05, A15, A16, DC greater than 600 V)	mm	465.5	434	465.5	434
Depth	mm	471	291	471	291
Approvals					
General product approvals		VDE, UL, CE, CCC, EAC, C-Tick, CSA		VDE, UL, CE, CCC, EAC, C-Tick, CSA	
Breaking capacity					
			S	H	
Short-circuit breaking capacity acc. to UL 489					
Short-circuit breaking capacity up to 480 V AC $I_{cu} = I_{cs}$	kA	65		100	
Short-circuit breaking capacity up to 600 Y V / 347 V AC $I_{cu} = I_{cs}$	kA	50		85 <sup>1)</sup>	
Short-circuit breaking capacity up to 600 V AC $I_{cu} = I_{cs}$	kA	–		85	
Short-circuit breaking capacity acc. to IEC 60947-2					
Short-circuit breaking capacity up to 500 V AC $I_{cu} = I_{cs}$	kA	65		100	
Short-circuit breaking capacity $I_{cm}$ at 500 V AC $I_{cu} = I_{cs}$	kA	143		220	
Short-circuit breaking capacity up to 690 V AC $I_{cu} = I_{cs}$	kA	50		85	
Short-circuit breaking capacity $I_{cm}$ at 690 V AC $I_{cu} = I_{cs}$	kA	105		187	
Rated short-time withstand current $I_{cw}$ acc. to UL 489					
Rated short-time withstand current $I_{cw}$ at max. delay time $t_{sd}$	0.4 s	kA	65		85
Rated short-time withstand current $I_{cw}$ acc. to IEC 60947-2					
Rated short-time withstand current $I_{cw}$ at max. delay time $t_{sd}$	0.5 s	kA	65		85
	1 s	kA	50		80
Rated short-circuit current $I_{cc}$ of the non-automatic air circuit breakers					
Rated short-circuit current $I_{cc}$ at 690 V DC	kA	–		–	
Rated short-circuit current $I_{cc}$ at 1000 V DC	kA	–		–	

<sup>1)</sup> Covered by 600 V AC (delta) test.



AC



DC

1

3WL53		3WL5120		3WL5232	
≤600 Y / 347		1000		690	
4000 ... 5000		2000		3200	
3		1		2	
Withdrawable 3/4-pole	Fixed-mounted 3/4-pole	Withdrawable 4-pole	Fixed-mounted 4-pole	Withdrawable 3-pole	Fixed-mounted 3-pole
704 914	704 914	410	410	460	460
465.5	434	465.5	434	465.5	434
471	291	471	291	471	291
VDE, UL, CE, CCC, EAC, C-Tick, CSA		VDE, UL, CE, CCC, EAC, C-Tick, CSA		VDE, UL, CE, CCC, EAC, C-Tick, CSA	
H		DC		DC	
100		-		-	
85		-		-	
-		-		-	
100		-		-	
220		-		-	
85		-		-	
187		-		-	
85		-		-	
85		-		-	
80		-		-	
-		20		25	
-		20		-	

# Switching devices for AC

UL 489

3WL51



Rated current $I_n$			≤1000 A	1600 A	
<b>General technical specifications</b>					
Isolating function acc. to EN 60947-2			Yes		
Utilization category			B		
Permissible ambient temperature	Operation	°C	-25 ... +55		
	Storage	°C	-25 ... +70		
Mounting position					
Degree of protection	With cover		IP55		
	Without cover (with door sealing frame)		IP41		
<b>Voltage</b>					
Rated operational voltage $U_e$ at 50/60 Hz			V AC	600 Y / 347	
<b>Permissible load at 50/60 Hz</b>					
For main conductors	At 40 °C	A	≤1000	1600	
	At 55 °C	A	≤1000	1600	
	At 60 °C	A	≤1000	1600	
<b>Power loss at <math>I_n</math></b>					
With 3-phase symmetrical load	Fixed-mounted circuit breaker		W	100	150
	Withdrawable circuit breaker		W	195	350
<b>Switching times</b>					
Make time		ms	35		
Opening time		ms	38		
Electrical make time (through activation solenoid) <sup>1)</sup>		ms	80		
Electrical opening time (through shunt trip)		ms	73		
Electrical opening time (instantaneous undervoltage release)		ms	≤80		
Opening time due to ETU, instantaneous short-circuit release		ms	50		
<b>Service life/endurance</b>					
Mechanical	Without maintenance		Operating cycles	10000	
Electrical	Without maintenance		Operating cycles	4000	
<b>Switching frequency</b>					
Mechanical / electrical			1/h	60	
<b>Minimum pauses</b>					
Between tripping by the electronic trip unit and the next closure of the circuit breaker (only with automatic mechanical reset of the reclosing lockout)			ms	80	

<sup>1)</sup> Make time through closing coil for synchronization purposes (short-time excited) 50 ms.

## 3WL52



## 3WL53




2000 A	2500 A	3000 A	3200 A	4000 A	5000 A
--------	--------	--------	--------	--------	--------

Yes

B

-25 ... +55

-25 ... +70



IP55

IP41

600

600

600

600

≤600 Y / 347

2000

2500

3000

3200

4000

5000

2000

2500

3000

3200

4000

5000

2000

2500

3000

3200

4000

5000

180

270

410

410

520

630

320

520

710

710

810

1050

35

34

100

73

≤80

50

35

34

100

73

≤80

50

10000

10000

4000

1000

60

60

80

80

# Switching devices for AC

UL 489

3WL51



Rated current I <sub>n</sub>		≤1000 A	1600 A
<b>Connection</b>			
<b>Main conductor minimum cross-sections</b>			
Copper bars, bare	Unit, mm <sup>2</sup>	2 × 6.4 × 76.2	
<b>Auxiliary conductor (Cu) max. number of auxiliary conductors × cross-section (solid/stranded)</b>			
Standard connection = screw	Without end sleeve	2 × 0.5 ... 2 × 1.5 mm <sup>2</sup> (AWG 20 ... 16); 1 × 2.5 mm <sup>2</sup> (AWG 14)	
	With end sleeve acc. to DIN 46228 Part 2 <sup>1)</sup>	1 × 0.5 ... 1 × 1.5 mm <sup>2</sup> (AWG 20 ... 16)	
	With twin end sleeve	2 × 0.5 ... 2 × 1.5 mm <sup>2</sup> (AWG 20 ... 16)	
Screwless connection technology	Without end sleeve	2 × 0.5 ... 2 × 2.5 mm <sup>2</sup> (AWG 20 ... 14)	
	With end sleeve acc. to DIN 46228 Part 2	2 × 0.5 ... 2 × 1.5 mm <sup>2</sup> (AWG 20 ... 16)	
<b>Minimum dimension of breaker compartment</b>			
Width × height × depth	3-pole	mm	400 × 460 × 380
	3-pole with A17	mm	–
	4-pole	mm	500 × 460 × 380
<b>Weights</b>			
3-pole	Fixed-mounted circuit breaker	kg	43
	Withdrawable circuit breaker	kg	45
	Guide frames	kg	25
4-pole	Fixed-mounted circuit breaker	kg	50
	Withdrawable circuit breaker	kg	54
	Guide frames	kg	30

<sup>1)</sup> Notice: Approval of end sleeves.

## 3WL52



## 3WL53



1

2000 A	2500 A	3000 A	3200 A	4000 A	5000 A
2x 6.4 x 102	2x 6.4 x 127 or 4x 6.4 x 63.5	4x 6.4 x 102	4x 6.4 x 102	4x 10 x 120	
2x 0.5 ... 2x 1.5 mm <sup>2</sup> (AWG 20 ... 16); 1x 2.5 mm <sup>2</sup> (AWG 14)			2x 0.5 ... 2x 1.5 mm <sup>2</sup> (AWG 20 ... 16); 1x 2.5 mm <sup>2</sup> (AWG 14)		
1x 0.5 ... 1x 1.5 mm <sup>2</sup> (AWG 20 ... 16)			1x 0.5 ... 1x 1.5 mm <sup>2</sup> (AWG 20 ... 16)		
2x 0.5 ... 2x 1.5 mm <sup>2</sup> (AWG 20 ... 16)			2x 0.5 ... 2x 1.5 mm <sup>2</sup> (AWG 20 ... 16)		
2x 0.5 ... 2x 2.5 mm <sup>2</sup> (AWG 20 ... 14)			2x 0.5 ... 2x 2.5 mm <sup>2</sup> (AWG 20 ... 14)		
2x 0.5 ... 2x 1.5 mm <sup>2</sup> (AWG 20 ... 16)			2x 0.5 ... 2x 1.5 mm <sup>2</sup> (AWG 20 ... 16)		
500 x 460 x 380	500 x 460 x 380	500 x 460 x 380	500 x 460 x 380	800 x 460 x 380	800 x 460 x 380
–	560 x 570 x 500	–	560 x 570 x 500	810 x 570 x 500	–
600 x 460 x 380	600 x 460 x 380	–	560 x 570 x 500	1000 x 460 x 380	1000 x 460 x 380
56	59	64	64	82	
60	63	68	–	88	
31	39	45	–	60	
67	71	77	77	99	
72	76	82	–	106	
37	47	54	–	84	

# Switching devices for DC

UL 489

3WL5120                      3WL5232

Rated current $I_n$			1600 A	3200 A
<b>General technical specifications</b>				
Isolating function acc. to EN 60947-2			Yes	
Utilization category			B	
Permissible ambient temperature	Operation	°C	-25...+55	
	Storage	°C	-25...+70	
Mounting position				
Degree of protection	With cover		IP55	
	Without cover (with door sealing frame)		IP41	
<b>Voltage</b>				
Rated operational voltage $U_e$		V DC	1000	690
<b>Permissible load</b>				
For main conductors, acc. to IEC 60947-2	At 40 °C	A	2000	3200
	At 55 °C	A	2000	3200
	At 60 °C	A	2000	3200
For main conductors, acc. to UL 489B	At 40 °C	A	1600	3200
	At 55 °C	A	1600	3200
	At 60 °C	A	1600	3200
<b>Power loss at <math>I_n</math></b>				
With 3-phase symmetrical load	Fixed-mounted circuit breaker	W	100	410
	Withdrawable circuit breaker	W	–	–
<b>Switching times</b>				
Make time		ms	35	35
Opening time		ms	38	34
Electrical make time (through activation solenoid) <sup>1)</sup>		ms	80	100
Electrical opening time (through shunt trip)		ms	73	73
Electrical opening time (instantaneous undervoltage release)		ms	≤80	≤80
Opening time due to ETU, instantaneous short-circuit release		ms	50	50
<b>Service life/endurance</b>				
Mechanical	Without maintenance	Operating cycles	10000	
Electrical	Without maintenance	Operating cycles	1000	
<b>Switching frequency</b>				
Mechanical/electrical		1/h	60	

<sup>1)</sup> Make time through activation solenoid for synchronization purposes (short-time excited) 50 ms.

			3WL5120	3WL5232
Rated current I <sub>n</sub>			1600 A	3200 A
<b>Connection</b>				
<b>Main conductor minimum cross-sections</b>				
Copper bars, bare	Unit		2× 6.4 × 76.2	4× 6.4 × 102
<b>Auxiliary conductor (Cu) max. number of auxiliary conductors × cross-section (solid/stranded)</b>				
Standard connection = strain-relief clamp	Without end sleeve		2× 0.5 ... 2× 1.5 mm <sup>2</sup> (AWG 20 ... 16); 1× 2.5 mm <sup>2</sup> (AWG 14)	
	With end sleeve acc. to DIN 46228 Part 2 <sup>2)</sup>		1× 0.5 ... 1× 1.5 mm <sup>2</sup> (AWG 20 ... 16)	
	With twin end sleeve		2× 0.5 ... 2× 1.5 mm <sup>2</sup> (AWG 20 ... 16)	
Optional connection = tension spring	Without end sleeve		2× 0.5 ... 2× 2.5 mm <sup>2</sup> (AWG 20 ... 14)	
	With end sleeve acc. to DIN 46228 Part 2		2× 0.5 ... 2× 1.5 mm <sup>2</sup> (AWG 20 ... 16)	
<b>Weights</b>				
3-pole	Fixed-mounted circuit breaker	kg	50	64
<b>Dimensions 3/4-pole</b>				
Fixed-mounted	Width	mm	320/410	460/590
	Height	mm	434	434
	Depth	mm	291	291
Withdrawable	Height	mm	465.5	465.5
	Depth	mm	471	471

1


<sup>2)</sup> Notice: Approval of end sleeves.

# Switching devices for DC

## Application examples size 1

Permissible interconnection  
Circuit diagrams for size 1,  
1000 V DC non-automatic air circuit breakers

1

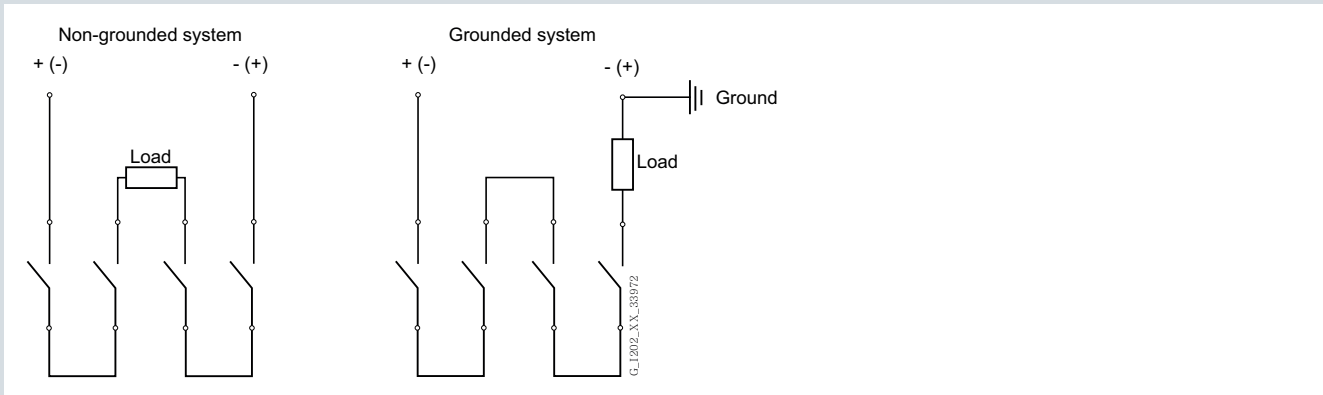



## Application examples size 2

The connection to the circuit breakers is not dependent on direction and polarity; the circuit diagrams can be adapted accordingly. If the parallel or series connections are made directly to the connecting bars, for thermal reasons the continuous load on the circuit breakers must only be 80% of the permissible operational current. If the parallel or series connection is made at a distance of 1 m from the connecting bars, the circuit breaker can be used at full operational current load.

Required contact gaps at rated voltage	For 3-pole non-automatic air circuit breakers		For 4-pole non-automatic air circuit breakers	
	1-pole	2-pole	1-pole	2-pole
<b>Rated operational voltage &lt;300 V + 10%</b>		 <small>NSS0_00539</small> only with grounded system <sup>2)</sup>	 only with grounded system <sup>3)</sup>	 only with grounded system <sup>3)</sup>
<b>Rated operational voltage &gt;300 V + 10% ... 600 V + 10%</b>		 only with grounded system	 only with grounded system <sup>2)</sup>	 only with grounded system <sup>2)</sup>
<b>Rated operational voltage &gt;600 V + 10% ... 1000 V + 10%<sup>4)</sup></b>		 only with grounded system	 <small>NSS0_00595</small> only with grounded system	 only with grounded system

<sup>1)</sup> Conducting paths series-connected

<sup>2)</sup> 2 parallel conducting paths

<sup>3)</sup> 3 parallel conducting paths

<sup>4)</sup> Version for 1000 V required, order with "-Z" and order code A05

—| Grounded system

▬ Load

# Electronic trip units ETU

Available for air circuit breakers

1



Basic protection functions		ETU25B (LSI)	ETU45B (LSIG)
<b>L</b> Overload protection (L tripping operation)	Setting range of operating value $I_r = I_n \times \dots$	0.4   0.45   0.5   0.55   0.6   0.65   0.7   0.8   0.9   1	0.4   0.45   0.5   0.55   0.6   0.65   0.7   0.8   0.9   1
	Switchable overload protection (from $I^2t$ - to $I^4t$ -dependent function)	–	■
	Setting range of delay $t_r$ at $I^2t$ (Reference point $6 \times I_n$ )	10 s fixed	2   3.5   5.5   8   10   14   17   21   25   30 s
	Setting range of delay $t_r$ at $I^4t$ (Reference point $6 \times I_n$ )	–	1   2   3   4   5 s
	Thermal memory can be switched on/off	–	■
	Phase failure sensitivity / asymmetry	At $t_{sd} = 20$ ms (M)	At $t_{sd} = 20$ ms (M)
<b>S</b> Short-time delay short-circuit protection (ST tripping operation)	Setting range of operating value $I_{sd} = I_n \times \dots$	1.25   1.5   2   2.5   3   4   6   8   10   12	1.25   1.5   2   2.5   3   4   6   8   10   12   OFF
	Setting range of delay time $t_{sd}$ at $I^2t$	–	100   200   300   400 ms
	Setting range of delay time $t_{sd}$ ( $t = \text{const.}$ )	M (0.02 ms)   100   200   300   400 ms	M (0.02 ms)   100   200   300   400 ms
	ZSI function	–	Via module of the <b>CubicleBUS</b>
<b>I</b> Instantaneous short-circuit protection (INST tripping operation)	Setting range $2 = I_n \times \dots$	Fixed at $I_l \geq 20 \times I_n$ , max. 50 kA	OFF   1.5   2.2   3   4   6   8   10   12   $0.8 \times I_{cs}$
<b>N</b> Neutral conductor protection	Neutral conductor setting range $I_N = I_n \times \dots$	–	OFF   50%   100%
<b>G</b> Ground-fault tripping operation (GF tripping operation) Detection of ground-fault current through summation current formation with internal or external N conductor transformer	Tripping function can be switched on/off	–	■
	Alarm function can be switched on/off	–	–
	Detection of ground-fault current through external current transformer	–	■
	Setting range of the operating current $I_g = I_n \times \dots$	–	A <sup>1)</sup> (100/400 A)   B <sup>1)</sup> (300/600 A); C <sup>1)</sup> (600/800 A)   D <sup>1)</sup> (900/1000 A); E <sup>1)</sup> (1200/1200 A)
	Setting range of the operating current $I_g$ for alarm	–	A <sup>1)</sup> (100/400 A); B <sup>1)</sup> (300/600 A); C <sup>1)</sup> (600/800 A); D <sup>1)</sup> (900/1000 A); E <sup>1)</sup> (1200/1200 A)
	Setting range of the delay time $t_g$	–	100   200   300   400   500 ms
	Switchable grounding protection characteristic ( $I^2t$ -dependent function)	–	■
	Setting range of delay time $t_g$ at $I^2t$	–	100   200   300   400   500 ms
ZSI-G function	–	Via module of the <b>CubicleBUS</b>	

<sup>1)</sup> Sizes 1 and 2 / size 3











		ETU25B (LSI)	ETU45B (LSIG)
Parameter set changeover	Switchable between parameter set A and B	–	–
LCD		–	Optional
Voltage tap on top/bottom		–	Optional
Metering function		–	Metering function Plus
<b>Tripping operation as a result of extended protection function: (including: phase asymmetry current/voltage, harmonic distortion current/voltage, under/overvoltage, phase rotation direction, active power in/opposite to normal direction, under/over-frequency, protection functions dependent on direction of power flow)</b>			
		–	■
<b>Mode of communication</b>			
Communication PROFIBUS   PROFINET   Modbus RTU   Modbus TCP		–	■
<b>Output modules</b>			
Signals via relay: Overload warning, load shedding / load carrying, leading signal, overload tripping 200 ms, temperature alarm, phase asymmetry, instantaneous short-circuit release, short time-delayed short-circuit release, overload trip, neutral conductor trip, auxiliary relay, ETU faults, grounding protection tripping and grounding protection alarm (only with grounding protection module)		–	■

# Connection

## Main circuit connection

### 3WL5

Connection	Fixed-mounted	Withdrawable
Front-mounted	 1-hole	 2-hole
	 1-hole	 2-hole
Rear-mounted	 Vertical	 Vertical
	 Horizontal	 Horizontal

## Auxiliary circuit connections


### 3WL5: Withdrawable version

- Connection of the internal auxiliary switches to the male connector on the switch side
- When fully inserted, connection with the sliding contact module in the guide frame


### 3WL5: Fixed-mounted version

- Engagement of the auxiliary supply connectors directly onto the circuit breaker

Coding pins on the connectors prevent them being inserted in the wrong slots



Screw connection (standard)



Screwless connection (tension spring) (optional)

# Operating mechanism, auxiliary release, auxiliary switch

## Operating mechanism

The circuit breakers are available with various optional operating mechanisms:

- Manual operating mechanism with mechanical closing (standard design)
- Manual operating mechanism with mechanical and electrical closing
- Motorized operating mechanism with mechanical and electrical closing

The operating mechanisms with electrical closing are suitable for synchronization tasks.

	Available for air circuit breakers 3WL5
Closing coils (CC)	■
Undervoltage releases (UVR) / shunt trips (ST)	■
Shunt trips (ST)	■
Remote reset magnets (RR)	■
Motorized operating mechanism (MO)	■
Mechanical operating cycles counters	■

# 3WL5 system overview

UL 489 AC ..

For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

1

## Switching devices



Sizes 1 to 3

### Trip units



LSI



LSIN, LSING

### Accessories



Communi-  
cation  
module



Rating plugs



Remote reset  
magnets




Breaker status  
sensors (BSS)



Ground-fault  
modules

## Main conductor connections



Fixed-mounted,  
withdrawable versions




Main connection vertical,  
horizontal, front, flange

### Accessories




Auxiliary conductor plug-in system

## Operating mechanisms and auxiliary releases




Motorized operating mechanisms



Auxiliary releases

### Accessories




Closing coils

#### Note:


You will find a detailed range of accessories in the Accessories section.

## Auxiliary switches



Auxiliary switches

## Accessories



Position signaling switches

## Further accessories



Door sealing frames



Shutters



EMERGENCY-OFF pushbuttons



Operating cycle counters



Support brackets



Grounding connections

## Interlocking



Interlocking sets



Key operation

**Note:** You will find a detailed range of accessories in the Accessories section.

# Online configurator highlights

[www.siemens.com/lowvoltage/configurators](http://www.siemens.com/lowvoltage/configurators)

## Search function with global direct input

Searches for specific terms and jumps to MLFB based on input to the correct configurator

1

## Product list stores multiple configurations and can transfer them collectively to the shopping cart

List of products

[Load product list](#)

Actions ▾

No.	Article	Quantity	Unit price:	Documents		
1	<a href="#">3WL5110-3FB32-1AA2-Z B02+M41</a> fixed-mounted circuit breaker approved to UL489 3-pole, BG I, In=1000A AC 50/60 Hz, IEC: to 690V, 65kA at 440V ul: to 600y... ▾ Further details	<input type="text" value="1"/> <small>Piece</small>	on request	> all documents for position	...	

## Recall of completed configurations for modification or additional configuration

List of products

[Load product list](#)

Actions ▾

No.	Article	Quantity	Unit price:	Documents		
1	<a href="#">3WL5110-3FB32-1AA2-Z B02+M41</a> fixed-mounted circuit breaker approved to UL489 3-pole, BG I, In=1000A AC 50/60 Hz, IEC: to 690V, 65kA at 440V ul: to 600y... ▾ Further details	<input type="text" value="1"/> <small>Piece</small>	on request	> all documents for position	...	

## Responsive Design

1



[www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

## Download an ePlan Selector for 3WL5

The configuration is complete. You can order this product.

Basic breaker | ETU | Connection | Motor and auxiliary releases | Auxiliary switches | Accessories | Locking | Result | CAD/CAE | 15.3

3WL5110-3FB32-1AA2-Z...

Wire frame view | Area Model

**Documentation and reporting**

Choose languages for the data sheet: deutsch

Project data for the datasheet

Download selection of document types

Data sheets (PDF)

Selection of download format

All in a ZIP file

Start generation

Component documentation

3WL5110-3FB32-1AA2-Z B02

Datasheet (PDF)

© Siemens AG | Application information

Download - quick links

3WL5110-3FB32-1AA2-Z...

Click2CAD

Download - all CAD formats

View: Wire frame view

View option: Isometric

File type: Joint Photography Experts Group (\*.jpg)

Start generation

Download - all documents

open documents dialog

## Mouseover display of characteristic curves to show the protection function

The configuration is not complete, please set all orange values.

Basic configuration | Trip units | Main connection | Motor | Auxiliary release / Closing coil | 2019\_08.02

Choose value:

Trip units	Protective function	Communication capability	Metering capability	Display
Non-automatic breaker	-	-	-	-
ETU120	LI	-	-	-
ETU250	LI	-	-	-
ETU360	-	-	-	-
ETU450	-	yes	yes	yes
ETU460	-	yes	yes	yes

Graph showing characteristic curves for the selected trip unit (ETU460).

## Direct entry of an already known MLFB or parts of an MLFB

### 3WL Air Circuit Breakers

Product Information

Configurators

Select a Configurator: 3WL10 Air Circuit-Breakers, FS0

#### 3WL10 Air Circuit-Breakers, FS0

Selection - Tool for air circuit breakers (ACB) SENTRON 3WL10 from 630 A to 1250 A

- for selective line protection
- for motor protection
- non-automatic circuit breaker



Using this configurator, you can precisely select the optimum circuit breaker configuration for your application. Comprehensive CAX-data support of the device is provided after successful configuration.

Start

MLFB direct input (complete): 3WL1010-2CE41-0AA0

Start

# Structure of the article numbers

## Basic configuration for AC circuit breakers

The structure shown below is intended as an overview of each position and its meaning. For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

		5	6	7	8	9	10	11	12	13	14	15	16
		3WL5			-								
<b>Basic unit and ETU</b>													
<b>Size (SZ)</b>	1	1											
	2	2											
	3	3											
		SZ 1	SZ 2	SZ 3									
<b>Max. rated current</b>	1000 A	■	-	-	1	0							
$I_n$	1600 A	■	-	-	1	6							
	2000 A	-	■	-	2	0							
	2500 A	-	■	-	2	5							
	3000 A	-	■	-	3	0							
	3200 A	-	■ <sup>1)</sup>	-	3	2							
	4000 A	-	-	■	4	0							
	5000 A	-	-	■	5	0							
<b>Short-circuit breaking capacity</b>	S Standard	■	-	-	≤65 kA	3							
$I_{cu}$ at 480 V	H High	-	■	■	≤100 kA	4							
<b>Trip units</b>	Without communications interface	Without electronic trip unit		ETU25B <sup>2)</sup>	LSI	A	A						
		Without ground-fault protection		ETU45B	LSIN	E	B						
		Without ground-fault protection		ETU45B (with display)	LSIN	F	B						
	With ground-fault protection	Without ground-fault protection		ETU45B	LSING	E	G						
		With ground-fault protection		ETU45B (with display)	LSING	F	G						
<b>Number of poles</b>	3-pole							3					
	4-pole							4					
<b>Connection</b>		SZ 1	SZ 2	SZ 3									
<b>Type of mounting</b>	Fixed-mounted	■	■	■	Vertical			1					
		■	■ <sup>3)</sup>	■	Horizontal			2					
		■	■ <sup>3)</sup>	■ <sup>4)</sup>	Front single hole			3					
		■	■ <sup>3)</sup>	■ <sup>4)</sup>	Front double hole			4					
	Withdrawable	■	■ <sup>3)</sup>	■	Without frame			5					
		■	■ <sup>3)</sup>	■	Rear horizontal connection			6					
		■	■ <sup>3)</sup>	■	Rear vertical connection			7					
		■	■ <sup>3)</sup>	■ <sup>4)</sup>	Connecting flange			8					

<sup>1)</sup> For fixed-mounted versions only

<sup>2)</sup> Only available for delivery until September 30, 2021

<sup>3)</sup> Not available for 3200 A

<sup>4)</sup> Not available for 5000 A

## 3WL5

5	6	7	8	9	10	11	12	13	14	15	16
---	---	---	---	---	----	----	----	----	----	----	----

## Motor

<b>Stored energy mechanism</b>	Manual recharging of the stored energy mechanism	With mechanical operation		1
		With mechanical and electrical closing, closing coil suitable for uninterrupted duty, 100% OP	110 V AC 50/60 Hz / 110 ... 125 V DC	2
			240 V AC 50/60 Hz / 220 V DC	3
	Motorized recharging	With mechanical and electrical closing, closing coil suitable for uninterrupted duty, 100% OP	208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC	4
			110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC	5
			24 V DC	6
<b>1st auxiliary release</b>	Without 1st auxiliary release			A
	With shunt trip (ST) 100% OP	24 V DC		B
		30 V DC		C
		48 V DC		D
		60 V DC		E
		110 ... 127 V AC, 110 ... 125 V DC		F
		208 ... 240 V AC, 220 ... 250 V DC		G
<b>2nd auxiliary release</b>	Without 2nd auxiliary release			A
	With shunt trip (ST) 100% OP	24 V DC		B
		30 V DC		C
		48 V DC		D
		60 V DC		E
		110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC		F
		208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC		G
		With undervoltage release (UVR), instantaneous	24 V DC	
	30 V DC			K
	48 V DC			L
	60 V DC			U
	110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC			M
	208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC			N
	380 ... 415 V AC 50/60 Hz			P
	With undervoltage release (UVR), delay 0.2 ... 3.2 s		48 V DC	
110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC			R	
208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC			S	
380 ... 415 V AC 50/60 Hz			T	

## Auxiliary switches

<b>1st auxiliary switch block</b>	2 NO + 2 NC	2
<b>1st + 2nd auxiliary switch block</b>	4 NO + 4 NC	4
	6 NO + 2 NC	7
	5 NO + 3 NC	8

# Structure of the article numbers

## Basic configuration for DC circuit breakers

The structure shown below is intended as an overview of each position and its meaning. For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

		5	6	7	8	9	10	11	12	13	14	15	16
<b>3WL5</b>					-					-			
<b>Basic unit and ETU</b>													
<b>Size (SZ)</b>	1	1											
	2 <sup>1)</sup>	2											
		SZ 1	SZ 2										
<b>Max. rated current</b>	1600 A <sup>2)</sup>	■	-										
<b>I<sub>n</sub></b>	3200 A	-	■			2	0						
						3	2						
<b>Short-circuit breaking capacity</b>	20 kA at 1000V +10%	■	-										
<b>I<sub>cu</sub></b>	25 kA at 690V	-	■										
<b>Non-automatic air circuit breaker</b>	Without communications interface												
	Without electronic trip unit												
								A	A				
<b>Number of poles</b>	3-pole	-	■										3
	4-pole	■	-										4
<b>Connection</b>		SZ 1	SZ 2										
<b>Type of mounting</b>	Fixed-mounted	■	■	Vertical									1
		■	■	Horizontal									2

<sup>1)</sup> Can also be used for variable frequencies of 0 ... 30 Hz.  
Z option A17 must always be ordered additionally.

<sup>2)</sup> Acc. to IEC 60947-2, the rated current is 2000 A

## 3WL5

5	6	7	8	9	10	11	12	13	14	15	16
---	---	---	---	---	----	----	----	----	----	----	----

## Motor

<b>Stored energy mechanism</b>	Manual recharging of the stored energy mechanism	With mechanical operation		1
		With mechanical and electrical closing, closing coil suitable for uninterrupted duty, 100% OP	110 V AC 50/60 Hz / 110 ... 125 V DC	2
			240 V AC 50/60 Hz / 220 V DC	3
	Motorized recharging	With mechanical and electrical closing, closing coil suitable for uninterrupted duty, 100% OP	208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC	4
			110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC	5
			24 V DC	6
<b>1st auxiliary release</b>	Without 1st auxiliary release			A
	With shunt trip (ST) 100% OP	24 V DC		B
		30 V DC		C
		48 V DC		D
		60 V DC		E
		110 ... 127 V AC, 110 ... 125 V DC		F
		208 ... 240 V AC, 220 ... 250 V DC		G
<b>2nd auxiliary release</b>	Without 2nd auxiliary release			A
	With shunt trip (ST) 100% OP	24 V DC		B
		30 V DC		C
		48 V DC		D
		60 V DC		E
		110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC		F
		208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC		G
		With undervoltage release (UVR), instantaneous	24 V DC	
	30 V DC		K	
	48 V DC		L	
	60 V DC		U	
	110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC		M	
	208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC		N	
	380 ... 415 V AC 50/60 Hz		P	
With undervoltage release (UVR), delay 0.2 ... 3.2 s	48 V DC		Q	
110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC		R		
208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC		S		
380 ... 415 V AC 50/60 Hz		T		

## Auxiliary switches

<b>1st auxiliary switch block</b>	2 NO + 2 NC	2
<b>1st + 2nd auxiliary switch block</b>	4 NO + 4 NC	4
	6 NO + 2 NC	7
	5 NO + 3 NC	8

# Accessory options

For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

To specify the options, add "-Z" to the complete Article No. and indicate the appropriate order code(s).

3WL....-.....-.... -Z

Order code

## Accessories for basic configuration

### IT-system capability at 690 V AC + 10% according to IEC 60947-2 Annex H

Rated voltage AC	Size	Article No.	Order code
	Size 2	3WL5225-4..31-...	A17
		3WL5225-4..32-...	A17
		3WL5232-4..31-...	A17
	Size 3	3WL5340-4..31-...	A17
		3WL5340-4..32-...	A17
		3WL5350-4..31-...	A17
	Size 3	3WL5350-4..32-...	A17
		3WL5232-8AA31-...	A17
		3WL5232-8AA32-...	A17
Rated voltage DC	Size 2		

## Accessories for electronic trip units ETU

### Rating plugs

- Only one module is possible per circuit breaker.
- As standard, the electronic trip units are equipped with a rating plug which is equal to the maximum rated circuit breaker current ( $I_{n \max}$ ). The rated current of the selected rating plug must be less than  $I_{n \max}$ .

Module	Sizes	Rating (A)	Order code
	Sizes 1, 2	250 A	B02
		315 A	B03
		400 A	B04
		500 A	B05
		630 A	B06
		800 A	B08
		1000 A	B10
	Sizes 1, 2, 3	1250 A	B12
		1600 A	B16
	Sizes 2, 3	2000 A	B20
		2500 A	B25
		3000 A	B30
		3200 A	B32
	Size 3	4000 A	B40
		5000 A	B50

## Communication and metering function

Function	Description	Order code
Breaker status sensor (BSS)	For determining the statuses ON / OFF / Tripped	F01
PROFIBUS DP communication port <sup>1)</sup>	Including COM15 and breaker status sensor (BSS)	F02
MODBUS RTU communication port <sup>1)</sup>	Including COM16 and breaker status sensor (BSS)	F12
PROFINET IO / Modbus TCP communication port <sup>1)</sup>	Including COM35 and breaker status sensor (BSS)	F35
Metering function Plus <sup>2)</sup>	Without communication module	F05

<sup>1)</sup> When ordering withdrawable circuit breaker and guide frame separately, specify order code "F02", "F12" or "F35" only for withdrawable circuit breaker.

<sup>2)</sup> Additional voltage transformers are always required for connection of the metering function Plus.

To specify the options, add "-Z" to the complete Article No. and indicate the appropriate order code(s).

3WL....-.....-.... -Z

Order code

## Accessories for electronic trip units ETU

### EMC filter

- Common-mode interference suppressor filters (e.g. in IT networks, caused by frequency converters)
- Insertion loss (asymmetric) in the range 40 kHz to 10 MHz >40 dB.

EMC filter			F31
------------	--	--	-----

### Overload and short-circuit protection for neutral conductors

- Only possible with 4-pole circuit breaker with ETU45B

Internal current transformer for N conductor	Size 1		F23
	Size 2		F23
	Size 3		F23

### Remote resetting

#### Automatic reset of the reclosing lockout

- Remote reset for displays and reset buttons including automatic reset of the reclosing lockout

Remote reset magnets	24 V DC		K10
	48 V DC		K11
	120 V AC 50/60 Hz / 125 V DC		K12
	208 ... 250 V AC 50/60 Hz / 208 ... 250 V DC		K13

## Connection

### Connection technology for main connections (fixed mounting)

Top: <sup>1)</sup> horizontal Bottom: accessible from front, single hole	Size 1	≤1600 A	N11
	Size 2	≤2000 A	N11
		≤2500 A	N11
		≤3200 A	N11
		≤4000 A	N11
Top: vertical Bottom: horizontal	Size 1	≤1600 A	N20
		≤2000 A	N20
	Size 2	≤2000 A	N20
		≤2500 A	N20
		≤3200 A	N20
		≤4000 A	N20
	Size 3	≤4000 A	N20
		≤5000 A	N20
Top: horizontal Bottom: vertical	Size 1	≤1600 A	N24
		≤2000 A	N24
	Size 2	≤2000 A	N24
		≤2500 A	N24
		≤3200 A	N24
		≤4000 A	N24
	Size 3	≤4000 A	N24
		≤5000 A	N24

<sup>1)</sup> Cannot be used for DC non-automatic air circuit breakers and circuit breakers with the Z option A17.

# Accessory options

For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

To specify the options, add "-Z" to the complete Article No. and indicate the appropriate order code(s).

3WL....-.....-.... -Z

Order code

## Connection

### Connection technology for main connections (withdrawable versions)

Top and bottom: accessible from front, single hole	Size 1	≤1600 A	P00
	Size 2	≤3200 A	P00
	Size 3	≤4000 A	P00
Top and bottom: accessible from front, double hole	Size 1	≤1600 A	P01
	Size 2	≤3200 A	P01
	Size 3	≤4000 A	P01
Top: horizontal Bottom: accessible from front, single hole	Size 1	≤1600 A	P07
	Size 2	≤3200 A	P07
	Size 3	≤4000 A	P07

### Connection technology for main connections (withdrawable versions)

Top: vertical Bottom: horizontal	Size 1	≤1600 A	P18
	Size 2	≤3200 A	P18
	Size 3	≤5000 A	P18
Top: connecting flange Bottom: horizontal	Size 1	≤1600 A	P19
	Size 2	≤3200 A	P19
	Size 3	≤4000 A	P19
Top: horizontal Bottom: vertical	Size 1	≤1600 A	P23
	Size 2	≤3200 A	P23
	Size 3	≤5000 A	P23
Top: horizontal Bottom: connecting flange	Size 1	≤1600 A	P28
	Size 2	≤3200 A	P28
	Size 3	≤4000 A	P28

## Connection

### Connection technology for auxiliary conductors (for fixed-mounted and withdrawable circuit breakers)

Connection technology for screwless terminals (tension spring)	Fixed-mounted	N61
	Withdrawable	P61



To specify the options, add "-Z" to the complete Article No. and indicate the appropriate order code(s).

3WL.....-.....-..... -Z

Order code

## Operating mechanisms and auxiliary releases

<b>Motorized operating mechanisms</b>	Only possible if the 13th digit of the Article No. = "1"	24 ... 30 V DC	M01	
		48 ... 60 V DC	M03	
		110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC	M05	
		208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC	M06	
<b>Mechanical operating cycles counter, 5-digit<sup>1)</sup></b>			C01	
<b>Closing coils</b>	<ul style="list-style-type: none"> <li>Suitable for uninterrupted duty, 100% OP</li> <li>Only possible if the 13th digit of the Article No. = "1"</li> </ul>	24 V DC	M21	
		30 V DC	M22	
		48 V DC	M23	
		60 V DC	M24	
	110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC	M25		
	208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC	M26		
	<ul style="list-style-type: none"> <li>Not suitable for uninterrupted duty, 5% OP, synchronizable<sup>3)</sup></li> <li>Only possible if the 13th digit of the Article No. = "1"</li> </ul>	24 V DC	M31	
		48 V DC	M33	
		110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC	M35	
		208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC	M36	
<b>Opening coils (shunt trips)<sup>2)3)</sup></b>		Not suitable for uninterrupted duty, 5% OP, synchronizable	24 V DC	M41
			48 V DC	M43
	110 ... 127 V AC 50/60 Hz / 110 ... 125 V DC		M45	
	208 ... 240 V AC 50/60 Hz / 220 ... 250 V DC		M46	
<b>Auxiliary switches and signaling switches</b>				
<b>Position signaling switches for guide frames</b>	1 CO   1 CO   1 CO (connected   test   disconnected position)		R15	
	3 CO   2 CO   1 CO (connected   test   disconnected position)		R16	
<b>Signaling switches</b>	Ready-to-close signaling switches (S20)	1 NO contact	C22	
	Spring charged signaling switch <sup>4)</sup> (S21)	1 NO contact	C20	
	For the first auxiliary release <sup>5)</sup> (S22)	1 CO contact	C26	
	For the second auxiliary release <sup>5)</sup> (S23)	1 CO contact	C27	
	1st tripped signaling switch <sup>4)6)</sup> (S24)	1 CO contact	K07	
	2nd tripped signaling switch <sup>4)5)6)</sup> (S25)	1 NO contact	K06	

<sup>1)</sup> Only possible with motorized operating mechanism.

<sup>2)</sup> Only possible if the 14th digit of the Article No. for the circuit breaker is "A", i.e. "without 1st auxiliary release".

<sup>3)</sup> Overexcited, i.e. switching time 50 ms (standard >80 ms).

<sup>4)</sup> Not possible with "communications interface" option, order code "F02", "F12" or "F35".

<sup>5)</sup> Only possible with option "K07".

<sup>6)</sup> Not available for non-automatic air circuit breakers.

# Accessory options

For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

To specify the options, add "-Z" to the complete Article No. and indicate the appropriate order code(s).

3WL.....-.....-..... -Z

Order code

## Further accessories

### Pushbuttons / shutdown switches / closing lockouts

EMERGENCY-OFF pushbuttons	Mushroom pushbutton instead of the mechanical OFF pushbutton		S24
Electrical ON button S10 in the operator panel <sup>1)</sup>	This prevents unauthorized electrical closing from the operator panel. Mechanical closing and remote closing remain possible. Possible only for circuit breakers with closing coil (CC)	With sealing cap	C11
		With CES lock	C12
Motor shutdown switch on operator panel <sup>2)</sup> (S12)	This prevents automatic charging of the stored energy mechanism by the spring charging motor		S25

### Special packaging for increased transport requirements (moisture protection)

Cardboard packaging with water-repellent coating on corrugated cardboard (moisture protection)		A61
--	--	-----

### Shutters

Shutter: 2-part, lockable, with padlocks <sup>4)</sup>	3-pole, 4-pole	Sizes 1 / 2 / 3	R21
--	----------------	-----------------	-----

## Interlocking

### Mechanical interlocks

- Interlocking module with Bowden cable 2 m

Mutual mechanical interlockings	For fixed-mounted breakers	S55
	For withdrawable circuit breakers with guide frame	R55
	For guide frames (ordered separately)	R56
	For withdrawable circuit breakers (ordered separately)	R57

### Locking provisions (for fixed-mounted and withdrawable circuit breakers)

- The disconnecter unit fulfills the requirements for main circuit breakers according to EN 60204-1

Locking provisions	To prevent unauthorized activation in the operator panel	Made by CES	S01
		Made by IKON	S03
		Assembly kit FORTRESS or CASTELL <sup>3)</sup>	S05
		Assembly kit for padlocks <sup>4)</sup>	S07
		Made by RONIS	S08
		Made by PROFALUX	S09

### Locking provisions (for fixed-mounted and withdrawable versions)

Locking provisions	For charging handle <sup>4)</sup>	S33
--------------------	-----------------------------------	-----

### Locking provisions (for withdrawable circuit breaker)

- The disconnecter unit fulfills the requirements for main circuit breakers acc. to EN 60204-1, consisting of a lock in the guide frame, active in the connected position, function is retained when circuit breaker is replaced.
- Not possible in combination with order code "R81", "R85" or "R86".

Locking provisions	To prevent unauthorized activation in the operator panel	Made by CES	R61
		Made by RONIS	R68
		Made by PROFALUX	R60

<sup>1)</sup> Not possible with "communications interface" option, order code "F02", "F12" or "F35".

<sup>2)</sup> Only for breakers with motorized operating mechanism, not possible with order codes "C11", "C12".

<sup>3)</sup> Locks must be ordered from the manufacturer.

<sup>4)</sup> Padlock not included in the scope of supply.

To specify the options, add "-Z" to the complete Article No. and indicate the appropriate order code(s).

3WL.....-.....-..... -Z

Order code

## Interlocking

### Locking provisions (for withdrawable circuit breaker)

- Safety lock for mounting onto the circuit breaker

Locking provisions	To prevent movement of the withdrawable circuit breaker	Made by CES	S71
		Made by PROFALUX	S75
		Made by RONIS	S76

### Locking mechanisms

- Not possible in combination with order code "R81", "R85" or "R86".
- R30 and R50 only possible on complete order for a circuit breaker with a guide frame or when ordering the guide frame separately

For fixed-mounted circuit breakers	To prevent opening of the cabinet door in ON position	S30
For withdrawable circuit breakers	To prevent opening of the cabinet door in connected position	R30
	To prevent movement when the cabinet door is open	R50

### Locking mechanisms to prevent movement of the withdrawable circuit breakers in disconnected position

- Consisting of Bowden cable and lock in the cabinet door
- Not possible in combination with order code "R30", "R50", "R61", "R68" or "R60".

Made by CES	R81
Made by PROFALUX	R85
Made by RONIS	R86

### Seals

Door sealing frame for degree of protection IP41	T40
--	-----

# Accessory options

## Further technical specifications

### Manual operating mechanism

3WL5

#### Switching on/charging the stored-energy operating mechanism

Maximum force required to operate the hand lever	≤230 N
Required number of strokes on the hand lever	9

### Closing coils

3WL5

#### Primary operating range

Primary operating range		0.85 ... 1.1 × U <sub>s</sub>
Extended operating range for battery operation	At 24 V DC, 48 V DC 60 V DC, 110 V DC 220 V DC	0.7 ... 1.26 × U <sub>s</sub>

#### Rated voltage

Rated control supply voltage U <sub>s</sub>	50/60 Hz AC	110 ... 127 V, 208 ... 240 V
	DC	24 V, 30 V, 48 V, 60 V, 110 ... 125 V, 220 ... 250 V

#### Operation

Power consumption	AC/DC	15 VA/15 W
Min. command duration at U <sub>s</sub> for the closing coil		60 ms

#### Short-circuit protection

Smallest permissible DIAZED fuse (operational class gL)/ automatic circuit breaker with C characteristic; manual operating mechanism with mechanical and electrical closing		1 A TDz (slow)/1 A
Smallest permissible DIAZED fuse (operational class gL)/ automatic circuit breaker with C characteristic; motor and closing coil for the same rated control supply voltages; motorized operating mechanism with mechanical and electrical closing		6 A TDz (slow)/2 A
Smallest permissible DIAZED fuse (operational class gL)/ automatic circuit breaker with C characteristic (for different rated control supply voltages)	At U <sub>s</sub> = 24 ... 30 V	6 A
	At U <sub>s</sub> = 48 ... 60 V	6 A
	At U <sub>s</sub> = 110 ... 125 V DC/ 110 ... 127 V AC	2 A
	At U <sub>s</sub> = 220 ... 250 V DC/ 208 ... 240 V AC	2 A

### Motor

3WL5

#### Primary operating range

Primary operating range		0.85 ... 1.1 × U <sub>s</sub>
Extended operating range for battery operation	At 24 V DC, 48 V DC 60 V DC, 110 V DC 220 V DC	0.7 ... 1.26 × U <sub>s</sub>

#### Operation

Power consumption of motor	AC/DC	24/30 V DC, 110 W; 48/60 V DC, 120 W; 110 ... 127 V AC/110 ... 125 V DC, 150 W; 200 ... 240 V AC/220 ... 250 V DC, 130 W
Time required to charge the spring energy store at 1 × U <sub>s</sub>		≤10 s

#### Short-circuit protection

Smallest permissible DIAZED fuse (operational class gL)/ automatic circuit breaker with C characteristic; motor and closing coil for the same rated control supply voltages		6 A TDz (slow)/2 A
Smallest permissible DIAZED fuse (operational class gL)/ automatic circuit breaker with C characteristic (for different rated control supply voltages)	At U <sub>s</sub> = 24 ... 30 V	6 A
	At U <sub>s</sub> = 48 ... 60 V	6 A
	At U <sub>s</sub> = 110 ... 125 V DC/ 110 ... 127 V AC	2 A
	At U <sub>s</sub> = 220 ... 250 V DC/ 208 ... 240 V AC	2 A

### Signals of the electronic trip unit

3WL5

#### Signals of the electronic trip unit

Measuring accuracy of the electronic trip unit	Protection functions acc. to EN 60947; current indication ≤10%; metering function for base quantities ≤1%; metering function for derived quantities ≤4%
--	---

## Undervoltage releases UVR (F3) and UVR-t<sub>d</sub> (F4)

3WL5

Primary operating range		
Response values	Pickup	$\geq 0.85 \times U_s$ (circuit breaker can be closed)
	Dropout	$0.35 \dots 0.7 \times U_s$ (circuit breaker is tripped)
Primary operating range		$0.85 \dots 1.1 \times U_s$
Extended operating range for battery operation		$0.85 \dots 1.26 \times U_s$
At 24 V DC, 30 V DC, 48 V DC, 110 V DC, 220 V DC		
Rated voltage		
Rated control supply voltage $U_s$	Instantaneous 50/60 Hz AC	110 ... 127 V, 208 ... 240 V, 380 ... 415 V
	Instantaneous DC	24 V, 30 V, 48 V, 60 V, 110 ... 125 V, 220 ... 250 V <sup>1)</sup>
	Delayed 50/60 Hz AC	110 ... 127 V, 208 ... 240 V, 380 ... 415 V
	Delayed DC	48 V, 110 ... 125 V, 220 ... 250 V
Operation		
Power consumption (pickup/uninterrupted duty)	AC	20/5 VA
	DC	20/5 W
Opening time of the circuit breaker		
Version UVR (F3)	Instantaneous	$\leq 80$ ms
	With delay	200 ms
Version UVR-t <sub>d</sub> (F8)	With delay, $t_d = 0.2$ to $3.2$ s	$0.2 \dots 3.2$ s
	Reset through additional NC contact – direct tripping	$\leq 100$ ms
Short-circuit protection		
Smallest permissible DIAZED fuse (operational class gL)/miniature circuit breaker with C characteristic		1 A TDz (slow) / 1 A

## Shunt trip (ST) (F1, F2)

3WL5

Primary operating range				
Version		For continuous command (100% OP), locks out on momentary-contact commands	5% OP	With spring energy store consisting of shunt trip and capacitor storage device
Response values	Pickup	$> 0.7 \times U_s$ (circuit breaker is tripped)	$> 0.7 \times U_s$ (circuit breaker is tripped)	–
Primary operating range		$0.7 \dots 1.1 \times U_s$	$0.7 \dots 1.1 \times U_s$	$0.85 \dots 1.1 \times U_s$
Extended operating range for battery operation		$0.7 \dots 1.26 \times U_s$	$0.7 \dots 1.26 \times U_s$	–
At 24 V DC, 48 V DC, 60 V DC, 110 V DC, 220 V DC				
Rated voltage				
Rated control supply voltage $U_s$	50/60 Hz AC	110 ... 127 V, 208 ... 240 V	110 ... 127 V, 208 ... 240 V	110 V, 230 V
	DC	24 V, 30 V, 48 V, 60 V, 110 ... 125 V, 220 ... 250 V	24 V, 48 V, 110 ... 125 V, 220 ... 250 V	110 V, 220 V
Operation				
Power consumption	AC/DC	15 VA/15 W	15 VA/15 W	1 VA/1 W
Min. command duration at $U_s$		60 ms	25 ms	–
Storage time at $U_s/$ Recharging time at $U_s$		–	–	max. 5 min/ min. 5 s
Opening time of the circuit breaker				
Opening time of the circuit breaker at $U_s = 100\%$	At AC/DC	80 ms	50 ms	80 ms
Short-circuit protection				
Smallest permissible DIAZED fuse (operational class gL)/automatic circuit breaker with C characteristic		1 A TDz (slow)/1 A		

# Accessory options

## Further technical specifications

### Remote reset magnet for mechanical tripped indicator (F7)

3WL5

Primary operating range		
Primary operating range		0.85 ... $1.1 \times U_s$
Extended operating range for battery operation	At 24 V DC, 48 V DC 110 V DC 220 V DC	0.7 ... $1.26 \times U_s$
Operation		
Power consumption	AC/DC	50 VA/50 W
Min. command duration at $U_s$ for the remote reset magnet		60 ms
Short-circuit protection		
Smallest permissible DIAZED fuse (operational class gL)/ automatic circuit breaker with C characteristic		2 A TDz (slow)/1 A at 24 V DC and 48 V DC, 1 A TDz (slow)/1 A at 110 V and 208 ... 250 V

### Contact position-driven auxiliary switches (S1, S2, S3, S4, S7, S8)

3WL5

Rated voltage					
Rated insulation voltage $U_i$	AC/DC	500 V			
Rated operational voltage $U_e$	AC/DC	500 V			
Rated impulse withstand voltage $U_{imp}$		4 kV			
Contact reliability		From 1 mA at 5 V DC			
Breaking capacity					
Alternating current 50/60 Hz	Rated operational voltage $U_e$	24 ... 230 V	380 V, 400 V		
	Rated operational current $I_e/AC-12$	10 A	10 A		
	Rated operational current $I_e/AC-15$	4 A	3 A		
Direct current	Rated operational voltage $U_e$	24 V	48 V	110 V	220 V
	Rated operational current $I_e/DC-12$	10 A	8 A	3.5 A	1 A
	Rated operational current $I_e/DC-13$	8 A	4 A	1.2 A	0.4 A
Short-circuit protection					
Largest permissible DIAZED fuse (operational class gL)		10 A TDz, 10 A Dz			
Largest permissible miniature circuit breaker with C characteristic		10 A			

### Ready-to-close signaling switches (S20) (acc. to DIN VDE 0630)

3WL5

Breaking capacity			
Alternating current 50/60 Hz	Rated operational voltage $U_e$	250 V	
	Rated operational current $I_e$	8 A	
Direct current	Rated operational voltage $U_e$	125 V	250 V
	Rated operational current $I_e$	0.4 A	0.2 A
	Contact reliability	From 1 mA at 5 V DC	
Short-circuit protection			
Largest permissible DIAZED fuse (operational class gL)		2 A Dz (quick)	

## Tripped signaling switches (S24) and signaling switches for auxiliary releases (S22, S23) (acc. to DIN VDE 0630)

3WL5

Breaking capacity				
Alternating current 50/60 Hz	Rated operational voltage $U_e$	250 V		
	Rated operational current $I_e/AC-12$	8 A		
Direct current	Rated operational voltage $U_e$	24 V	125 V	250 V
	Rated operational current $I_e/DC-12$	6 A	0.4 A	0.2 A
	Contact reliability	From 1 mA at 5 V DC		
Short-circuit protection				
Largest permissible DIAZED fuse (operational class gL)		6 A Dz (quick)		
Tripped signaling switches				
Signal duration after tripping		Until manual or electrical remote reset (option)		

## Position signaling switches on guide frame

3WL5

Type of contacts				
Message	"Circuit breaker in connected position"	3 CO	or	1 CO
	"Circuit breaker in test position"	2 CO	or	1 CO
	"Circuit breaker in disconnected position"	1 CO	or	1 CO
Contact reliability (valid from April 1, 2020)		From 1 mA at 5 V DC		
Rated voltage				
Rated insulation voltage $U_i$	50/60 Hz AC	440 V		
	DC	250 V		
Rated operational voltage $U_e$	250 V			
Rated impulse withstand voltage $U_{imp}$	4 kV			
Breaking capacity				
Rated operational current $I_e$	$I_e/AC-12$	24 V 10 A, 110/127 V 10 A, 220/240 V 10 A, 320/440 V 10 A		
	$I_e/AC-15$	220/240 V 4 A, 320/440 V 3 A		
	$I_e/DC-12$	24 V 10 A, 48 V 2.5 A, 220/240 V 0.2 A		
	$I_e/DC-13$	24 V 3.0 A, 220/240 V 0.1 A		
	A 300 (AC)	120 V 6 A, 240 V 3 A		
	R 300 (DC)	125 V 0.22 A, 250 V 0.11 A		
Short-circuit protection				
Largest permissible DIAZED fuse (operational class gL)		8 A TDz (slow)		
Largest permissible automatic circuit breaker with C characteristic		8 A TDz (slow)		

1

# Guide frames for AC

The structure shown below is intended as an overview of each position and its meaning. For a complete and valid configuration of your air circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3wl-configurator](http://www.siemens.com/lowvoltage/3wl-configurator)

		5	6	7	8	9	10	11	12	13	14	15	16
<b>3WL9</b>		2	5		-					-		A	1
Size (SZ)	1			1									
	2			2									
	3			3									
		SZ 1	SZ 2	SZ 3									
Max. rated current $I_n$	1000 A	■	-	-	1								
	1600 A	■	-	-	2								
	2000 A	-	■	-	3								
	2500 A	-	■	-	4								
	3000 A	-	■	-	5								
	4000 A	-	-	■	6								
	5000 A	-	-	■	7								
Number of poles	3-pole	■	■	■								A	
	4-pole	■	■	■								B	
Main connection	Front, single hole	■	■	■ <sup>1)</sup>								A	
	Front, double hole	■	■	■ <sup>1)</sup>								B	
	Horizontal	■	■	■								C	
	Vertical	■	■	■								D	
	Connecting flange	■	■	■ <sup>1)</sup>								E	

<sup>1)</sup> Not available for rated circuit breaker current 5000 A

## Options

		5	6	7	8	9	10	11	12	13	14	15	16
<b>3WL9</b>		2	5		-					-		A	1
Number of auxiliary supply connectors	Without							0					
	1 connector							1					
	2 connectors							2					
	3 connectors							3					
	4 connectors							4					
Type of auxiliary circuit connections	Without <sup>2)</sup>							0					
	With screw terminals (SIGUT, standard)							1					
	With screwless terminals (tension spring)							2					
Position signaling switches	Without									0			
	1 CO   1 CO   1 CO (connected   test   isolated position)									1			
	3 CO   2 CO   1 CO (connected   test   isolated position)									2			
Shutters	Without										A		
	With shutter, 2-part, lockable										B		

<sup>2)</sup> Can only be selected if the number of auxiliary supply connectors = without



# Accessories and spare parts

## Accessories for electronic trip units ETU

### Protective devices with device holder and optional metering function



- For replacement in existing circuit breakers, please specify the circuit breaker ID No. when ordering.

Type	With protection function	Metering function	Article No.
ETU25B <sup>1)</sup>	LSI	Without	3WL9352-5AA00-0AA1
ETU45B (without display)	LSIN(G)	Without	3WL9354-5AA00-0AA1
		With metering function Plus	3WL9354-5AA20-0AA1

### Rating plugs



- With the rating plug selected, the maximum rated current  $I_{n \max}$  of the circuit breaker must not be exceeded. The following applies:  $I_n \leq I_{n \max}$ .

Size	Rated current $I_n$	Article No.
1, 2	250 A	3WL9111-2AA51-0AA0
	315 A	3WL9111-2AA52-0AA0
	400 A	3WL9111-2AA53-0AA0
	500 A	3WL9111-2AA54-0AA0
	630 A	3WL9111-2AA55-0AA0
	800 A	3WL9111-2AA56-0AA0
	1000 A	3WL9111-2AA57-0AA0
1, 2, 3	1250 A	3WL9111-2AA58-0AA0
	1600 A	3WL9111-2AA61-0AA0
2, 3	2000 A	3WL9111-2AA62-0AA0
	2500 A	3WL9111-2AA63-0AA0
	3000 A	3WL9111-2AA77-0AA0
	3200 A	3WL9111-2AA64-0AA0
3	4000 A	3WL9111-2AA65-0AA0
	5000 A	3WL9111-2AA66-0AA0

### Ground-fault modules



- Alarm and tripping
- For direct metering of the ground-fault current, e.g. in the star point of the transformer, a 1200 A/1 A current transformer, class 1, is required. The internal load of the 3WL circuit breaker is 0.11  $\Omega$ . If the ground-fault current is to be determined using the vectorial sum of the phases, a transformer must be installed in the neutral conductor.

Type	Accessory for	Article No.
GFM AT 45B	ETU45B	3WL9111-2AT53-0AA0

### Display



For ETU	Version	Article No.
ETU45B	4-line	3WL9111-1AT81-0AA0

### External current transformers for N conductor



Version	Size	Article No.
For mounting on busbar	1	3WL9111-0AA21-0AA0
	2	3WL9111-0AA22-0AA0
	3	3WL9111-0AA23-0AA0
For busbar connection	1	3WL9111-0AA31-0AA0
	2	3WL9111-0AA32-0AA0
	3	3WL9111-0AA33-0AA0

### EMC filter

- Common-mode interference suppressor filters (e.g. in IT networks, caused by frequency converters)
- Insertion loss (asymmetric) in the range 40 kHz to 10 MHz >40 dB.

Variants	Article No.
Only for ETU Release 2	3WL9111-0AK32-0AA0

<sup>1)</sup> Only available for delivery until September 30, 2021

# Accessories and spare parts

## Accessories for electronic trip units ETU

### Sealable and lockable covers




Accessory for	Article No.
ETU25B and ETU45B	3WL9111-0AT45-0AA0

### Automatic reset of the reclosing lockout

Version	Article No.
Spare part for option K01	3WL9111-0AK21-0AA0

### Remote reset magnets



- For mechanical tripped indicator
- Spare part for options K10 to K13
- **Note:** Automatic reset of the reclosing lockout 3WL9111-0AK21-0AA0 is also required


Voltage	Article No.
24 V DC	3WL9111-0AK03-0AA0
48 V DC	3WL9111-0AK04-0AA0
120 V AC / 125 V DC	3WL9111-0AK05-0AA0
208 ... 250 V AC / 208 ... 250 V DC	3WL9111-0AK06-0AA0

### Retrofittable internal wiring

Purpose	Male connector	Accessory for	Article No.
Internal wiring of CubicleBUS for connection to terminal X8	Without male connector for retrofitting the communication	ETU45B	3WL9111-0AK30-0AA0
For connection of the external N and G transformers to terminal X8	With male connector	Not for ETU Release 2	3WL9111-0AK31-0AA0

## Locking provisions and interlocks


### Interlocking sets for mechanical Open/Close



- Consisting of two transparent covers each for sealing or for attaching padlocks (padlocks not included in scope of supply)
- Cover with 6.35 mm hole (for tool actuation)
- Lock mount for safety lock for key operation

Version	Article No.
Without safety lock	3WL9111-0BA21-0AA0
Made by CES	3WL9111-0BA22-0AA0
Made by IKON	3WL9111-0BA24-0AA0


### Locking provision to prevent unauthorized activation, in the operator panel



- The disconnecter unit fulfills the requirements for main circuit breakers acc. to EN 60204-1
- Spare part for options S01 to S09

Variant	Scope of supply	Article No.
Assembly kit FORTRESS or CASTELL	Without locks, cylinders or keys	3WL9111-0BA31-0AA0
Made by RONIS	Locks, cylinders and keys included	3WL9111-0BA33-0AA0
Made by KIRK-Key	Without locks, cylinders or keys	3WL9111-0BA34-0AA0
Made by PROFALUX	Locks, cylinders and keys included	3WL9111-0BA35-0AA0
Made by CES	Locks, cylinders and keys included	3WL9111-0BA36-0AA0
Made by IKON	Locks, cylinders and keys included	3WL9111-0BA38-0AA0
Assembly kit for padlocks	Without padlock	3WL9111-0BA41-0AA0

### Locking provision against unauthorized closing, for withdrawable circuit breakers







- The disconnecter unit fulfills the requirements for main circuit breakers acc. to EN 60204-1
- Consisting of lock in the cabinet door, active in connected position, function is retained when circuit breaker is replaced
- Spare part for option R60, R61, R68

Variant	Scope of supply	Article No.
Made by CES	Locks, cylinders and keys included	3WL9111-0BA51-0AA0
Made by IKON	Locks, cylinders and keys included	3WL9111-0BA53-0AA0
Made by KIRK-Key <sup>1)</sup>	Without locks, cylinders or keys	3WL9111-0BA57-0AA0
Made by RONIS	Locks, cylinders and keys included	3WL9111-0BA58-0AA0
Made by PROFALUX	Locks, cylinders and keys included	3WL9111-0BA50-0AA0

<sup>1)</sup> Locks, cylinders and keys must be ordered from the manufacturer.

## Locking provisions and interlocks


Locking provisions for charging handle			
	<b>Version</b>	<b>Scope of supply</b>	<b>Article No.</b>
	Spare part for option S33	Without padlock	3WL9111-0BA71-0AA0
<b>Locking provision to prevent movement of the withdrawable circuit breaker</b>			
	<ul style="list-style-type: none"> <li>Safety lock for mounting onto the circuit breaker</li> <li>Spare part for option S71, S75, S76</li> </ul>		
	<b>Variant</b>	<b>Scope of supply</b>	<b>Article No.</b>
	Made by CES	Locks, cylinders and keys included	3WL9111-0BA73-0AA0
	Made by IKON	Locks, cylinders and keys included	3WL9111-0BA75-0AA0
	Made by PROFALUX	Locks, cylinders and keys included	3WL9111-0BA76-0AA0
	Made by RONIS	Locks, cylinders and keys included	3WL9111-0BA77-0AA0
	Made by KIRK-Key <sup>1)</sup>	Without locks, cylinders or keys	3WL9111-0BA80-0AA0
<b>Interlocking systems</b>			
<ul style="list-style-type: none"> <li>2 of the same keys for 3 circuit breakers</li> <li>Locking provision in OFF position</li> <li>Lock in the operator panel</li> <li>A maximum of 2 circuit breakers can be switched on</li> </ul>			
<b>Variant</b>			<b>Article No.</b>
Made by CES			3WL9111-0BA43-0AA0
<b>Locking mechanisms to prevent movement of the withdrawable circuit breakers in disconnected position</b>			
	<ul style="list-style-type: none"> <li>Consisting of Bowden cable and lock in the cabinet door on the circuit breaker</li> <li>Spare part for option R81, R85, R86</li> <li><b>Note:</b> Not possible in combination with "Locking mechanism to prevent opening of the cabinet door" (order code "R30") or "Locking mechanism to prevent movement with the cabinet door open" (order code "R50").</li> </ul>		
	<b>Variant</b>	<b>Article No.</b>	
	Made by CES	3WL9111-0BA81-0AA0	
	Made by IKON	3WL9111-0BA83-0AA0	
	Made by PROFALUX	3WL9111-0BA85-0AA0	
Made by RONIS	3WL9111-0BA86-0AA0		
<b>Locking mechanisms to prevent opening of the cabinet door in ON position</b>			
	<ul style="list-style-type: none"> <li>Fixed-mounted</li> <li>Defeatable</li> <li><b>Note:</b> Not possible in combination with "Locking mechanism to prevent movement of the withdrawable circuit breakers in disconnected position" (order codes "R81", "R85" or "R86").</li> </ul>		
	<b>Version</b>	<b>Article No.</b>	
Spare part for option S30		3WL9111-0BB12-0AA0	
<b>Locking mechanisms to prevent opening of the cabinet door</b>			
<ul style="list-style-type: none"> <li>Guide frames</li> <li>Defeatable</li> <li><b>Note:</b> Not possible in combination with "Locking mechanism to prevent movement of the withdrawable circuit breakers in disconnected position" (order codes "R81", "R85" or "R86").</li> </ul>			
<b>Version</b>			<b>Article No.</b>
Spare part for option R30			3WL9111-0BB13-0AA0
<b>Locking mechanisms to prevent movement with the cabinet door open</b>			
<ul style="list-style-type: none"> <li>Guide frames</li> <li><b>Note:</b> Not possible in combination with "Locking mechanism to prevent movement of the withdrawable circuit breakers in disconnected position" (order codes "R81", "R85" or "R86").</li> </ul>			
<b>Version</b>			<b>Article No.</b>
Spare part for option R50			3WL9111-0BB15-0AA0

<sup>1)</sup> Locks, cylinders and keys must be ordered from the manufacturer

# Accessories and spare parts

## Locking provisions and interlocks

### Mutual mechanical interlockings



- With Bowden cable 2000 mm (one required for each circuit breaker)

Type	When ordered separately	Spare part for	Article No.
Fixed-mounted circuit breaker	–	Option S55	3WL9111-0BB21-0AA0
Module for withdrawable circuit breakers with guide frame	–	Option R55	3WL9111-0BB24-0AA0
Module for guide frame	✓	Option R56	3WL9111-0BB22-0AA0
Module for withdrawable circuit breaker	✓	Option R57	3WL9111-0BB23-0AA0
Adapter for size 3 withdrawable circuit breaker	✓	–	3WL9111-0BB30-0AA0

### Couplings on the circuit breaker (with ring) for mutual interlocking



- Can be used in all circuit breakers

Article No.
3WL9112-8AH47-0AA0

### Bowden cables

Length	Article No.
2000 mm	3WL9111-0BB45-0AA0
3000 mm	3WL9111-0BB46-0AA0
4500 mm	3WL9111-0BB47-0AA0

## Test devices

### Manual tester, Release 2 for electronic trip units ETU25B to ETU45B



- For testing the Electronic Trip Unit functions of all 3WL ETUs (release 1 and release 2)

Article No.
3WL9111-0AT32-0AA0

### Function test unit

- For testing the tripping characteristics for electronic trip units ETU25B to ETU45B (release 1 and release 2)

Article No.
3WL9111-0AT44-0AA0

### TD400 Kit IEC<sup>1)</sup>

- Commissioning/Service Tool for UL 3WL5 (ETU Release 1)
- With adapter, cable and case

Article No.
3VW9011-0AT41

### TD400 adapter (spare part)

Version	Article No.
for 3VA	3VW9011-0AT43
for 3WL ETU Release 1	3VW9011-0AT44

## Storage devices






### Capacitor storage devices

- For shunt trips
- Storage time 5 min
- Also suitable for 3VL circuit breakers
- **Note:** Rated control supply voltage must match the rated control supply voltage of the shunt trips.

Rated control supply voltage/rated operational voltage	Article No.
50/60 Hz AC	DC
220 ... 240 V	220 ... 250 V
	3WL9111-0BA14-0AA0

<sup>1)</sup> A country-specific radio license is required to operate the Bluetooth interface.  
Before activating the Bluetooth function, ensure that the license is available:  
[www.siemens.com/lowvoltage/certificates](http://www.siemens.com/lowvoltage/certificates)


## Indicators and control elements

Ready-to-close signaling switches (S20)			
	<b>Version</b>	<b>Contacts</b>	<b>Article No.</b>
	Spare part for option C22	1 NO contact	3WL9111-0AH01-0AA0
<b>Signaling switch (S22 or S23)</b>			
	<ul style="list-style-type: none"> <li>Not possible with communication port, order code "F02", "F12" or "F35"</li> <li>Auxiliary supply connection X7 required for circuit breakers or guide frames. If this is not already available, please order additionally</li> </ul>		
	<b>Version</b>	<b>Contacts</b>	<b>Article No.</b>
Spare part for options C26 to C27	1st or 2nd auxiliary release	3WL9111-0AH02-0AA0	
<b>1st tripped signaling switch (S24)</b>			
	<ul style="list-style-type: none"> <li>Not possible with communication port, order code "F02", "F12" or "F35"</li> <li>Auxiliary supply connection X7 required for circuit breakers or guide frames. If this is not already available, please order additionally</li> </ul>		
	<b>Version</b>	<b>Contacts</b>	<b>Article No.</b>
Spare part for option K07	1 CO contact	3WL9111-0AH14-0AA0	
<b>2nd tripped signaling switch (S25)</b>			
	<ul style="list-style-type: none"> <li>Not possible with communication port, order code "F02", "F12" or "F35"</li> <li>Auxiliary supply connection X7 required for circuit breakers or guide frames. If this is not already available, please order additionally</li> <li>Can only be used in combination with 1st tripped signaling switch</li> </ul>		
	<b>Version</b>	<b>Contacts</b>	<b>Article No.</b>
Spare part for option K06	1 NO contact	3WL9111-0AH17-0AA0	
<b>Operating cycle counters</b>			
	<ul style="list-style-type: none"> <li>Only in conjunction with motorized operating mechanism.</li> </ul>		
	<b>Variant</b>	<b>Version</b>	<b>Article No.</b>
Spare part for option C01	Mechanical	3WL9111-0AH07-0AA0	
<b>Spring charged signaling switch</b>			
	<ul style="list-style-type: none"> <li>Not possible with communication port, order code "F02", "F12" or "F35".</li> <li>Auxiliary supply connection X7 required for circuit breakers or guide frames. If this is not already available, please order additionally</li> </ul>		
	<b>Version</b>	<b>Contacts</b>	<b>Article No.</b>
Spare part for option C20	1 NO contact	3WL9111-0AH08-0AA0	
<b>Position signaling switches for guide frames</b>			
	<b>Version</b>	<b>Contacts</b>	<b>Article No.</b>
	Spare part for options R15 to R16	1st block (3 CO contacts)	3WL9111-0AH11-0AA0
		2nd block (6 CO contacts)	3WL9111-0AH12-0AA0
<b>Electrical ON button (S10) for operator panel</b>			
	<ul style="list-style-type: none"> <li>Not possible with communication port, order code "F02", "F12" or "F35"</li> <li>Not possible with motor shutdown switch</li> <li>Button + wiring (Auxiliary supply connection X7 required for circuit breakers or guide frames. If this is not already available, please order additionally)</li> <li><b>Note:</b> Possible only for circuit breakers with closing coil.</li> </ul>		
	<b>Version</b>	<b>Variant</b>	<b>Article No.</b>
Spare part for options C11 to C12	With sealing cap C11	3WL9111-0AJ02-0AA0	
	With CES assembly kit C12	3WL9111-0AJ03-0AA0	
	With IKON assembly kit	3WL9111-0AJ05-0AA0	
<b>Motor shutdown switch (S12)</b>			
	<ul style="list-style-type: none"> <li>Mounting onto operator panel</li> <li>Not possible with electrical ON button</li> </ul>		
	<b>Version</b>	<b>Article No.</b>	
Spare part for option S25		3WL9111-0AJ06-0AA0	

# Accessories and spare parts

## Indicators and control elements

### EMERGENCY-OFF pushbuttons



- Mushroom pushbutton instead of the mechanical OFF pushbutton

#### Variant


Spare part for option S24

#### Article No.

3WL9111-0BA72-0AA0

## Auxiliary conductor connections

### Male connectors for circuit breakers 1



#### Article No.

3WL9111-0AB01-0AA0

### Extension for male connector

- Male connector must be ordered separately

#### Version

1000 V

#### Article No.

3WL9111-0AB02-0AA0

### Male connectors and extension

#### Version

1000 V

#### Article No.

3WL9111-0AB10-0AA0


### Auxiliary supply connection for circuit breakers or guide frames 2

#### Version

Screw connection (SIGUT)


#### Article No.

3WL9111-0AB03-0AA0



Screwless connection (tension spring)

3WL9111-0AB04-0AA0



### Coding kits 3

#### Version

For fixed-mounted X5 to X8

#### Article No.


3WL9111-0AB07-0AA0



### Sliding contact modules for guide frames 4

#### Article No.

3WL9111-0AB08-0AA0




### One-part sliding contact modules for guide frames 5

#### Version

Screw connection (SIGUT)

#### Article No.

3WL9111-0AB18-0AA0



### Blanking blocks for circuit breakers

#### Article No.

3WL9111-0AB12-0AA0


For a complete auxiliary current connection you must order:

Fixed-mounted version: 1 + 2 + 3

Withdrawable version: 1 + 4 + 2 or 1 + 5

## Auxiliary releases

### Closing coils / shunt trips



Version	Voltage	Article No.
100% OP	24 V DC	3WL9111-0AD01-0AA0
	30 V DC	3WL9111-0AD02-0AA0
	48 V DC	3WL9111-0AD03-0AA0
	60 V DC	3WL9111-0AD04-0AA0
	110 ... 125 V DC/110 ... 127 V AC	3WL9111-0AD05-0AA0
	220 ... 250 V DC/208 ... 240 V AC	3WL9111-0AD06-0AA0
5% OP Switching time 50 ms (standard >80 ms).	24 V DC	3WL9111-0AD11-0AA0
	48 V DC	3WL9111-0AD12-0AA0
	110 ... 125 V DC/110 ... 127 V AC	3WL9111-0AD13-0AA0
	220 ... 250 V DC/208 ... 240 V AC	3WL9111-0AD14-0AA0

### Undervoltage release




Version	Voltage	Article No.
Instantaneous	24 V DC	3WL9111-0AE01-0AA0
	30 V DC	3WL9111-0AE02-0AA0
	48 V DC	3WL9111-0AE03-0AA0
	60 V DC	3WL9111-0AE07-0AA0
	110 ... 125 V DC/110 ... 127 V AC	3WL9111-0AE04-0AA0
	220 ... 250 V DC/208 ... 240 V AC	3WL9111-0AE05-0AA0



Delayed	48 V DC	3WL9111-0AE11-0AA0
	110 ... 125 V DC/110 ... 127 V AC	3WL9111-0AE12-0AA0
	220 ... 250 V DC/208 ... 240 V AC	3WL9111-0AE13-0AA0

## Operating mechanism

### Motorized operating mechanisms




- Auxiliary supply connection X5 required for circuit breakers or guide frames.  
If this is not already available, please order additionally

Voltage	Article No.
24 ... 30 V DC	3WL9111-0AF01-0AA0
48 ... 60 V DC	3WL9111-0AF02-0AA0
110 ... 125 V DC/110 ... 127 V AC	3WL9111-0AF03-0AA0
220 ... 250 V DC/208 ... 240 V AC	3WL9111-0AF04-0AA0

## Auxiliary contacts

### Auxiliary switch blocks



Contacts	Article No.
2 NO contacts + 2 NC contacts	3WL9111-0AG01-0AA0
2 NO contacts	3WL9111-0AG02-0AA0
1 NO contact + 1 NC contact	3WL9111-0AG03-0AA0

## Door sealing frames, hoods, shutters

### Door sealing frames



Version	Article No.
Spare part for option T40	3WL9111-0AP01-0AA0

# Accessories and spare parts

## Door sealing frames, hoods, shutters

### Protective covers IP55



- Cannot be used in conjunction with door sealing frames
- Hood removable and can be opened on both sides

#### Article No.


3WL9111-0AP03-0AA0

### Shutters

Version	Number of poles	Size	Breaking capacity	Article No.
Spare part for option R21	3-pole	1	N, S, H	3WL9111-0AP04-0AA0
		2	N, S, H	3WL9111-0AP06-0AA0
		3	H, C	3WL9111-0AP07-0AA0
	4-pole	1	N, S, H	3WL9111-0AP08-0AA0
		2	N, S, H	3WL9111-0AP11-0AA0
		3	H, C	3WL9111-0AP12-0AA0

## Coding for withdrawable version

### Coding for withdrawable version



- By customer, for 36 coding variants

#### Size

1 and 2

3

#### Article No.

3WL9111-0AR12-0AA0

3WL9111-0AR13-0AA0

## Support brackets

### Support brackets



- For mounting fixed-mounted circuit breakers on vertical plane
- Only for sizes 1 and 2 (1 set = 2 units)


#### Article No.

3WL9111-0BB50-0AA0

## CubicleBUS modules

- Each CubicleBUS module is supplied with a 0.2 m pre-assembled cable to connect the modules with each other. A longer pre-assembled cable is required for connection to the circuit breaker.
- All communication components, **CubicleBUS** modules and metering functions are available for the electronic trip units ETU45B.

### Modules of the CubicleBUS



Type	Article No.
Digital output modules with rotary coding switch, relay outputs	3WL9111-1AT26-0AA0
Digital output modules, configurable, relay outputs	3WL9111-1AT20-0AA0
Digital input module	3WL9111-1AT27-0AA0
Analog output module	3WL9111-1AT23-0AA0
ZSI module	3WL9111-1AT21-0AA0

### Preassembled cables for CubicleBUS modules

For connection to 3WL	Length	Article No.
With COM15/COM16/COM35	0.2 m	3WL9111-0BC04-0AA0
	1 m	3WL9111-0BC02-0AA0
	2 m	3WL9111-0BC03-0AA0
Without COM15/COM16/COM35	2 m	3WL9111-0BC05-0AA0

### Voltage transformers

- Required for 3WL circuit breakers with metering function Plus
- 380 ... 690 V/100 V, class 0.5

Number of poles	Metering function	Article No.
3-pole	With metering function Plus	3WL9111-0BB68-0AA0






## Retrofitting and spare parts

- All communication components, **CubicleBUS** modules and metering functions are available for the electronic trip units ETU45B.

COM35 PROFINET IO / Modbus TCP modules		
	<b>Version</b>	<b>Article No.</b>
	For electronic trip units ETU45B	3WL9111-1AT66-0AA0
COM15 PROFIBUS module		
	<b>Version</b>	<b>Article No.</b>
	For electronic trip units ETU45B	3WL9111-1AT65-0AA0
COM16 Modbus module		
	<b>Version</b>	<b>Article No.</b>
	For electronic trip units ETU45B	3WL9111-1AT15-0AA0
Breaker status sensor (BSS)		
	<b>Version</b>	<b>Article No.</b>
	For electronic trip units ETU45B	3WL9111-1AT16-0AA0
Metering function Plus		
<ul style="list-style-type: none"> <li>A measuring accuracy of 3% is achieved if retrofitted.</li> </ul>		
	<b>Version</b>	<b>Article No.</b>
	Voltage transformer required	3WL9111-1AT03-0AA0


## Main conductor connections, fixed-mounted versions (essential accessory)

Front-accessible main connections, single hole at top				
	<b>Size</b>	<b>Rated current <math>I_n</math></b>	<b>Article No.</b>	
	1	≤1000 A 1250 ... 1600 A	3WL9111-0AL01-0AA0 3WL9111-0AL02-0AA0	
	2	≤2000 A ≤2500 A ≤3200 A	3WL9111-0AL03-0AA0 3WL9111-0AL04-0AA0 3WL9111-0AL05-0AA0	
	3	≤4000 A	3WL9111-0AL06-0AA0	
	Front-accessible main connections, single hole at bottom			
		<b>Size</b>	<b>Rated current <math>I_n</math></b>	<b>Article No.</b>
		1	≤1000 A 1250 ... 1600 A	3WL9111-0AL51-0AA0 3WL9111-0AL52-0AA0
2		≤2000 A ≤2500 A ≤3200 A	3WL9111-0AL53-0AA0 3WL9111-0AL54-0AA0 3WL9111-0AL55-0AA0	
3		≤4000 A	3WL9111-0AL56-0AA0	
Front-accessible main connections according to DIN 43673, double hole at top				
		<b>Size</b>	<b>Rated current <math>I_n</math></b>	<b>Article No.</b>
		1	≤1000 A 1250 ... 1600 A	3WL9111-0AL07-0AA0 3WL9111-0AL08-0AA0
	2	≤2000 A ≤2500 A ≤3200 A	3WL9111-0AL11-0AA0 3WL9111-0AL12-0AA0 3WL9111-0AL13-0AA0	
	3	≤4000 A	3WL9111-0AL14-0AA0	

# Accessories and spare parts


## Main conductor connections, fixed-mounted versions (essential accessory)

### Front-accessible main connections according to DIN 43673, double hole at bottom



Size	Rated current $I_n$	Article No.
1	$\leq 1000$ A <sup>1)</sup>	3WL9111-0AL57-0AA0
	1250 ... 1600 A	3WL9111-0AL58-0AA0
2	$\leq 2000$ A	3WL9111-0AL61-0AA0
	$\leq 2500$ A	3WL9111-0AL62-0AA0
	$\leq 3200$ A	3WL9111-0AL63-0AA0
3	$\leq 4000$ A	3WL9111-0AL64-0AA0

### Rear vertical main connections




Size	Rated current $I_n$	Article No.
1 <sup>1)</sup>	$\leq 1600$ A	3WL9111-0AM01-0AA0
2 <sup>2)</sup>	$\leq 3200$ A	3WL9111-0AM02-0AA0
3	$\leq 6300$ A	3WL9111-0AM03-0AA0

<sup>1)</sup> In the case of vertical connection size 1 with breaking capacity N and S, up to 1000 A one 3WL9 111-0AM01-0AA0 vertical connection is required, up to 1600 A or with breaking capacity H two 3WL9 111-0AM01-0AA0 vertical connections are required.

<sup>2)</sup> In the case of vertical connection size 2, up to 2500 A one 3WL9 111-0AM02-0AA0 vertical connection is required, up to 3200 A two 3WL9 111-0AM02-0AA0 vertical connections are required.


## Main conductor connections, withdrawable versions (essential accessory)

### Front-accessible main connections, single hole at top or at bottom <sup>1)</sup>




Size	Rated current $I_n$	Article No.
1	$\leq 1000$ A	3WL9111-0AN01-0AA0
	1250 ... 1600 A	3WL9111-0AN02-0AA0
2	$\leq 2000$ A	3WL9111-0AN03-0AA0
	$\leq 2500$ A	3WL9111-0AN04-0AA0
	$\leq 3200$ A	3WL9111-0AN05-0AA0
3	$\leq 4000$ A	3WL9111-0AN06-0AA0

### Front-accessible main connections, according to DIN 43673, double hole at top or at bottom <sup>1)</sup>



Size	Rated current $I_n$	Article No.
1	$\leq 1000$ A	3WL9111-0AN07-0AA0
	1250 ... 1600 A	3WL9111-0AN08-0AA0
2	$\leq 2000$ A	3WL9111-0AN11-0AA0
	$\leq 2500$ A	3WL9111-0AN12-0AA0
	$\leq 3200$ A	3WL9111-0AN13-0AA0
3	$\leq 4000$ A	3WL9111-0AN14-0AA0

### Supports for front and DIN connecting bars



Number of poles	Size	Article No.
3-pole for 3 bars	1	3WL9111-0AN41-0AA0
	2	3WL9111-0AN42-0AA0
	3	3WL9111-0AN43-0AA0
4-pole for 4 bars	1	3WL9111-0AN44-0AA0
	2	3WL9111-0AN45-0AA0
	3	3WL9111-0AN46-0AA0

<sup>1)</sup> When using front-accessible main connections (withdrawable circuit breakers) supports are required





## One system. For all applications

Requirements for cost- and energy-efficient operation of electrical power distribution are on the increase. Whether in industrial plants, in infrastructure or in buildings: As a modular, highly adaptable system, the 3VA series of molded case circuit breakers ensures fully reliable protection of personnel and plant, and supports every process phase – from planning to operation of electrical power distribution.

Comprehensively certified. Deployable worldwide.

3VA molded case circuit breakers are available in various ranges with IEC approval; other ranges are available that comply with standard IEC 60947 and standard UL 489. The system is therefore ideally suited for mechanical engineering companies and switchgear manufacturers. The full range of functionalities of molded case circuit breakers can be used for plant and equipment operating in Europe and North America, with absolute standards compliance assured.

# Molded Case Circuit Breakers



All the information you need	2/2
Molded case circuit breakers for all applications	2/4
Quick selection guide	2/6
Switching devices and accessories	2/6
3VA5 switching devices up to 800 A	2/8
3VA6 switching devices up to 1000 A	2/12
Trip units	2/16
Online configurator highlights	2/18
3VA51 – 3VA66	2/20
System overview	2/20
Structure of the article numbers	2/22
Internal accessories	2/26
Manual operators	2/28
Motor operators	2/34
Connection technology	2/36
Plug-in and draw-out technology	2/56
Communication	2/59
Locking, blocking and interlocking	2/64
Cover frame and mounting	2/66
3VL	2/68
3VL up to 1600 A, according to UL 489	2/68

# A multitude of additional information ...

## Information + ordering

### All the important things at a glance

For information about molded case circuit breakers, please visit our website [www.siemens.com/3VA](http://www.siemens.com/3VA)

### Your product in detail

The Siemens Industry Online Support (SIOS) provides detailed technical information

[www.siemens.com/lowvoltage/product-support](http://www.siemens.com/lowvoltage/product-support)

- Technical basic information – 3VA molded case circuit breakers ([109766672](https://www.siemens.com/lowvoltage/product-support/109766672))

The relevant tender specifications can be found at [www.siemens.com/lowvoltage/tenderspecifications](http://www.siemens.com/lowvoltage/tenderspecifications)

Use our conversion tool for quick and easy conversion to Siemens products

[www.siemens.com/conversion-tool](http://www.siemens.com/conversion-tool)

### Siemens YouTube channel

- 3VA molded case circuit breakers (general) [bit.ly/2xNxIFA](https://bit.ly/2xNxIFA)

### Everything you need for your order

Refer to the Industry Mall for an overview of your products

- 3VA molded case circuit breakers, UL / IEC [sie.ag/2yPsA2e](https://sie.ag/2yPsA2e)

Direct forwarding to the individual products in the Industry Mall by clicking on the Article No. in the catalog or by entering this web address incl. Article No. [www.siemens.com/product?Article No.](http://www.siemens.com/product?Article No.)

### Configurators

The configurator reduces the time and effort required in the planning and ordering process, and allows for individual adaptations. Configure your 3VA molded case circuit breaker at

[www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

For your configured 3VA molded case circuit breaker, you can additionally find

- 3D views
- CAD data
- Unit wiring diagrams
- Dimension drawings

## The fast track to the experts

### Contact persons in your region

We offer a comprehensive portfolio of services. You can find your local contacts at

[www.siemens.com/lowvoltage/components/contact](http://www.siemens.com/lowvoltage/components/contact)

You can find further information on services at [www.siemens.com/service-catalog](http://www.siemens.com/service-catalog)

Competent expert advice on technical questions with a wide range of demand-optimized services for all our products and systems.

Assistance with technical queries is provided at [www.siemens.com/lowvoltage/support-request](http://www.siemens.com/lowvoltage/support-request)

# ... can be found in our online services

## Commissioning + operation

### SENTRON powerconfig

The combined commissioning and service tool for communication-capable measuring devices and circuit breakers from the SENTRON portfolio.

[www.siemens.com/powerconfig](http://www.siemens.com/powerconfig)

Free download SENTRON powerconfig mobile via:  
[App Store](#) and [Play Store](#)

### Your product in detail

The Siemens Industry Online Support (SIOS) provides detailed technical information

[www.siemens.com/lowvoltage/product-support](http://www.siemens.com/lowvoltage/product-support)

- Operating instructions
- Characteristic curves
- Certificates

Comprehensive mobile support via the Siemens Industry Online Support app available for download from the [App Store](#) and [Play Store](#)

You will find further information under:

[www.siemens.com/support-app](http://www.siemens.com/support-app)

Provision of 3D data (step and u3d data formats)

- Siemens Industry Mall  
[www.siemens.com/lowvoltage/mall](http://www.siemens.com/lowvoltage/mall)
- Image database  
[www.siemens.com/lowvoltage/picturedb](http://www.siemens.com/lowvoltage/picturedb)

Engineering data for CAD or CAE systems are available in the CAX Download Manager at

[www.siemens.com/lowvoltage/cax](http://www.siemens.com/lowvoltage/cax)

### Manuals

Manuals are available for downloading in Siemens Industry Online Support (SIOS) at

[www.siemens.com/lowvoltage/manuals](http://www.siemens.com/lowvoltage/manuals)

- Configuration manual – 3VA selectivity (**109743975**)
- Communication manual – 3VA molded case circuit breakers with IEC and UL certification (**98746267**)
- Equipment manual – 3VA molded case circuit breakers with UL and IEC certification (**109758561**)

### Classroom or online training

Our training courses can be found at

[www.siemens.com/sitrain-lowvoltage](http://www.siemens.com/sitrain-lowvoltage)

- Protection systems in low-voltage power distribution (WT-LVAPS)
- 3VA molded case circuit breakers (WT-LVA3VA)
- Communication with SENTRON components (LV-COM)
- Project planning and selection of SENTRON circuit breakers (LV-CBPROJ)

## Technical overview – Molded case circuit breakers




### The fast way to get you to our online services

This page provides you with comprehensive information and links on molded case circuit breakers

[www.siemens.com/lowvoltage/product-support](http://www.siemens.com/lowvoltage/product-support) (**109767421**)

# Molded case circuit breakers for all applications

2

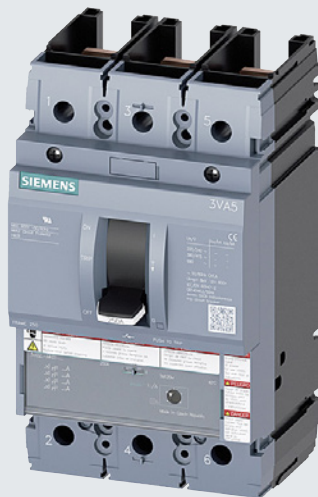

3VA51 ... 3VA55  
molded case circuit breakers

## *Ideal for standard applications*

The 3VA5 molded case circuit breaker is suitable for numerous applications in infrastructure and industrial plants - and this applies worldwide thanks to IEC and UL certification.

Its additional functionality is the perfect complement to the circuit breaker series - and it features a consistent design and wide range of accessories.

### Special features

- Compact design
- AC/DC applications
- Universal platform of accessories
- 1-, 2-, 2 in 3-, 3- and 4-pole version
- Also available as a molded case switch and motor circuit protector

### UL certificate

- 3VA5/6 molded case circuit breaker for line protection E364397 (CCN <sup>1)</sup>: DIVQ)
- 3VA5/6 motor circuit protector: E482699 (CCN: DKPUZ)
- 3VA5/6 molded case switch: E482701 (CCN: WJAZ)
- Accessories: E354102

<sup>1)</sup> CCN= UL Category Code Number





3VA61 ... 3VA66  
molded case circuit breakers

## Perfect for advanced applications

Whether in industry or infrastructure - the 3VA6 molded case circuit breaker can handle all tasks with ease. It can be easily integrated into higher-level energy management or automation systems.

It reliably signals plant conditions and measured values, helping you to increase plant availability and identify any potential for savings.

### Special features

- Very good selective protection response
- AC applications
- Integrated metering function for current, voltage and energy values
- Connection to a communication system
- Various circuit breaker versions available as "100% rated" (uninterrupted current carrying) and as „current limiting“ breaker according to UL 489

### UL certificate

- 3VA5/6 molded case circuit breaker for line protection E364397 (CCN <sup>1)</sup>: DIVQ)
- 3VA5/6 motor circuit protector: E482699 (CCN: DKPUZ)
- 3VA5/6 molded case switch: E482701 (CCN: WJAZ)
- Accessories: E354102

<sup>1)</sup> CCN= UL Category Code Number

# Switching devices and accessories

2



## Protective functions

Size	3VA51	3VA52	3VA53	3VA54	3VA55
Molded case switch (MCS)					
with short-circuit release for intrinsic device protection	■	■	■	■	■
<b>Thermal-magnetic</b>					
Line protection	■	■	■	■	■
Protective circuit breaker for motor starter combinations, motor circuit protector (MCP)	■	■	■	■	■
<b>Electronic</b>					
Line protection	–	–	–	–	–
Line protection, with display	–	–	–	–	–
Line protection, with display and metering function	–	–	–	–	–
Protective circuit breaker for motor starter combinations, motor circuit protector (MCP)	–	–	–	–	–

## Accessories

Size	125 A	250 A	400 A	600 A	800 A
<b>Accessories</b>					
Auxiliary switches and signaling switches	■	■	■	■	■
Auxiliary releases	■	■	■	■	■
Connection technology	■	■	■	■	■
Plug-in version	–	–	–	–	–
Draw-out version	–	–	–	–	–
Front rotary operator	■	■	■	■	■
Door mounted rotary operator	■	■	■	■	■
Side wall mounted rotary operator	■	■	–	–	–
Operating unit with Bowden cable/linkage	■	■	■	■	–
Motor operator MO 320 (mounted on front)	■	■	■	■	–
Motor operator with SEO520 stored energy operator	–	■	–	–	–
Locking, blocking and interlocking	■	■	■	■	■
Communications interface	–	–	–	–	–
EFB300	–	–	–	–	–
MMB300	–	–	–	–	–
Testing and commissioning devices	–	–	–	–	–
Cover frame	■	■	■	■	■

■ Available – Not available/not present




# 3VA5 switching devices up to 800 A

## Technical data

2



			3VA51			3VA51		
<b>Basic data</b>								
Number of poles			1-pole			2-pole		
Size	A		125			125		
Rated current $I_n$	A		15 ... 125			15 ... 125		
Frequency	Hz		0 ... 400			0 ... 400		
<b>Electrical characteristics according to UL 489</b>								
Rated operational voltage $U_e$ 50/60 Hz AC	V		347			600 Y/347 and 480		
<b>Electrical characteristics according to IEC 60947-2</b>								
Rated operational voltage $U_e$ 50/60 Hz AC	V		415			415		
Rated insulation voltage $U_i$	V		500			600		
Rated impulse withstand voltage $U_{imp}$	kV		8			8		
<b>Breaking capacity (line protection)</b>								
			<b>S</b>	<b>M</b>	<b>H</b>	<b>S</b>	<b>M</b>	<b>H</b>
UL breaker type			SEAS	MEAS	HEAS	SEAS	MEAS	HEAS
<b>Short-circuit breaking capacity acc. to UL 489</b>								
50/60 Hz AC								
120 V	kA		65	85	100	–	–	–
240 V	kA		–	–	–	65	85	150
277 V	kA		25	35	50	–	–	–
347 V	kA		14	18	18	–	–	–
480 Y/277 V	kA		–	–	–	25	35	65
480 V	kA		–	–	–	25	35	65
600 Y/347 V	kA		–	–	–	14	18	25
600 V	kA		–	–	–	–	–	–
DC								
125 V	kA		14	25	30	14	25	30
250 V	kA		–	–	–	50	85	100
500 V	kA		–	–	–	–	–	–
600 V	kA		–	–	–	–	–	–
750 V	kA		–	–	–	–	–	–
1000 V	kA		–	–	–	–	–	–
<b>Short-circuit breaking capacity acc. to IEC 60947-2</b>								
Rated ultimate short-circuit breaking capacity $I_{cu}$ 50/60 Hz AC <sup>1)</sup>								
240 V	kA		25	36	55	55	85	150
415 V	kA		5	5	5	36	55	70
690 V	kA		–	–	–	–	–	–
Rated operational short-circuit breaking capacity $I_{cs}$ 50/60 Hz AC <sup>1)</sup>								
240 V	kA		25	36	55	55	85	150
415 V	kA		5	5	5	36	55	70
690 V	kA		–	–	–	–	–	–
DC								
125 V	kA		14	25	30	14	25	30
250 V	kA		–	–	–	50	85	100
500 V	kA		–	–	–	–	–	–
600 V	kA		–	–	–	–	–	–
750 V	kA		–	–	–	–	–	–
1000 V	kA		–	–	–	–	–	–
<b>Dimensions</b>								
A		mm	25.4			50.8		
B		mm	140			140		
C		mm	76.5			76.5		
D		mm	93.4			93.4		



■ Available – Not available/not present

\* On request

<sup>1)</sup>  $I_{cu}$  = rated ultimate short-circuit breaking capacity, rms value, according to IEC 60947-2.  $I_{cs}$  = rated operational short-circuit breaking capacity, rms value, according to IEC 60947-2.



3VA51			3VA52			3VA53			3VA54			3VA55		
3/4-pole			2- in 3-pole, 3/4-pole			2- in 3-pole, 3/4-pole			2- in 3-pole, 3/4-pole			2- in 3-pole, 3/4-pole		
125			250			400			600			800		
15 ... 125			40 ... 250			200 ... 400			450, 500, 600			600, 700, 800		
0 ... 400			0 ... 400			0 ... 400			0 ... 400			0 ... 400		
600 Y/347 and 480			600			600			600			600		
690			690			690			690			690		
800			800			800			800			800		
8			8			8			8			8		
S	M	H	M	H	C	M	H	C	M	H	C	M	H	C
SEAS	MEAS	HEAS	MFAS	HFAS	CFAS	MJAS	HJAS	CJAS	MLAS	HLAS	CLAS	MMAS	HMAS	CMAS
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
65	85	150	85	100	200	85	100	200	85	100	200	85	100	200
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
25	35	65	35	65	100	35	65	100	35	65	100	35	65	100
25	35	65	35	65	100	35	65	100	35	65	100	35	65	100
14	18	25	18	25	35	20	25	35	20	25	35	18	25	50
-	-	-	18	25	35	20	25	35	20	25	35	18	25	50
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
50	85	100	50	85	100	50	85	100	50	85	100	50	85	100
50	85	100	50	85	100	50	85	100	50	85	100	50	85	100
50	85	100	50	85	100	50	85	100	50	85	100	50	85	100
-	-	-	50	85	100	50	85	100	50	85	100	50	85	100
-	-	-	50	85	100	6	6	10	6	6	10	18	25	50
55	85	150	85	100	200	85	100	200	85	100	200	85	100	200
36	55	70	55	70	110 (3P) 85 (4P)	55	70	110	55	70	110	55	70	110
5	7	10	7	10	10	7	10	10	7	10	10	25	35	35
55	85	150	85	100	200	85	100	200	85	100	200	85	100	150
36	55	70	55	70	110 (3P) 85 (4P)	55	70	110	55	70	110	55	70	85
5	5	5	7	10	10	5	6	6	6	6	6	19	19	19
-	-	-	-	-	-	8	16	25	8	16	25	50	85	100
50	85	100	50	85	100	8	16	25	8	16	25	50	85	100
50	85	100	50	85	100	8	16	25	8	16	25	50	85	100
50	85	100	50	85	100	8	16	25	8	16	25	50	85	100
-	-	-	50	85	100	-	-	-	-	-	-	50	85	100
-	-	-	25	36	50	-	-	-	-	-	-	25	35	50
76.2				105			138			138			201	
140				185			210			210			328	
76.5				83			110			110			120	
93.4				107			137			137			253	

# 3VA5 switching devices up to 800 A

## Application

2



		3VA51	3VA51
<b>Basic data</b>			
Number of poles		1-pole	2-pole
Size	A	125	125
Rated current $I_n$	A	15 ... 125	15 ... 125
Frequency	Hz	0 ... 400	0 ... 400
<b>3VA5 molded case circuit breakers for line protection</b>			
<b>Service life/endurance (operating cycles)</b>			
Mechanical (NO contact – NC contact)		20000	20000
Electrical for $U_e$ 480 V (UL 489) / 415 V (IEC 60947)		8000	8000
<b>Trip units</b>			
FTFM	TM210	■	■
FTAM	TM230	–	–
ATAM	TM240	–	–
<b>3VA5 motor circuit protector (protective circuit breaker for motor starter combinations)</b>			
Rated current $I_n$	A	–	–
Breaking capacity acc. to UL 489 without contactor at 480 V <sup>1)</sup>	kA	–	–
Approval acc. to IEC 60947-2 Annex O ICB		–	–
<b>Integrated, instantaneous short-circuit release for intrinsic device protection</b>			
AM	TM120M	–	–
<b>3VA5 molded case switch</b>			
<b>Electrical characteristics according to UL 489</b>			
Rated uninterrupted current $I_n$ at 40 °C ambient temperature for short-circuit current rating (SCCR) <sup>2)</sup>	Up to 65 kA at 480 V	A	–
	Up to 100 kA at 480 V	A	100
Approval acc. to IEC 60947-2 Annex L CBI-X		–	■
<b>Integrated, instantaneous short-circuit release for intrinsic device protection</b>			
FM	MCS110	–	■
<b>Standards and specifications</b>			
Standards and specifications		UL 489/CSA C22.2 No. 5, IEC 60947-2	UL 489/CSA C22.2 No. 5, IEC 60947-2
Direction of power flow and infeed		Top and bottom	Top and bottom
Standard connection technology		Without connection technology	Without connection technology

■ Available – Not available/not present \* On request

<sup>1)</sup> Breaking capacity in combinations with contactor (SCCR rating) may differ

<sup>2)</sup> The breaking capacity (SCCR rating) is the maximum short-circuit current permissible at the location where the MCS is installed in conjunction with a suitable overload protection device

**3VA51****3VA52****3VA53****3VA54****3VA55**

2

3VA51	3VA52	3VA53	3VA54	3VA55
3/4-pole	2- in 3-pole, 3/4-pole	2- in 3-pole, 3/4-pole	2- in 3-pole, 3/4-pole	2- in 3-pole, 3/4-pole
125	250	400	600	800
15 ... 125	40 ... 250	200 ... 400	450, 500, 600	600, 700, 800
0 ... 400	0 ... 400	0 ... 400	0 ... 400	0 ... 400
20000	20000	20000	20000	10000
8000	8000	6000	3000	4800
■	■	–	–	–
■	■	■	■	■
■	■	■	■	–
15 ... 125	150 ... 200	250	400, 500, 600	600, 800
65	65/100	65/100	65/100	65/100
■	■	■	■	■
■	■	■	■	■
100	150, 250	400	600	800
–	100, 150, 250	400	600	800
■	■	■	■	■
■	■	■	■	■
UL 489/CSA C22.2 No. 5, IEC 60947-2	UL 489/CSA C22.2 No. 5, IEC 60947-2	UL 489/CSA C22.2 No. 5, IEC 60947-2	UL 489/CSA C22.2 No. 5, IEC 60947-2	UL 489/CSA C22.2 No. 5, IEC 60947-2
Top and bottom	Top and bottom	Top and bottom	Top and bottom	Top and bottom
Without connection technology	Without connection technology	Without connection technology	Without connection technology	Nut keeper kit

# 3VA6 switching devices up to 1000 A

## Technical data

2


**3VA61**

Basic data							
Number of poles		3/4-pole					
Size	A	150					
Rated current $I_n$	A	40 ... 150					
Frequency	Hz	50 ... 60					
Electrical characteristics according to UL 489							
Rated operational voltage $U_e$ 50/60 Hz AC	V	600					
Electrical characteristics according to IEC 60947-2							
Rated operational voltage $U_e$ 50/60 Hz AC	V	690					
Rated insulation voltage $U_i$	V	800					
Rated impulse withstand voltage $U_{imp}$	kV	8					
Breaking capacity (line protection)		M	H	C	L	E	
UL breaker type		MDAE	HDAE	CDAE	LDAE	EDAE	
Current limiting according to UL 489		–	–	–	–	■	
Short-circuit breaking capacity acc. to UL 489							
50/60 Hz AC	120 V	kA	–	–	–	–	
	240 V	kA	100	100	200	200	
	277 V	kA	–	–	–	–	
	347 V	kA	–	–	–	–	
	480 Y/277 V	kA	35	65	100	150	200
	480 V	kA	35	65	100	150	200
	600 Y/347 V	kA	18	22	35	50	100
600 V	kA	18	22	35	50	100	
Short-circuit breaking capacity acc. to IEC 60947-2							
Rated ultimate short-circuit breaking capacity $I_{cu}$ 50/60 Hz AC <sup>1)</sup>	240 V	kA	85	110	150	200	–
	415 V	kA	55	85	110	150	200
	690 V	kA	2.5	2.5	2.5	2.5	3
Rated operational short-circuit breaking capacity $I_{cs}$ 50/60 Hz AC <sup>1)</sup>	240 V	kA	85	110	150	200	–
	415 V	kA	55	85	110	150	150
	690 V	kA	2.5	2.5	2.5	2.5	3
Dimensions							
	A	mm	105 (3P)   140 (4P)				
	B	mm	198				
	C	mm	86				
	D	mm	107				

■ Available – Not available/not present

\* On request

<sup>1)</sup>  $I_{cu}$  = rated ultimate short-circuit breaking capacity, rms value, according to IEC 60947-2.

 $I_{cs}$  = rated operational short-circuit breaking capacity, rms value, according to IEC 60947-2.



**3VA62****3VA63****3VA64****3VA65****3VA66**

3/4-pole

3/4-pole

3/4-pole

3/4-pole

3/4-pole

250

400

600

800

1000

100, 250

250 A, 400

400, 600

600, 800

1000

50 ... 60

50 ... 60

50 ... 60

50 ... 60

50 ... 60

600

600

600

600

600

690

690

690

690

690

800

800

800

800

800

8

8

8

8

8

M	H	C	L	E	M	H	C	L	E	M	H	C	L	E	M	H	C	M	H	C
MFAE	HFAE	CFAE	LFAE	EFAE	MJAE	HJAE	CJAE	LJAE	EJAE	MLAE	HLAE	CLAE	LLAE	ELAE	MMAE	HMAE	CMAE	MMNAE	HMNAE	CMNAE
-	-	-	-	■	-	-	-	-	■	-	-	-	-	■	-	-	-	-	-	-

-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
100	100	200	200	-	100	100	200	200	-	100	100	200	200	-	100	150	200	100	150	200
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
35	65	100	150	200	35	65	100	150	200	35	65	100	150	200	35	65	100	35	65	100
35	65	100	150	200	35	65	100	150	200	35	65	100	150	200	35	65	100	35	65	100
18	22	35	50	100	18	22	35	50	100	18	22	35	50	100	25	35	50	25	35	50
18	22	35	50	100	18	22	35	50	100	18	22	35	50	100	25	35	50	25	35	50

85	110	150	200	-	85	110	150	200	-	85	110	150	200	-	85	110	200	85	110	200
55	85	110	150	200	55	85	110	150	200	55	85	110	150	200	55	85	110	55	85	110
3	3	3	3	3	5	5	5	5	6	6	6	6	6	6	25	35	35	25	35	35
85	110	150	200	-	85	110	150	200	-	85	110	150	200	-	85	110	150	85	110	150
55	85	110	150	150	55	85	110	110	110	55	85	110	110	110	55	85	85	55	85	85
3	3	3	3	3	5	5	5	5	6	6	6	6	6	6	19	19	19	19	19	19

105 (3P) | 140 (4P)

138 (3P) | 184 (4P)

138 (3P) | 184 (4P)

210

210

198

248

248

328

328

86

110

110

120

120

107

137

137

253

253

# 3VA6 switching devices up to 1000 A

## Application

2


**3VA61**

Basic data		
Number of poles		3/4-pole
Size	A	150
Rated current $I_n$	A	40 ... 150
Frequency	Hz	50 ... 60
3VA6 molded case circuit breakers for line protection		
Service life/endurance (operating cycles)		
Mechanical (NO contact – NC contact)		25000
Electrical for $U_e$ 480 V (UL 489) / 415 V (IEC 60947)		14000
Trip units		
LI	ETU320/ETU820	■
LIG	ETU330/ETU830	■
LSI	ETU350	■
LSI	ETU550/ETU850	■
LSI (G alarm, no integrated G protection)	ETU556/ETU856	■
LSIG	ETU560/ETU860	■
Motor circuit protector (protective circuit breaker for motor starter combinations) 3VA6		
Rated current $I_n$	A	25 ... 100
Breaking capacity acc. to UL 489 without contactor at 480 V <sup>1)</sup>	kA	100
Approval acc. to IEC 60947-2 Annex O ICB		■
Integrated, instantaneous short-circuit release for intrinsic device protection		
I	ETU310M	■
Standards and specifications		
Standards and specifications		UL 489/CSA C22.2 No. 5/ IEC 60947-2
Direction of power flow and infeed		Top and bottom
Standard connection technology		Without connection technology

■ Available – Not available/not present \* On request

<sup>1)</sup> Breaking capacity in combinations with contactor (SCCR rating) may differ

<sup>2)</sup> The breaking capacity (SCCR rating) is the maximum short-circuit current permissible at the location where the MCS is installed in conjunction with a suitable overload protection device



2

**3VA62****3VA63****3VA64****3VA65****3VA66**

3/4-pole  
250  
100, 250  
50 ... 60

3/4-pole  
400  
250, 400  
50 ... 60

3/4-pole  
250  
600  
50 ... 60

3/4-pole  
800  
600, 800  
50 ... 60

3/4-pole  
1000  
1000  
50 ... 60

25000  
12000

20000  
6000

20000  
4000

10000  
5100

10000  
4900

■  
■  
■  
■  
■  
■

■  
■  
■  
■  
■  
■

■  
■  
■  
■  
■  
■

■  
■  
■  
■  
■  
■

■  
■  
■  
■  
■  
■

110 ... 200  
100

200, 250  
100

400, 500  
100

800  
100

–  
–

■  
■

■  
■

■  
■

■  
■

–  
–

UL 489/CSA C22.2 No. 5/  
IEC 60947-2

UL 489/CSA C22.2 No. 5/  
IEC 60947-2

UL 489/CSA C22.2 No. 5/  
IEC 60947-2

UL 489/CSA C22.2 No. 5/  
IEC 60947-2

UL 489/CSA C22.2 No. 5/  
IEC 60947-2

Top and bottom

Top and bottom

Top and bottom

Top and bottom

Top and bottom

Without connection technology

Without connection technology

Without connection technology

Nut keeper kit

Nut keeper kit

# Trip units

Protection system for 3VA molded case circuit breakers up to 600 A

Trip units	Thermal-magnetic	Electronic	Electronic with display	Electronic with display and metering function
	 TM240 I/A I/A I201_19035	 ETU350 LSI I/A t/s I <sub>∞</sub> I t <sub>∞</sub> /s I <sub>∞</sub> I I201_18828	 ETU550M LSI ACT COM AL1 AL2 ESC OK I201_19701	 ETU860M LSI ACT COM AL1 AL2 ESC OK I201_18484
	<b>TM 2-series</b>	<b>ETU 3-series</b>	<b>ETU 5-series</b>	<b>ETU 8-series</b>
<b>Protection function</b>				
Line protection	TM210, TM230, TM240	ETU320, ETU330, ETU350	ETU550, ETU556, ETU560	ETU820, ETU830, ETU850, ETU856, ETU860
Starter protection	TM120M	ETU310M	–	–
<b>Integrated functions</b>				
Parameterizing	Setting and reading the parameters • In A	Setting and reading the parameters • In A and s	Setting and reading the parameters • Via display and communication • Fine setting of the parameters • Reading the measured values	Setting and reading the parameters • Via display and communication • Fine setting of the parameters • Reading the measured values
Status display	–	Indicating the ETU status via LEDs	Indicating the ETU status via LEDs	Indicating the ETU status via LEDs
Interface	–	Interface for test devices	Interface for test devices	Interface for test devices
Metering function	–	–	–	Metering function integrated
<b>Optional expansions</b>				
24 V module	–	–	 24 V module for continuous power supply (also without primary current through the molded case circuit breaker)	 24 V module for continuous power supply (also without primary current through the molded case circuit breaker)
External function box	–	 EFB300 external function box for connection to the ETU	 EFB300 external function box for connection to the ETU	 EFB300 external function box for connection to the ETU
Maintenance mode box	–	 MMB300 maintenance mode box for connection to the ETU	 MMB300 maintenance mode box for connection to the ETU	 MMB300 maintenance mode box for connection to the ETU
Communication module	–	–	 COM060 communication module	 COM060 communication module
Breaker data server	–	–	 COM800/COM100 breaker data server with interface to • PROFIBUS • PROFINET • Modbus RTU • Ethernet (Modbus TCP)	 COM800/COM100 breaker data server with interface to • PROFIBUS • PROFINET • Modbus RTU • Ethernet (Modbus TCP)
External display	–	–	 DSP800 external display for installing in the cubicle door	 DSP800 external display for installing in the cubicle door
Test device	–	 TD300/TD400/TD500 test device	 TD300/TD400/TD500 test device	 TD300/TD400/TD500 test device

## Protection functions of the 3VA5 with thermal-magnetic trip unit

	TM120M AM	TM210 FTFM	TM230 FTAM	TM240 ATAM
<b>Protection</b>				
Motor circuit protector	■	–	–	–
Line protection	–	■	■	■
<b>Version available with</b>				
1-pole breaker	–	■	–	–
2-pole breaker in 3-pole enclosure	–	■	■	–
3-pole breaker	■	■	■	■
4-pole breaker	–	■	■	■
<b>Available protection parameters</b>				
$I_r$ adjustable	–	–	–	■
$I_r$ adjustable	■	–	■	■
$I_r$ fixed	–	■	■	–
$I_i$ fixed	–	■	–	–

2

## Protection functions of the 3VA6 with electronic trip unit

	ETU310M I	ETU320 LI	ETU330 LIG	ETU350 LSI	ETU550 LSI	ETU556 LSI (G alarm)	ETU560 LSIG	ETU820 LI	ETU830 LIG	ETU850 LSI	ETU856 LSI (G alarm)	ETU860 LSIG
<b>Protection</b>												
Motor circuit protector	■	–	–	–	–	–	–	–	–	–	–	–
Line protection	–	■	■	■	■	■	■	■	■	■	■	■
<b>Version available with</b>												
3-pole without external neutral conductor transformer	■	■	■	■	–	–	–	–	–	–	–	–
3-pole with external neutral conductor transformer	–	–	–	–	■	■	■	–	–	■	■	■
4-pole with protected neutral conductor transformer	–	■	■	■	■	■	■	■	■	■	■	■
<b>Available protection parameters</b>												
Characteristic in L range	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$	$I^2t$
$I_r$	–	■	■	■	■	■	■	■	■	■	■	■
$t_r$ at $6 \times I_r$	–	■	■	■	■	■	■	■	■	■	■	■
Thermal image	■	■	■	■	■	■	■	■	■	■	■	■
Thermal image can be switched on/off	–	–	–	–	■	■	■	–	–	■	■	■
$I_{sd}$	–	–	–	■	■	■	■	–	–	■	■	■
$t_{sd}$ at $8 \times I_r$	–	–	–	■	■	■	■	–	–	■	■	■
Characteristic in S range: $I^2t_{sd}$	–	–	–	■	■	■	■	–	–	■	■	■
Characteristic in S range: selectable $I^2t_{sd} / t_{sd}$	–	–	–	–	■	■	■	–	–	■	■	■
$I_i$	■	■	■	■	■	■	■	■	■	■	■	■
$I_N$ <sup>1)</sup>	–	■	■	■	■	■	■	■	■	■	■	■
$I_g$	–	–	■	–	–	–	–	–	■	–	–	■
$t_g$ at $2 \times I_g$	–	–	■	–	–	–	–	–	■	–	–	■
Characteristic in G range: $I^2t_g$	–	–	–	–	–	–	■	–	■	–	–	■
Characteristic in G range: selectable $I^2t_g / t_g$	–	–	–	–	–	–	■	–	■	–	–	■
Ground-fault alarm function	–	–	–	–	–	■	■	–	–	–	■	■
ZSI	–	■	■	■	■	■	■	■	■	■	■	■
Arc fault mitigation mode	–	■	■	■	■	■	■	■	■	■	■	■

■ Available – Not available/not present


<sup>1)</sup> Available for circuit breakers with an external current transformer for the neutral conductor and for 4-pole circuit breakers

# Online configurator highlights


[www.siemens.com/lowvoltage/configurators](http://www.siemens.com/lowvoltage/configurators)

## Search function with global direct input


Searches for specific terms and jumps to MLFB based on input to the correct configurator

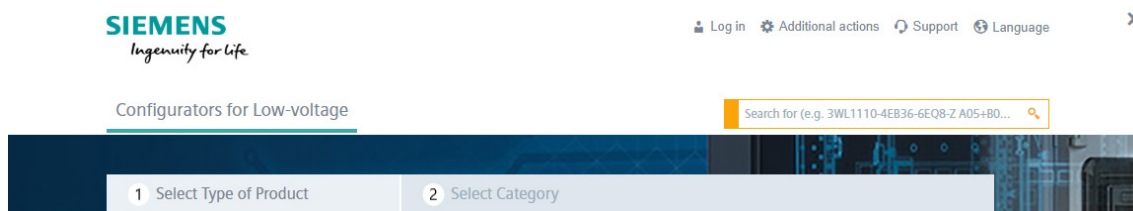


## Product list stores multiple configurations and can transfer them collectively to the shopping cart

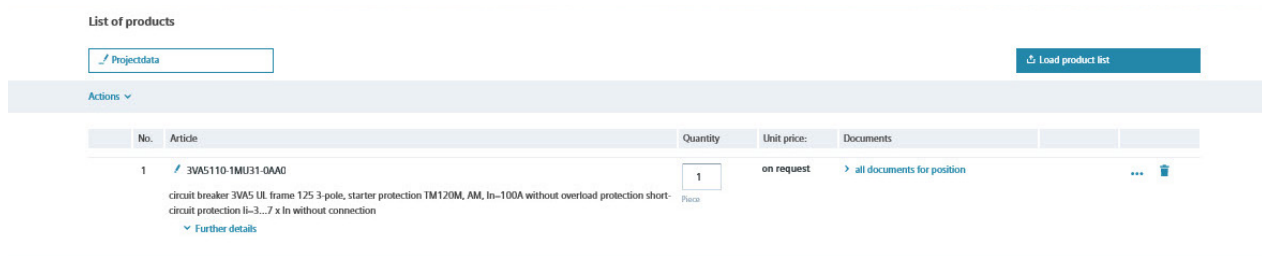

## Recall of completed configurations for modification or additional configuration

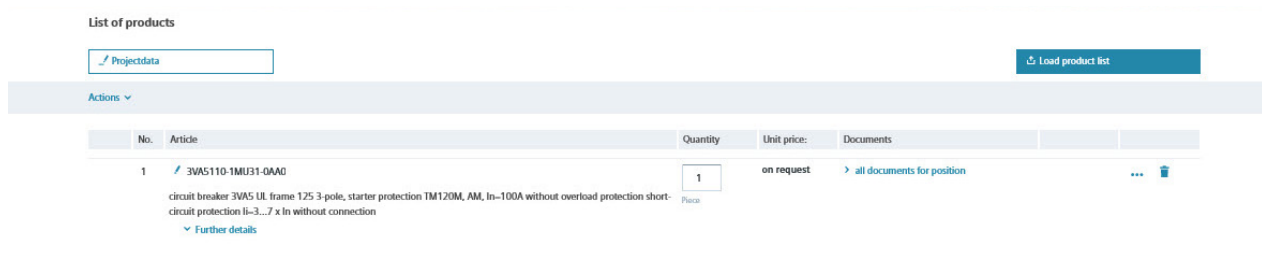

## Responsive Design

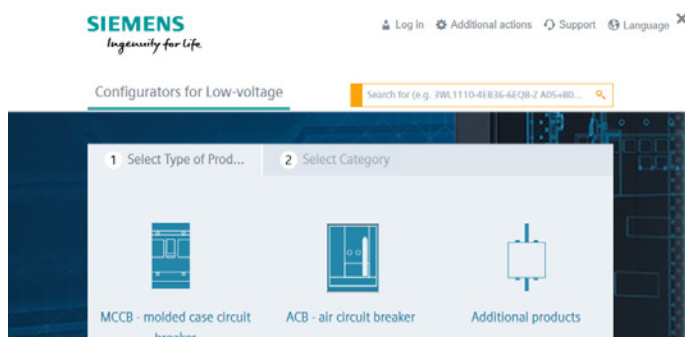

## www.siemens.com/lowvoltage/3va-ul-configurator

### Visualization of the internally mountable accessories (slot assignment)

✓ The configuration is complete. You can order this product.

Filter (e.g. "power", ...)

Basic breaker | Trip Unit | Type of mounting | Aux Release & Aux Switch | **Mountable accessories** | Result | CAD/CAE

2020\_05.13

**Assembly option**

Field Assembly

**Auxiliary release**


Shunt trip left (STL) Without

Shunt trip flexible (STF) Without

Undervoltage release (UVR) Without

Universal release (UNI) Without

**Slot assignment**

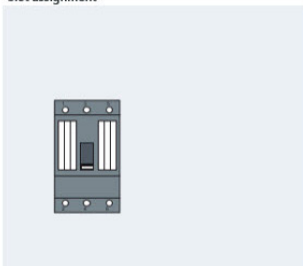

**Auxiliary switch/alarm switch (changeover contacts - Form C)**

**Auxiliary switch type HP**

AUX auxiliary switch

LCS leading auxiliary switch

**Auxiliary switch type HQ**

AUX auxiliary switch

AUX auxiliary switch, suitable for electronic circuits

LCS leading auxiliary switch

LCS leading auxiliary switch, suitable for electronic circuits

**Alarm switch type HP**

TAS alarm switch

**Alarm switch type HQ**

TAS alarm switch

TAS alarm switch, suitable for electronic circuits

### Download of the individual edz files for 3VA

SIEMENS  
Ingenuity for life

Additional actions | List of products | Support | Language

✓ The configuration is complete. You can order this product.

Filter (e.g. "power", ...)

Basic breaker | Trip Unit | Type of mounting | Aux Release & Aux Switch | **Mountable accessories** | Result | CAD/CAE

2020\_05.13

**Selection**

Assembly drawing

3VA-UL molded-case circuit bre

**Preview**

Wire frame view | 3D view | Dimension drawing | Area Model View | Unit Wiring Diagram IEC

**Documentation and reporting**

Choose languages for the data sheet deutsch

Project data for the datasheet

**Download selection of document types**

Datasheets (PDF)

**Selection of download format**

All in a ZIP file

**Component documentation**

3VA5110-1MU31-0AA0

Datasheet (PDF)

© Siemens AG | Application Information

**Download – all CAD formats**

View Area Model View

View option Dimetric

File type Bitmap (\*.bmp)

Start generation

**Download – all documents**

open documents dialog

### Automatic generation of the 3D model, 2D dimension drawing and the internal circuit diagram according to IEC

✓ The configuration is complete. You can order this product.

Filter (e.g. "power", ...)

Basic breaker | Trip Unit | Type of mounting | Aux Release & Aux Switch | **Mountable accessories** | Result | CAD/CAE

2020\_05.13


**Selection**

Assembly drawing

3VA-UL molded-case circuit breaker

**Preview**

Wire frame view | 3D view | Dimension drawing | Area Model View | Unit Wiring Diagram IEC



**Download – all CAD formats**

View Area Model View

View option Dimetric

File type Bitmap (\*.bmp)

Start generation

**Download – all documents**

open documents dialog

# System overview

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

## Switching devices




3VA5 for standard applications




3VA6 for applications with more stringent requirements

## Trip unit



Thermal-magnetic trip unit (TMTU)



Electronic trip unit (ETU)



Electronic trip unit (ETU) with display, and optionally with metering function

## Trip unit accessories



24 V module



Communication module



Breaker data server



External display



Test device

## Type of mounting



Fixed-mounted



Draw-out unit, complete kit



Plug-in unit, complete kit

## Supplementary accessories



Auxiliary circuit connector



Door feedthrough



Position signaling switch



Cylinder lock adapter



Crank

## Main conductor connections



Front bus connectors extended



Front bus connectors offset



Circular conductor terminal



Box terminal

## Connection accessories



Insulation accessories

### Note:

You will find a detailed range of accessories in the Accessories section.



## Auxiliary releases/ auxiliary switches



Shunt trip STF/STL

Universal release  
UNIUndervoltage  
release UVRAuxiliary switch  
AUXTrip alarm switch  
TASLeading changeover  
switch LCSElectrical alarm switch  
EAS

## Mountable accessories



Manual operator

Motorized  
operating  
mechanism

Operating unit with Bowden cable



Operating unit with linkage

## Additional circuit breaker accessories



Cover frame




Locking provision



Cylinder lock

## Mechanical interlocks



Sliding bar interlock



Interlocking with rod



Handle interlock using a Bowden cable

### Note:

You will find a detailed range of accessories in the Accessories section.

# Structure of the article numbers

## Basic configuration for line protection

The structure shown below is intended as an overview of each position and its meaning. For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

		3VA										4	5	6	7	8	9	10	11	12	13	AA0	
Trip units	Thermal-magnetic											5											
	Electronic											6											
Size		3VA51	3VA52	3VA53	3VA54	3VA55	3VA61	3VA62	3VA63	3VA64	3VA65	3VA66											
	125 A	■	-	-	-	-	-	-	-	-	-	-	1										
	150 A	-	-	-	-	-	■	-	-	-	-	-	1										
	250 A	-	■	-	-	-	-	■	-	-	-	-	2										
	400 A	-	-	■	-	-	-	-	■	-	-	-	3										
	600 A	-	-	-	■	-	-	-	-	■	-	-	4										
	800 A	-	-	-	-	■	-	-	-	-	■	-	5										
1000 A	-	-	-	-	-	-	-	-	-	-	■	6											
Max. rated current $I_n$	Line protection	15 A	■	-	-	-	-	-	-	-	-	-	9	5									
	20 A	■	-	-	-	-	-	-	-	-	-	-	2	0									
	25 A	■	-	-	-	-	-	-	-	-	-	-	2	5									
	30 A	■	-	-	-	-	-	-	-	-	-	-	3	0									
	35 A	■	-	-	-	-	-	-	-	-	-	-	3	5									
	40 A	■	■	-	-	-	■	-	-	-	-	-	4	0									
	45 A	■	■	-	-	-	-	-	-	-	-	-	4	5									
	50 A	■	■	-	-	-	-	-	-	-	-	-	5	0									
	60 A	■	■	-	-	-	-	-	-	-	-	-	6	0									
	70 A	■	■	-	-	-	-	-	-	-	-	-	7	0									
	80 A	■	■	-	-	-	-	-	-	-	-	-	8	0									
	90 A	■	■	-	-	-	-	-	-	-	-	-	9	0									
	100 A	■	■	-	-	-	■	■	-	-	-	-	1	0									
	110 A	■	■	-	-	-	-	-	-	-	-	-	1	1									
	125 A	■	■	-	-	-	-	-	-	-	-	-	1	2									
	150 A	-	■	-	-	-	■	-	-	-	-	-	1	5									
	175 A	-	■	-	-	-	-	-	-	-	-	-	1	7									
	200 A	-	■	■	-	-	-	-	-	-	-	-	2	0									
	225 A	-	■	■	-	-	-	-	-	-	-	-	2	2									
	250 A	-	■	■	-	-	-	■	■	-	-	-	2	5									
	300 A	-	-	■	-	-	-	-	-	-	-	-	3	0									
	350 A	-	-	■	-	-	-	-	-	-	-	-	3	5									
	400 A	-	-	■	■	-	-	-	■	■	-	-	4	0									
	450 A	-	-	-	■	-	-	-	-	-	-	-	4	5									
	500 A	-	-	-	■	-	-	-	-	-	-	-	5	0									
	600 A	-	-	-	■	■	-	-	-	■	■	-	6	0									
	700 A	-	-	-	-	■	-	-	-	-	-	-	7	0									
800 A	-	-	-	-	■	-	-	-	-	■	-	8	0										
1000 A	-	-	-	-	-	-	-	-	-	-	■	1	0										
Short-circuit breaking capacity $I_{cu} = I_{cs}$ at 480 V 50/60 Hz	25 kA	■	-	-	-	-	-	-	-	-	-		4										
	35 kA	■	■	■	■	■	■	■	■	■	■		5										
	65 kA	■	■	■	■	■	■	■	■	■	■		6										
	100 kA	-	■	■	■	■	■	■	■	■	■		7										
	150 kA	-	-	-	-	-	■	■	■	■	-		8										
200 kA	-	-	-	-	-	■	■	■	■	-		0											

■ Available    - Not available/not present



# Structure of the article numbers

## Basic configuration for motor circuit protectors and molded case switches

The structure shown below is intended as an overview of each position and its meaning. For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

		3VA										4	5	6	7	8	9	10	11	12	- 0AA0		
Trip units	Thermal-magnetic											5											
	Electronic											6											
Size		3VA51	3VA52	3VA53	3VA54	3VA55	3VA61	3VA62	3VA63	3VA64	3VA65												
	125 A	■	-	-	-	-	-	-	-	-	-												
	150 A	-	-	-	-	-	■	-	-	-	-												
	250 A	-	■	-	-	-	-	■	-	-	-												
	400 A	-	-	■	-	-	-	-	■	-	-												
	600 A	-	-	-	■	-	-	-	-	■	-												
800 A	-	-	-	-	■	-	-	-	-	■													
Max. rated current $I_n$	Motor circuit protector	1 A	■	-	-	-	-	-	-	-	-												
		2 A	■	-	-	-	-	-	-	-	-	-											
		3 A	■	-	-	-	-	-	-	-	-	-											
		5 A	■	-	-	-	-	-	-	-	-	-											
		7 A	■	-	-	-	-	-	-	-	-	-											
		10 A	■	-	-	-	-	-	-	-	-	-											
		15 A	■	-	-	-	-	-	-	-	-	-											
		25 A	■	-	-	-	-	■	-	-	-	-											
		30 A	■	-	-	-	-	■	-	-	-	-											
		40 A	■	-	-	-	-	■	-	-	-	-											
		50 A	■	-	-	-	-	■	-	-	-	-											
		70 A	■	-	-	-	-	■	-	-	-	-											
		80 A	■	-	-	-	-	■	-	-	-	-											
		90 A	■	-	-	-	-	■	-	-	-	-											
		100 A	■	-	-	-	-	■	-	-	-	-											
		110 A	■	-	-	-	-	-	■	-	-	-											
	125 A	■	-	-	-	-	-	■	-	-	-												
	150 A	-	■	-	-	-	-	-	■	-	-												
	200 A	-	■	-	-	-	-	-	■	-	-												
	250 A	-	■	■	-	-	-	-	■	-	-												
	400 A	-	-	-	■	-	-	-	■	■	-												
	500 A	-	-	-	■	-	-	-	-	■	-												
	600 A	-	-	-	■	■	-	-	-	-	-												
	800 A	-	-	-	-	■	-	-	-	-	■												
	1000 A	-	-	-	-	-	-	-	-	-	-												
	Molded case switch	100 A	■	■	-	-	-	-	-	-	-												
		150 A	-	■	-	-	-	-	-	-	-												
		250 A	-	■	■	-	-	-	-	-	-												
		400 A	-	-	■	■	-	-	-	-	-												
		600 A	-	-	-	■	■	-	-	-	-												
		800 A	-	-	-	-	■	-	-	-	-												
	Short-circuit breaking capacity $I_{cu} = I_{cs}$ at 480 V 50/60 Hz	Without, with	65 kA	-	■	■	■	■	-	-	-												
SCCR rating as a		100 kA	-	■	■	■	■	■	■	■													
combined device		65 kA	■	-	-	-	-	-	-	-													

■ Available    - Not available/not present

		3VA										- 0AA0			
		4	5	6	7	8	9	10	11	12					
		3VA51	3VA52	3VA53	3VA54	3VA55	3VA61	3VA62	3VA63	3VA64	3VA65				
Protection function thermal-magnetic	Motor circuit protector	Setting range I <sub>n</sub> high	■	■	■	■	■	-	-	-	-	TM120M	AM	M	H
		Setting range I <sub>n</sub> low	■	■	■	■	-	-	-	-	-	TM120M	AM	M	U
Protection function only intrinsic device protection	Molded case switch		■	■	■	■	-	-	-	-	-	MCS110	-	B	B
Protection function electronic	Motor circuit protector		-	-	-	-	■	■	■	■	■	ETU310M I		M	S
Number of poles	Motor circuit protector		■	■	■	■	■	■	■	■	■	3-pole			3
	Molded case switch		■	-	-	-	-	-	-	-	-	2-pole			2
			-	■	■	■	■	-	-	-	-	2-pole in 3-pole enclosure			6
			■	■	■	■	■	-	-	-	-	3-pole			3
Connection technology	Without	■	■	■	■	-	■	■	■	■	-				1
	Nut keeper kit	-	-	-	-	■	-	-	-	-	■				2

# Internal accessories

## Auxiliary and alarm switches (changeover contacts)

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

		3VA61
3VA51		3VA62
3VA52		3VA63
3VA53		3VA64
3VA54		3VA65
3VA55		3VA66

### Auxiliary switches AUX

- Used to signal the position of the main contacts of the molded case circuit breaker
- The contacts of the auxiliary switch and the molded case circuit breaker close in unison



Type	Width	I <sub>e</sub>	U <sub>e</sub> AC/DC	Version	
HQ	7 mm (1 slot)	6 A	240 V/250 V	Standard	3VA9978-0AA12
		0.3 A	24 V/24 V	Electronic-compatible	3VA9978-0AA13
HP	14 mm (2 slots)	10 A	600 V/250 V	Standard	3VA9978-0AA11

### Leading changeover switches LCS

- Used for load shedding, for example
- Signal the opening of the main contacts with a lead time of 20 ms in advance of circuit breaker trips



Type	Width	I <sub>e</sub>	U <sub>e</sub> AC/DC	Version	
HQ	7 mm (1 slot)	6 A	240 V/250 V	Standard	3VA9978-0AA22
		0.3 A	24 V/24 V	Electronic-compatible	3VA9978-0AA23
HP	14 mm (2 slots)	10 A	600 V/250 V	Standard	3VA9978-0AA21

### Trip alarm switches TAS

- Signal every circuit breaker tripping operation
- Are actuated whenever the molded case circuit breaker switches to the TRIP position



Type	Width	I <sub>e</sub>	U <sub>e</sub> AC/DC	Version	
HQ	7 mm (1 slot)	6 A	240 V/250 V	Standard	3VA9978-0AB12
		0.3 A	24 V/24 V	Electronic-compatible	3VA9978-0AB13
HP	14 mm (2 slots)	10 A	600 V/250 V	Standard	3VA9978-0AB11

### Electrical alarm switches EAS

- Are actuated as soon as the main contacts of the molded case circuit breaker open in the event that the breaker is tripped by the ETU



Type	Width	I <sub>e</sub>	U <sub>e</sub> AC/DC	Version		
HQ	7 mm (1 slot)	6 A	240 V/250 V	Standard	–	3VA9978-0AB22
		0.3 A	24 V/24 V	Electronic-compatible	–	3VA9978-0AB23

## Auxiliary releases

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)






2

			3VA51	3VA61	
			3VA52	3VA62	
			3VA53	3VA63	3VA65
			3VA54	3VA64	3VA66
			3VA55		
<b>Shunt trips left STL</b>					
	<ul style="list-style-type: none"> <li>Used for remote-controlled tripping of the molded case circuit breaker</li> <li>Have particularly low power consumption</li> </ul>				
	<b>Version</b>	<b>U<sub>e</sub> 50/60 Hz AC</b>	<b>U<sub>e</sub> DC</b>		
	Standard	–	12 V		3VA9978-OBL10
		24 V	24 ... 30 V		3VA9978-OBL30
		48 ... 60 V	48 ... 60 V		3VA9978-OBL31
		110 ... 127 V	110 ... 127 V		3VA9978-OBL32
		208 ... 277 V	220 ... 250 V		3VA9978-OBL33
		380 ... 600 V	–		3VA9978-OBL20
<b>Shunt trips flexible STF</b>					
	<ul style="list-style-type: none"> <li>Used for remote-controlled tripping of the molded case circuit breaker</li> <li>Flexible installation</li> </ul>				
	<b>Version</b>	<b>U<sub>e</sub> 50/60 Hz AC</b>	<b>U<sub>e</sub> DC</b>		
		24 V	–	3VA9978-0BA20	–
		48 ... 60 V	–	3VA9978-0BA21	–
		110 ... 127 V	–	3VA9978-0BA22	–
		208 ... 277 V	–	3VA9978-0BA23	–
		380 ... 500 V	–	3VA9978-0BA24	–
		600 V	–	3VA9978-0BA25	–
<b>Universal releases UNI</b>					
	<ul style="list-style-type: none"> <li>Combination of shunt trip and undervoltage release</li> </ul>				
	<b>Version</b>	<b>U<sub>e</sub> 50/60 Hz AC</b>	<b>U<sub>e</sub> DC</b>		
		–	12 V		3VA9978-0BD11
		–	24 V		3VA9978-0BD12
		–	48 V		3VA9978-0BD13
<b>Undervoltage releases UVR</b>					
	<ul style="list-style-type: none"> <li>Trip the molded case circuit breaker in the event that the rated voltage of a monitored circuit drops below a minimum permissible limit or fails altogether</li> </ul>				
	<b>Version</b>	<b>U<sub>e</sub> 50/60 Hz AC</b>	<b>U<sub>e</sub> DC</b>		
		–	12 V		3VA9978-0BB10
		–	24 V		3VA9978-0BB11
		24 V	–		3VA9978-0BB20
		–	48 V		3VA9978-0BB12
		120 ... 127 V	–		3VA9978-0BB24
		–	125 ... 127 V		3VA9978-0BB14
		208 ... 230 V	–		3VA9978-0BB25
		–	250 V		3VA9978-0BB16
		440 ... 480 V	–		3VA9978-0BB27
<b>Time-delay devices for undervoltage releases</b>					
	<b>Version</b>	<b>U<sub>e</sub> 50/60 Hz AC</b>	<b>U<sub>e</sub> DC</b>		
		230 V	230 V		3VA9978-0BF22
		–	24 V		3VA9978-0BF23

# Manual operators

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

				3VA51	3VA52	3VA53	3VA54	3VA55	
					3VA61	3VA63	3VA64	3VA65	
					3VA62	3VA64		3VA66	
<b>Front mounted rotary operators</b>									
<ul style="list-style-type: none"> <li>• Handle</li> <li>• Degree of protection IP30</li> <li>• For 3-pole and 4-pole breakers</li> </ul>									
Version	Door open function	Illumination kit	Door interlock						
	Without	Without	Without	3VA9137-0EK11	3VA9277-0EK11	3VA9447-0EK11	3VA9677-0EK11		
			With	3VA9137-0EK21	3VA9277-0EK21	3VA9447-0EK21	3VA9677-0EK21		
		With	Without	3VA9137-0EK13	3VA9277-0EK13	3VA9447-0EK13	–		
			With	3VA9137-0EK23	3VA9277-0EK23	3VA9447-0EK23	–		
	With	Without	With	3VA9137-0EK31	3VA9277-0EK31	3VA9447-0EK31	3VA9677-0EK31	<b>new</b>	
		With	With	3VA9137-0EK33	3VA9277-0EK33	3VA9447-0EK33	–		
	Without	Without	Without	3VA9137-0EK15	3VA9277-0EK15	3VA9447-0EK15	3VA9677-0EK15		
			With	3VA9137-0EK25	3VA9277-0EK25	3VA9447-0EK25	3VA9677-0EK25		
		With	Without	3VA9137-0EK17	3VA9277-0EK17	3VA9447-0EK17	–		
			With	3VA9137-0EK27	3VA9277-0EK27	3VA9447-0EK27	–		
	With	Without	With	3VA9137-0EK35	3VA9277-0EK35	3VA9447-0EK35	3VA9677-0EK35	<b>new</b>	
		With	With	3VA9137-0EK37	3VA9277-0EK37	3VA9447-0EK37	–		
<b>Door mounted rotary operator</b>									
<ul style="list-style-type: none"> <li>• Shaft 300 mm (325 mm for 1000 A)</li> <li>• With mounting tolerance compensation</li> <li>• Handle with masking plate 75 × 75 mm</li> <li>• Degree of protection IP65</li> <li>• For 3-pole and 4-pole breakers</li> <li>• Enclosure types 1, 3R, 12, 4/4X</li> </ul>									
Version	Door open function	Illumination kit	Door interlock						
	Without	Without	With	3VA9137-0FK21	3VA9277-0FK21	3VA9447-0FK21	3VA9677-0FK21		
			With	3VA9137-0FK23	3VA9277-0FK23	3VA9447-0FK23	3VA9677-0FK23		
		With	Without	With	3VA9137-0FK31	3VA9277-0FK31	3VA9447-0FK31	3VA9677-0FK31	<b>new</b>
			With	With	3VA9137-0FK33	3VA9277-0FK33	3VA9447-0FK33	3VA9677-0FK33	<b>new</b>
		Without	Without	With	3VA9137-0FK25	3VA9277-0FK25	3VA9447-0FK25	3VA9677-0FK25	
			With	With	3VA9137-0FK27	3VA9277-0FK27	3VA9447-0FK27	3VA9677-0FK27	
With		Without	With	3VA9137-0FK35	3VA9277-0FK35	3VA9447-0FK35	3VA9677-0FK35	<b>new</b>	
		With	With	3VA9137-0FK37	3VA9277-0FK37	3VA9447-0FK37	3VA9677-0FK37	<b>new</b>	
<b>Door mounted rotary operators without handle</b>									
<ul style="list-style-type: none"> <li>• Degree of protection IP30</li> <li>• For 3-pole and 4-pole breakers</li> </ul>									
Version	Door open function	Illumination kit	Door interlock						
	With shaft stub (gray)	Without	Without	3VA9137-0GK00	3VA9277-0GK00	3VA9447-0GK00	3VA9677-0GK00		



		3VA51	3VA52	3VA53	3VA54	3VA55		
			3VA61	3VA62	3VA63	3VA64	3VA65	3VA66
<b>Side wall mounted rotary operators without mounting plates</b>								
	<ul style="list-style-type: none"> <li>Rotary operator with shaft 300 mm</li> <li>Handle with masking plate 75 × 75 mm</li> <li>Degree of protection IP65</li> <li>For 3-pole and 4-pole breakers</li> </ul>							
<b>Version</b>	<b>Illumination kit</b>							
Standard (gray)	Without	3VA9137-0PK11	3VA9277-0PK11	–	–	–	–	–
	With	3VA9137-0PK13	3VA9277-0PK13	–	–	–	–	–
EMERGENCY-OFF (red/yellow)	Without	3VA9137-0PK15	3VA9277-0PK15	–	–	–	–	–
	With	3VA9137-0PK17	3VA9277-0PK17	–	–	–	–	–
<b>Side wall mounted rotary operators with mounting plates</b>								
	<ul style="list-style-type: none"> <li>Rotary operator with short shaft and mounting plate for mounting directly on the side wall</li> <li>Handle with masking plate 75 × 75 mm</li> <li>Degree of protection IP65</li> <li>For 3-pole and 4-pole breakers</li> </ul>							
<b>Version</b>	<b>Illumination kit</b>							
Standard (gray)	Without	3VA9137-0PK51	3VA9277-0PK51	–	–	–	–	–
	With	3VA9137-0PK53	3VA9277-0PK53	–	–	–	–	–
EMERGENCY-OFF (red/yellow)	Without	3VA9137-0PK55	3VA9277-0PK55	–	–	–	–	–
	With	3VA9137-0PK57	3VA9277-0PK57	–	–	–	–	–
<b>Door interlock for side wall mounted rotary operators</b>								
		3VA9177-0VF40	3VA9277-0VF40	–	–	–	–	–
<b>Extended DIN rails for N/PE terminals</b>								
	<b>Version</b>	<b>Rated current I<sub>n</sub></b>						
	For mounting plate	≤250 A		3VA9987-0GL30				–
<b>Supplementary handles for door mounted rotary operators (NFPA79)</b>								
	<ul style="list-style-type: none"> <li>Mandatory according to NFPA79</li> <li>For operation when cabinet door is open</li> </ul>							
<b>Version</b>								
Standard (gray)		3VA9137-0GC01	3VA9477-0GC01	3VA9477-0GC11	3VA9677-0GC01			
EMERGENCY-OFF (red/yellow)		3VA9137-0GC05	3VA9477-0GC05	3VA9477-0GC15	3VA9677-0GC05			
<b>Handles</b>								
	<ul style="list-style-type: none"> <li>With masking plate</li> </ul>							
<b>Version</b>	<b>Door open function</b>	<b>Tolerance compensation</b>						
Standard (gray)	Without	Without	8UD1721-0AB11	8UD1731-0AB11	8UD1741-0AB11			
		With	8UD1721-0AB21	8UD1731-0AB21	8UD1741-0AB21			
	With	Without	8UD1721-0AC11	8UD1731-0AC11	8UD1741-0AC11	new		
		With	8UD1721-0AC21	8UD1731-0AC21	8UD1741-0AC21	new		
EMERGENCY-OFF (red/yellow)	Without	Without	8UD1721-0AB15	8UD1731-0AB15	8UD1741-0AB15			
		With	8UD1721-0AB25	8UD1731-0AB25	8UD1741-0AB25			
	With	Without	8UD1721-0AC15	8UD1731-0AC15	8UD1741-0AC15	new		
		With	8UD1721-0AC25	8UD1731-0AC25	8UD1741-0AC25	new		

# Manual operators

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

		3VA51	3VA62	3VA63	3VA53	3VA54	3VA55																																						
<b>Handle lever extensions</b>																																													
	<ul style="list-style-type: none"> <li><b>Note:</b> The handle lever extension is already included in the scope of supply of the breakers.</li> </ul>	–	–	3VA9487-0SC10	3VA9987-0SC10		<b>new</b>																																						
<b>Shafts</b>																																													
	<table border="1"> <thead> <tr> <th>Variant</th> <th>Length</th> <th>3VA51</th> <th>3VA62</th> <th>3VA63</th> <th>3VA53</th> <th>3VA54</th> <th>3VA55</th> </tr> </thead> <tbody> <tr> <td rowspan="2">8 × 8 mm</td> <td>300 mm</td> <td></td> <td></td> <td>8UD1900-2WA00</td> <td></td> <td></td> <td>–</td> </tr> <tr> <td>600 mm</td> <td></td> <td></td> <td>8UD1900-2WB00</td> <td></td> <td></td> <td>–</td> </tr> <tr> <td rowspan="2">12 × 12 mm</td> <td>325 mm</td> <td></td> <td></td> <td>–</td> <td></td> <td></td> <td>8UD1900-4WA00</td> </tr> <tr> <td>600 mm</td> <td></td> <td></td> <td>–</td> <td></td> <td></td> <td>8UD1900-4WB00</td> </tr> </tbody> </table>	Variant	Length	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55	8 × 8 mm	300 mm			8UD1900-2WA00			–	600 mm			8UD1900-2WB00			–	12 × 12 mm	325 mm			–			8UD1900-4WA00	600 mm			–			8UD1900-4WB00						
Variant	Length	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55																																						
8 × 8 mm	300 mm			8UD1900-2WA00			–																																						
	600 mm			8UD1900-2WB00			–																																						
12 × 12 mm	325 mm			–			8UD1900-4WA00																																						
	600 mm			–			8UD1900-4WB00																																						
<b>Adapters for shafts</b>																																													
	<table border="1"> <thead> <tr> <th>Variant</th> <th>Purpose</th> <th>3VA51</th> <th>3VA62</th> <th>3VA63</th> <th>3VA53</th> <th>3VA54</th> <th>3VA55</th> </tr> </thead> <tbody> <tr> <td>8 × 8 mm</td> <td>With door mounted rotary operator and side wall mounted rotary operator</td> <td></td> <td></td> <td>8UD1900-2DA00</td> <td></td> <td></td> <td>–</td> </tr> <tr> <td>12 × 12 mm</td> <td>With door mounted rotary operator and side wall mounted rotary operator</td> <td></td> <td></td> <td>–</td> <td></td> <td></td> <td>8UD1900-4DA00</td> </tr> </tbody> </table>	Variant	Purpose	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55	8 × 8 mm	With door mounted rotary operator and side wall mounted rotary operator			8UD1900-2DA00			–	12 × 12 mm	With door mounted rotary operator and side wall mounted rotary operator			–			8UD1900-4DA00																				
Variant	Purpose	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55																																						
8 × 8 mm	With door mounted rotary operator and side wall mounted rotary operator			8UD1900-2DA00			–																																						
12 × 12 mm	With door mounted rotary operator and side wall mounted rotary operator			–			8UD1900-4DA00																																						
<b>Door couplings</b>																																													
	<table border="1"> <thead> <tr> <th>Variant</th> <th>3VA51</th> <th>3VA62</th> <th>3VA63</th> <th>3VA53</th> <th>3VA54</th> <th>3VA55</th> </tr> </thead> <tbody> <tr> <td>8 × 8 mm</td> <td></td> <td></td> <td>8UD1900-2HA00</td> <td></td> <td></td> <td>–</td> </tr> <tr> <td>12 × 12 mm</td> <td></td> <td></td> <td>–</td> <td></td> <td></td> <td>8UD1900-4HA00</td> </tr> </tbody> </table>	Variant	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55	8 × 8 mm			8UD1900-2HA00			–	12 × 12 mm			–			8UD1900-4HA00																							
Variant	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55																																							
8 × 8 mm			8UD1900-2HA00			–																																							
12 × 12 mm			–			8UD1900-4HA00																																							
<b>Mounting tolerance compensations</b>																																													
	<table border="1"> <thead> <tr> <th>Variant</th> <th>3VA51</th> <th>3VA62</th> <th>3VA63</th> <th>3VA53</th> <th>3VA54</th> <th>3VA55</th> </tr> </thead> <tbody> <tr> <td>8 × 8 mm</td> <td></td> <td></td> <td>8UD1900-2GA00</td> <td></td> <td></td> <td>–</td> </tr> <tr> <td>12 × 12 mm</td> <td></td> <td></td> <td>–</td> <td></td> <td></td> <td>8UD1900-4GA00</td> </tr> </tbody> </table>	Variant	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55	8 × 8 mm			8UD1900-2GA00			–	12 × 12 mm			–			8UD1900-4GA00																							
Variant	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55																																							
8 × 8 mm			8UD1900-2GA00			–																																							
12 × 12 mm			–			8UD1900-4GA00																																							
<b>Fixing brackets for shafts</b>																																													
		3VA9137-0GA80	3VA9477-0GA80	3VA9677-0GA80																																									
<b>Variable depth adapters</b>																																													
	<table border="1"> <thead> <tr> <th>Variant</th> <th>3VA51</th> <th>3VA62</th> <th>3VA63</th> <th>3VA53</th> <th>3VA54</th> <th>3VA55</th> </tr> </thead> <tbody> <tr> <td>8 × 8 mm</td> <td></td> <td></td> <td>3VA9487-0GB10</td> <td></td> <td></td> <td>–</td> </tr> </tbody> </table>	Variant	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55	8 × 8 mm			3VA9487-0GB10			–																														
Variant	3VA51	3VA62	3VA63	3VA53	3VA54	3VA55																																							
8 × 8 mm			3VA9487-0GB10			–																																							
<b>Interlocking module UL 508A</b>																																													
	<ul style="list-style-type: none"> <li>Used when the handle is to remain on the circuit breaker when the door is open.</li> </ul>			8UC9400			–																																						

3VA51	3VA61	
3VA52	3VA62	3VA55
3VA53	3VA63	3VA65
3VA54	3VA64	3VA66

## Labeling plates for manual operators



3VA9087-0SX10

–

## Illumination kits for manual operators



- 24 V DC voltage

Version	Rated current I <sub>n</sub>			
Front rotary operator	125 ... 250 A	8UD1900-0KA10	–	–
	150 ... 600 A	–	8UD1900-0KA20	–
Door mounted rotary operator and side wall mounted rotary operator	125 ... 600 A	8UD1900-0KA20	–	–
	600 ... 1000 A	–	–	8UD1900-0KA30

## Cylinder locks (type Kaba), standard masking plates



Purpose	Door open function	Key		
For door mounted rotary operator and side wall mounted rotary operator (in the masking plate), only for locking, not for interlocking	Without	1	8UD1900-0MB01	–
		2	8UD1900-0NB01	–
		3	8UD1900-0PB01	–
		4	8UD1900-0QB01	–
	With	1	8UD1900-0MC01	–
		2	8UD1900-0NC01	–
		3	8UD1900-0PC01	–
		4	8UD1900-0QC01	–

## Cylinder locks (type Kaba), EMERGENCY-OFF masking plates



Purpose	Door open function	Key		
For door mounted rotary operator and side wall mounted rotary operator (in the masking plate), only for locking, not for interlocking	Without	1	8UD1900-0MB05	–
		2	8UD1900-0NB05	–
		3	8UD1900-0PB05	–
		4	8UD1900-0QB05	–
	With	1	8UD1900-0MC05	–
		2	8UD1900-0NC05	–
		3	8UD1900-0PC05	–
		4	8UD1900-0QC05	–

## Cylinder locks (type RONIS)



- Includes a lock with 2 keys
- For locking or interlocking
- For installation on the circuit breaker side in all rotary operators
- For mounting in the adapter kit for the accessories compartment
- **Note:** The cylinder lock adapter for rotary operators is also needed for locking or interlocking circuit breakers via rotary operators

Key		
1	3VA9980-0VL10	
3	3VA9980-0VL30	
4	3VA9980-0VL40	

## Cylinder lock adapters for rotary operators



- To mount the cylinder lock in the rotary operator (also possible with door mounted rotary operator and side wall mounted rotary operator), on circuit breaker side, NOT in masking plate







3VA9980-0LF20

3VA9670-0LF20 **new**

# Manual operators

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

		3VA51	3VA52 3VA61 3VA62	3VA53 3VA54 3VA63 3VA64	3VA55 3VA65 3VA66	
<b>Auxiliary switch modules for rotary operating mechanisms</b>						
	<b>Version</b>					
	2x leading to "ON"	3VA9137-0GX10 <b>new</b>	3VA9477-0GX10 <b>new</b>	3VA9477-0GX10 <b>new</b>	–	
	2x leading to "ON" and 1x leading to "OFF"	–	3VA9477-0GX20 <b>new</b>	3VA9477-0GX20 <b>new</b>	–	
<b>Mounting adapters for side wall mounted rotary operators</b>						
	<b>Version</b>					
	Necessary accessories for 3VA side wall mounted rotary operators, if 3VA9...-0GX.0 auxiliary switch modules are used	3VA9137-0GX01 <b>new</b>	3VA9477-0GX01 <b>new</b>	3VA9477-0GX01 <b>new</b>	–	
<b>Operating units with Bowden cable (MaxFlex operator), plastic</b>						
	<ul style="list-style-type: none"> <li>Complete set, comprising:               <ul style="list-style-type: none"> <li>Switching mechanism</li> <li>Handle, plastic</li> <li>Enclosure types 1, 3, 3R, 4, 12, 12K, black = OFF, red = ON</li> <li>Bowden cable, length 36 inch (0.9 m)</li> </ul> </li> </ul>				–	
		3VA9137-0CK12	3VA9277-0CK12	3VA9477-0CK12	–	
<b>Operating units with Bowden cable (MaxFlex operator), steel</b>						
	<ul style="list-style-type: none"> <li>Complete set, comprising:               <ul style="list-style-type: none"> <li>Switching mechanism</li> <li>Handle, steel, epoxy-coated</li> <li>Enclosure types 1, 3, 3R, 4, 12, 12K, black = OFF, red = ON</li> <li>Bowden cable, length 36 inch (0.9 m)</li> </ul> </li> </ul>				–	
		3VA9137-0CK72	3VA9277-0CK72	3VA9447-0CK72	3VA9677-0CK72	
<b>Switching mechanisms for operating unit with Bowden cable</b>						
		3VA9137-0CB10	3VA9277-0CB10	3VA9477-0CB10	3VA9677-0CB10	
<b>Handles for operating unit with Bowden cable</b>						
	<b>Handle</b>	<b>Enclosure types</b>	<b>OFF</b>	<b>ON</b>		
	Plastic	1, 3, 3R, 4, 12, 12K	Black	Red	3VA9977-0CH12	–
	Steel, epoxy-coated	1, 3, 3R, 4, 12, 12K	Black	Red	3VA9977-0CH72	3VA9877-0CH72
			Black	Black	3VA9977-0CH74	3VA9877-0CH74
Stainless steel, chrome-plated	1, 2, 3, 3R, 4, 4X, 12, 12K, 13	Black	Red	3VA9977-0CH82	3VA9877-0CH82	
		Black	Black	3VA9977-0CH84	–	
<b>Bowden cables for operating unit with Bowden cable</b>						
	<b>Length</b>					
	36 inch (0.9 m)		3VA9278-0CC10	3VA9578-0CC10	–	
	48 inch (1.2 m)		3VA9278-0CC20	3VA9578-0CC20	3VA9877-0CC20	
	60 inch (1.5 m)		3VA9278-0CC30	3VA9578-0CC30	3VA9877-0CC30	
	72 inch (1.8 m)		3VA9278-0CC40	3VA9578-0CC40	3VA9877-0CC40	
	84 inch (2.1 m)		3VA9278-0CC50	3VA9578-0CC50	–	
	96 inch (2.4 m)		3VA9278-0CC60	3VA9578-0CC60	3VA9877-0CC60	
	120 inch (3.0 m)		3VA9278-0CC70	3VA9578-0CC70	3VA9877-0CC70	
144 inch (3.6 m)		3VA9278-0CC80	3VA9578-0CC80	3VA9877-0CC80		


				3VA51	3VA62	3VA64	3VA53	3VA54	3VA55
<b>Auxiliary switches for operating unit with Bowden cable</b>									
<ul style="list-style-type: none"> <li>Leading from ON to OFF</li> </ul>									
<b>Variants</b>									
1 CO contact									
3VA9478-OCX10									
2 CO contacts									
3VA9478-OCX20									
<b>Operating units with linkage</b>									
<ul style="list-style-type: none"> <li>Complete set, comprising: <ul style="list-style-type: none"> <li>Switching mechanism</li> <li>Handle</li> </ul> </li> <li>For mounting depths 200 to 400 mm</li> </ul>									
<b>Handle</b>	<b>Enclosure types</b>	<b>OFF</b>	<b>ON</b>						
Steel, epoxy-coated	1, 12, 3R	Black	Red	3VA9138-ODK72	3VA9278-ODK72	3VA9478-ODK72			–
Steel, chrome-plated	4/4X	Black	Red	3VA9138-ODK82	3VA9278-ODK82	3VA9478-ODK82			–
		Black	Black	3VA9138-ODK84	3VA9278-ODK84	3VA9478-ODK84			–

# Motor operators


For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2


## Motor operators without stored energy operators (MO320)

	Addressable via control signals	Isolating features in accordance with IEC/EN 60947-1	Make time, typically		Break time, typically		Rated operational power
			for 3VA5	for 3VA6	for 3VA5	for 3VA6	
	■	■	800 ... 1700 ms	1000 ... 1700 ms	800 ... 1400 ms	800 ... 1400 ms	250 W, max. 500 W (60 ms)

## Motor operator with stored energy operator (SEO520)

	Addressable via control signals	Isolating features in accordance with IEC/EN 60947-1	Make time, typically		Break time, typically		Rated operational power
			for 3VA5	for 3VA6	for 3VA5	for 3VA6	
	■	■	< 80 ms	< 80 ms	< 80 ms	< 80 ms	300 W, max. 500 W (60 ms)


## Mechanical operating cycles counters (for installation in the SEO520)

	Mounting	Article No.
		For installation in the SEO520

## Cylinder lock adapters for SEO520

	Mounting	Article No.
		For installation of cylinder locks in the SEO520

## Cylinder locks (type RONIS)

	Key	Article No.
		<ul style="list-style-type: none"> <li>Includes a lock with 2 keys</li> <li>For locking the operating mode (Manual/Auto/Lock) of the SEO520</li> </ul>
	1	3VA9980-0VL10
	3	3VA9980-0VL30
	4	3VA9980-0VL40

				3VA53	
			3VA52	3VA54	3VA55
			3VA61	3VA63	3VA65
	3VA51	3VA62	3VA64		3VA66

Rated control supply voltage	With communication				
24 ... 60 V DC	–	3VA9137-0HA10	3VA9277-0HA10	3VA9447-0HA10	–
110 ... 230 V AC / 110 ... 250 V DC	–	3VA9137-0HA20	3VA9277-0HA20	3VA9447-0HA20	–

Rated control supply voltage	With communication				
24 V DC	–	–	3VA9277-0HC10	–	–
42 ... 60 V AC/DC	–	–	3VA9277-0HC20	–	–
110 ... 230 V AC / 110 ... 250 V DC	–	–	3VA9277-0HC30	–	–
24 V DC	Yes	–	3VA9277-0HC15	–	–
110 ... 230 V AC / 110 ... 250 V DC	–	–	3VA9277-0HC35	–	–



## Reset mode

### All motor operators have the following reset modes:

- Reset mode 1: Automatic reset
- Reset mode 2: Reset via OFF-signal

### The motor operator with SEO520 stored energy operator additionally has:

- Reset mode 3: Reset via OFF-signal with additional acknowledge signal

# Connection technology



- ① For mounting onto the circuit breaker  
② For mounting onto draw-out and plug-in units

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

## Box terminals

	Number of poles	Connection options		Scope of supply	Copper cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	②	3 single terminals	AWG 14	3/0
					AWG 10	3/0
					AWG 4	350 kcmil
					1/0	500 kcmil
	4P	①	②	4 single terminals	AWG 14	3/0
					AWG 10	3/0
					AWG 4	350 kcmil
					1/0	500 kcmil

## Box terminal with control wire tap

	Number of poles	Connection options		Scope of supply	Copper cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	②	3 single terminals	AWG 14	3/0
					AWG 10	3/0
					AWG 4	350 kcmil
					1/0	500 kcmil
	4P	①	②	4 single terminals	AWG 14	3/0
					AWG 10	3/0
					AWG 4	350 kcmil
					1/0	500 kcmil

## Nut keeper kits

	Number of poles	Connection options		Scope of supply	Max. tap width			Max. tap thickness
		①	②					
	3P	①	②	3 single terminals	17 mm	0.66 inch	6.5 mm	
					25 mm	0.98 inch	8 mm	
					35 mm	1.37 inch	10 mm	
					50 mm	1.96 inch	28 mm	
	4P	①	②	4 single terminals	17 mm	0.66 inch	6.5 mm	
					25 mm	0.98 inch	8 mm	
					35 mm	1.37 inch	10 mm	
					50 mm	1.96 inch	28 mm	

## Circular conductor terminals, 1 cable

	Number of poles	Connection options		Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	②	3 single terminals	AWG 14	AWG 8
					AWG 14	1/0
					AWG 8	3/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil
	4P	①	②	4 single terminals	AWG 14	AWG 8
					AWG 14	1/0
					AWG 8	3/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil

<sup>1)</sup> Maximum current-carrying capacity of cable connection 400 A  
Flexible copper bar: No restrictions

<sup>2)</sup> Maximum current-carrying capacity of copper cables 380 A  
Maximum current-carrying capacity of aluminum cables 310 A



3VA51		3VA52		3VA61		3VA62		3VA53	3VA54	3VA55	
3VA51		3VA52		3VA61		3VA62		3VA63	3VA64	3VA65	
3VA51		3VA52		3VA61		3VA62		3VA63	3VA64	3VA65	
3VA51		3VA52		3VA61		3VA62		3VA63	3VA64	3VA65	
3VA9133-OJA11	-	-	-	-	-	-	-	-	-	-	-
-	3VA9233-OJA11	3VA9143-OJA12	3VA9243-OJA12	3VA9143-OJA12	3VA9243-OJA12	-	-	-	-	-	-
-	3VA9233-OJA12	3VA9143-OJA12	3VA9243-OJA12	3VA9143-OJA12	3VA9243-OJA12	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9473-OJA13 <sup>1)</sup>	-	-	-
3VA9134-OJA11	-	-	-	-	-	-	-	-	-	-	-
-	3VA9234-OJA11	3VA9144-OJA12	3VA9244-OJA12	3VA9144-OJA12	3VA9244-OJA12	-	-	-	-	-	-
-	3VA9234-OJA12	3VA9144-OJA12	3VA9244-OJA12	3VA9144-OJA12	3VA9244-OJA12	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9474-OJA13 <sup>1)</sup>	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-
-	3VA9233-OJH11	3VA9143-OJH12	3VA9243-OJH12	3VA9143-OJH12	3VA9243-OJH12	-	-	-	-	-	-
-	3VA9233-OJH12	3VA9143-OJH12	3VA9243-OJH12	3VA9143-OJH12	3VA9243-OJH12	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9473-OJH13	-	-	-
-	-	-	-	-	-	-	-	-	-	-	-
-	3VA9234-OJH11	3VA9144-OJH12	3VA9244-OJH12	3VA9144-OJH12	3VA9244-OJH12	-	-	-	-	-	-
-	3VA9234-OJH12	3VA9144-OJH12	3VA9244-OJH12	3VA9144-OJH12	3VA9244-OJH12	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9474-OJH13	-	-	-
3VA9133-OQA00	-	-	-	-	-	-	-	-	-	-	-
-	3VA9233-OQA00	3VA9143-OQA00	3VA9243-OQA00	3VA9143-OQA00	3VA9243-OQA00	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9473-OQA00	-	-	-
-	-	-	-	-	-	-	-	-	-	3VA9673-OQA00	-
3VA9134-OQA00	-	-	-	-	-	-	-	-	-	-	-
-	3VA9234-OQA00	3VA9144-OQA00	3VA9244-OQA00	3VA9144-OQA00	3VA9244-OQA00	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9474-OQA00	-	-	-
-	-	-	-	-	-	-	-	-	-	3VA9674-OQA00	-
3VA9133-OJB10	-	-	-	-	-	-	-	-	-	-	-
-	3VA9233-OJB11	3VA9143-OJB11	3VA9243-OJB11	3VA9143-OJB11	3VA9243-OJB11	-	-	-	-	-	-
3VA9133-OJB11	-	-	-	-	-	-	-	-	-	-	-
-	3VA9233-OJB12	3VA9143-OJB12	3VA9243-OJB12	3VA9143-OJB12	3VA9243-OJB12	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9373-OJB13 <sup>2)</sup>	-	-	-
3VA9134-OJB10	-	-	-	-	-	-	-	-	-	-	-
-	3VA9234-OJB11	3VA9144-OJB11	3VA9244-OJB11	3VA9144-OJB11	3VA9244-OJB11	-	-	-	-	-	-
3VA9134-OJB11	-	-	-	-	-	-	-	-	-	-	-
-	3VA9234-OJB12	3VA9144-OJB12	3VA9244-OJB12	3VA9144-OJB12	3VA9244-OJB12	-	-	-	-	-	-
-	-	-	-	-	-	-	-	3VA9374-OJB13 <sup>2)</sup>	-	-	-

# Connection technology



- ① For mounting onto the circuit breaker  
② For mounting onto draw-out and plug-in units


For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2


## Circular conductor terminals with control wire taps, 1 cable

	Number of poles	Connection options		Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	②	3 single terminals	AWG 14	AWG 8
					AWG 14	1/0
					AWG 8	3/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil
	4P	①	②	4 single terminals	AWG 14	AWG 8
					AWG 14	1/0
					AWG 8	3/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil

## Copper circular conductor terminals, 1 cable

	Number of poles	Connection options		Scope of supply	Copper cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	②	3 single terminals	AWG 14	AWG 8
					AWG 14	2/0
					AWG 14	1/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil
	4P	①	②	4 single terminals	AWG 14	AWG 8
					AWG 14	2/0
					AWG 14	1/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil

## Copper circular conductor terminals with control wire taps, 1 cable

	Number of poles	Connection options		Scope of supply	Copper cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	②	3 single terminals	AWG 14	AWG 8
					AWG 14	2/0
					AWG 14	1/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil
	4P	①	②	4 single terminals	AWG 14	AWG 8
					AWG 14	2/0
					AWG 14	1/0
					AWG 6	350 kcmil
					AWG 1	600 kcmil

## Control wire taps for busbars



Version  
Fixed-mounted

	3VA51	3VA52	3VA61 3VA62	3VA53 3VA54 3VA63 3VA64	3VA55 3VA65 3VA66
3VA9133-OJG10		–	–	–	–
–		3VA9233-OJG11 <b>new</b>	3VA9143-OJG11	–	–
3VA9133-OJG11		–	–	–	–
–		3VA9233-OJG12	3VA9243-OJG12	–	–
–		–	–	3VA9373-OJG13	–
3VA9134-OJG10		–	–	–	–
–		3VA9234-OJG11 <b>new</b>	3VA9144-OJG11	–	–
3VA9134-OJG11		–	–	–	–
–		3VA9234-OJG12	3VA9244-OJG12	–	–
–		–	–	3VA9374-OJG13	–
3VA9133-OJD10		–	–	–	–
3VA9133-OJD11		–	–	–	–
–		3VA9233-OJD11 <b>new</b>	3VA9143-OJD11	–	–
–		3VA9233-OJD12	3VA9243-OJD12	–	–
–		–	–	3VA9373-OJD13	–
3VA9134-OJD10		–	–	–	–
3VA9134-OJD11		–	–	–	–
–		3VA9234-OJD11 <b>new</b>	3VA9144-OJD11	–	–
–		3VA9234-OJD12	3VA9244-OJD12	–	–
–		–	–	3VA9374-OJD13	–
3VA9133-OJK10		–	–	–	–
3VA9133-OJK11		–	–	–	–
–		3VA9233-OJK11 <b>new</b>	3VA9143-OJK11	–	–
–		3VA9233-OJK12	3VA9243-OJK12	–	–
–		–	–	3VA9373-OJK13	–
3VA9134-OJK10		–	–	–	–
3VA9134-OJK11		–	–	–	–
–		3VA9234-OJK11	3VA9144-OJK11	–	–
–		3VA9234-OJK12	3VA9244-OJK12	–	–
–		–	–	3VA9374-OJK13	–
–		3VA9270-0WC00		3VA9470-0WC00	–

# Connection technology



- ① For mounting onto the circuit breaker
- ② For mounting onto draw-out and plug-in units

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

## Note:

All bus connectors extended, bus connectors and rear connections are Cu/Sn 6 r plated according to ISO 2093

### Front bus connectors extended, with insulating plate, with phase barriers

- 3-pole and 4-pole front bus connectors extended only permitted if used with phase barriers and insulating plate!
- Insulating plate is included in the connection technology scope of supply or can be ordered as a spare part (3VA9...-0W..0).
- Phase barriers are included in the connection technology scope of supply or can be ordered as a spare part (3VA9...-WA00).

Number of poles	Connection options		Scope of supply	Max. tap width		Max. tap thickness	
	①	②					
3P	①	②	3 single terminals, 2 phase barriers, 1 insulating plate	22 mm	0.9 inch	8 mm	0.3 inch
4P	①	②	4 single terminals, 3 phase barriers, 1 insulating plate	22 mm	0.9 inch	8 mm	0.3 inch



### Front bus connectors offset, with insulating plate

- 3-pole and 4-pole front bus connectors extended only permitted if used with phase barriers!
- Insulating plate is included in the connection technology scope of supply or can be ordered as a spare part (3VA9...-0W..0).


Number of poles	Connection options		Scope of supply	Max. tap width		Max. tap thickness	
	①	②					
1P	①	–	1 busbar connection piece	22 mm	0.9 inch	8 mm	0.3 inch
3P	①	②	3 single terminals, 1 insulating plate	32 mm	1.3 inch	10 mm	0.4 inch
				40 mm	1.6 inch	12.5 mm	0.5 inch
4P	①	②	4 single terminals, 1 insulating plate	32 mm	1.3 inch	10 mm	0.4 inch
				40 mm	1.6 inch	12.5 mm	0.5 inch



### Front bus connectors extended, with phase barriers

- 3-pole and 4-pole front bus connectors offset only permitted if used with phase barriers!
- Phase barriers are included in the connection technology scope of supply or can be ordered as a spare part (3VA9...-WA00).

Number of poles	Connection options		Scope of supply	Max. tap width		Max. tap thickness	
	①	②					
3P	①	②	3 single terminals, 2 phase barriers	50.8 mm	2.0 inch	15.9 mm	0.63 inch
4P	①	②	4 single terminals, 3 phase barriers	50.8 mm	2.0 inch	15.9 mm	0.63 inch



						3VA55
			3VA53	3VA61	3VA63	3VA65
3VA51	3VA52	3VA54	3VA62	3VA64		3VA66

3VA9133-QQB00	-	-	-	-	-	-
3VA9134-QQB00	-	-	-	-	-	-
3VA9131-QQB00	-	-	-	-	-	-
-	3VA9273-QQB00	-	3VA9273-QQB00	-	-	-
-	-	3VA9473-QQB00	-	3VA9473-QQB00	-	-
-	-	-	3VA9274-QQB00	-	-	-
-	-	3VA9474-QQB00	-	3VA9474-QQB00	-	-
-	-	-	-	-	-	3VA9673-QQB00 <b>new</b>
-	-	-	-	-	-	3VA9674-QQB00 <b>new</b>

# Connection technology



For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

## Note:

All bus connectors extended, bus connectors and rear connections are Cu/Sn 6 r plated according to ISO 2093

2

### Front bus connectors offset, with insulating plate


- 3-pole and 4-pole front bus connectors offset only permitted if used with insulating plate!
- Phase barriers are included in the connection technology scope of supply or can be ordered as a spare part (3VA9...-WA00).

Number of poles	Connection options		Scope of supply	Max. tap width		Max. tap thickness	
	①	②		60 mm	2.4 inch	12.5 mm	0.5 inch
3P	①	②	3 single terminals, 1 insulating plate	60 mm	2.4 inch	12.5 mm	0.5 inch
4P	①	②	4 single terminals, 1 insulating plate	60 mm	2.4 inch	12.5 mm	0.5 inch

### Front bus connectors offset, with phase barriers

- 3-pole and 4-pole front bus connectors extended only permitted if used with phase barriers!
- Phase barriers are included in the connection technology scope of supply or can be ordered as a spare part (3VA9...-WA00).

Number of poles	Connection options		Scope of supply	Max. tap width		Max. tap thickness	
	①	②		60 mm	2.4 inch	12.5 mm	0.5 inch
3P	①	②	3 single terminals, 2 phase barriers	60 mm	2.4 inch	12.5 mm	0.5 inch
4P	①	②	4 single terminals, 3 phase barriers	60 mm	2.4 inch	12.5 mm	0.5 inch



3VA51	3VA52	3VA53 3VA54	3VA61 3VA62	3VA63 3VA64	3VA55 3VA65 3VA66
-	-	3VA9473-0QC00	-	3VA9473-0QC00	-
-	-	3VA9474-0QC00	-	3VA9474-0QC00	-
-	-	-	-	-	3VA9673-0QC00
-	-	-	-	-	3VA9674-0QC00

# Connection technology



- ① For mounting onto the circuit breaker  
② For mounting onto draw-out and plug-in units




For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

## Note:




All bus connectors extended, bus connectors and rear connections are Cu/Sn 6 r plated according to ISO 2093

2




### Rear connection studs flat

	Number of poles	Connection options		Scope of supply
		①	②	
	1P	①	②	1 short connection stud flat 1 long connection stud flat
	3P	①	②	2 short connection studs flat, 1 long connection stud flat
	4P	①	②	2 short connection studs flat, 2 long connection studs flat

### Rear connection studs round

	Number of poles	Connection options		Scope of supply
		①	②	
	1P	①	②	1 short connection stud round 1 long connection stud round
	3P	①	②	1 long connection stud round, 2 short connection studs round
	4P	①	②	2 long connection studs round, 2 short connection studs round

### Circular conductor terminals, large, 1 cable

	Number of poles	Connection options		Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
		①	–		Min.	Max.
	1P	①	–	2 single terminals, 1 extended terminal cover	AWG 4	300 kcmil
	3P	①	–	3 single terminals, 1 extended terminal cover	AWG 4 AWG 2	300 kcmil 350 kcmil
	4P	①	–	4 single terminals, 1 extended terminal cover	AWG 4 AWG 2	300 kcmil 350 kcmil



3VA51	3VA52	3VA53 3VA54	3VA61 3VA62	3VA63 3VA64	3VA55 3VA65 3VA66
3VA9131-0QE10	3VA9231-0QE10	3VA9471-0QE10	3VA9241-0QE10	3VA9471-0QE10	–
3VA9131-0QE20	3VA9231-0QE20	3VA9471-0QE20	3VA9241-0QE20	3VA9471-0QE20	–
3VA9133-0QE00	3VA9233-0QE00	3VA9473-0QE00	3VA9243-0QE00	3VA9473-0QE00	–
3VA9134-0QE00	3VA9234-0QE00	3VA9474-0QE00	3VA9244-0QE00	3VA9474-0QE00	–
3VA9131-0QF10	3VA9231-0QF10	3VA9471-0QF10	3VA9241-0QF10	3VA9471-0QF10	–
3VA9131-0QF20	3VA9231-0QF20	3VA9471-0QF20	3VA9241-0QF20	3VA9471-0QF20	–
3VA9133-0QF00	3VA9233-0QF00	3VA9473-0QF00	3VA9243-0QF00	3VA9473-0QF00	–
3VA9134-0QF00	3VA9234-0QF00	3VA9474-0QF00	3VA9244-0QF00	3VA9474-0QF00	–
3VA9132-0JJ12	–	–	–	–	–
3VA9133-0JJ12	–	–	–	–	–
–	3VA9233-0JJ13	–	3VA9243-0JJ13	–	–
3VA9134-0JJ12	–	–	–	–	–
–	3VA9234-0JJ13	–	3VA9244-0JJ13	–	–

# Connection technology






- ❶ For mounting onto the circuit breaker
- ❷ For mounting onto draw-out and plug-in units







For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

## Circular conductor terminals, large with control wire taps, 1 cable

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	2P	❶ –	2 single terminals, 1 extended terminal cover	AWG 4	300 kcmil
	3P	❶ –	3 single terminals, 1 extended terminal cover	AWG 4 AWG 2	300 kcmil 350 kcmil
	4P	❶ –	4 single terminals, 1 extended terminal cover	AWG 4 AWG 2	300 kcmil 350 kcmil

## Circular conductor terminals, 2 cables

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	3P	❶ –	3 single terminals, 1 extended terminal cover	AWG 4 2/0	300 kcmil 600 kcmil
	3P	❶ –	3 single terminals, 1 medium terminal cover	400 kcmil	750 kcmil
	3P	❶ –	3 single terminals, 1 short terminal cover	4/0	600 kcmil
	4P	❶ –	4 single terminals, 1 extended terminal cover	AWG 4 2/0	300 kcmil 600 kcmil
	4P	❶ –	4 single terminals, 1 medium terminal cover	400 kcmil	750 kcmil
	4P	❶ –	4 single terminals, 1 short terminal cover	4/0	600 kcmil

	3VA51	3VA52	3VA53 3VA54	3VA61 3VA62	3VA63 3VA64	3VA55 3VA65 3VA66
3VA9132-0JC12		–	–	–	–	–
3VA9133-0JC12		–	–	–	–	–
–		3VA9233-0JC13	–	3VA9243-0JC13	–	–
3VA9134-0JC12		–	–	–	–	–
–		3VA9234-0JC13	–	3VA9244-0JC13	–	–
–		3VA9233-0JJ22	–	3VA9243-0JJ22	–	–
–		–	3VA9473-0JJ23	–	3VA9473-0JJ23	–
–		–	–	–	–	3VA9673-0JJ24
–		–	–	–	–	3VA9573-0JB23 <b>new</b>
–		3VA9234-0JJ22	–	3VA9244-0JJ22	–	–
–		–	3VA9474-0JJ23	–	3VA9474-0JJ23	–
–		–	–	–	–	3VA9674-0JJ24
–		–	–	–	–	3VA9574-0JB23 <b>new</b>

# Connection technology



- ① For mounting onto the circuit breaker  
② For mounting onto draw-out and plug-in units

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2

## Circular conductor terminals with control wire taps, 2 cables

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	3P	① –	3 single terminals, 1 extended terminal cover	AWG 4 2/0	300 kcmil 600 kcmil
			3 Einzelklemmen, 1 medium terminal cover	400 kcmil	750 kcmil
	3P	① –	3 Einzelklemmen, 1 short terminal cover	4/0	600 kcmil
	4P	① –	4 single terminals, 1 extended terminal cover	AWG 4 2/0	300 kcmil 600 kcmil
			4 single terminals, 1 medium terminal cover	400 kcmil	750 kcmil
	4P	① –	4 single terminals, 1 short terminal cover	4/0	600 kcmil

## Circular conductor terminals, 3 cables

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	3P	① –	3 single terminals, 1 short terminal cover	4/0	400 kcmil
			3 single terminals, 1 long terminal cover	500 kcmil	750 kcmil
	4P	① –	4 single terminals, 1 short terminal cover	4/0	400 kcmil
			4 single terminals, 1 long terminal cover	500 kcmil	750 kcmil

	3VA51	3VA52	3VA53 3VA54	3VA61 3VA62	3VA63 3VA64	3VA55 3VA65 3VA66
	–	3VA9233-0JC22	–	3VA9243-0JC22	–	–
	–	–	3VA9473-0JC23	–	3VA9473-0JC23	–
	–	–	–	–	–	3VA9673-0JC24
	–	–	–	–	–	3VA9573-0JG23 <b>new</b>
	–	3VA9234-0JC22	–	3VA9244-0JC22	–	–
	–	–	3VA9474-0JC23	–	3VA9474-0JC23	–
	–	–	–	–	–	3VA9674-0JC24
	–	–	–	–	–	3VA9574-0JG23 <b>new</b>
	–	–	–	–	–	3VA9673-0JB32
	–	–	–	–	–	3VA9673-0JJ34 <b>new</b>
	–	–	–	–	–	3VA9674-0JB32
	–	–	–	–	–	3VA9674-0JJ34 <b>new</b>

# Connection technology









- ① For mounting onto the circuit breaker  
② For mounting onto draw-out and plug-in units





For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2





## Circular conductor terminals with control wire taps, 3 cables

	Number of poles	Connection options		Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	–	3 single terminals, 1 short terminal cover	4/0	400 kcmil
	3P	①	–	3 single terminals, 1 extended terminal cover	500 kcmil	750 kcmil
					4/0	400 kcmil
	4P	①	–	4 single terminals, 1 short terminal cover	4/0	400 kcmil
	4P	①	–	4 single terminals, 1 extended terminal cover	500 kcmil	750 kcmil
					4/0	400 kcmil

## Circular conductor terminals, 4 cables

	Number of poles	Connection options		Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	–	3 Einzelklemmen, 1 medium terminal cover	4/0	500 kcmil
				3 single terminals, 1 extended terminal cover	4/0	600 kcmil
	4P	①	–	4 single terminals, 1 medium terminal cover	4/0	500 kcmil
				4 single terminals, 1 extended terminal cover	4/0	600 kcmil

## Circular conductor terminals with control wire taps, 4 cables

	Number of poles	Connection options		Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
		①	②		Min.	Max.
	3P	①	–	3 Einzelklemmen, 1 medium terminal cover	4/0	500 kcmil
				3 single terminals, 1 extended terminal cover	4/0	600 kcmil
	4P	①	–	4 single terminals, 1 medium terminal cover	4/0	500 kcmil
				4 single terminals, 1 extended terminal cover	4/0	600 kcmil

3VA51		3VA52		3VA53 3VA54		3VA61 3VA62		3VA63 3VA64		3VA55 3VA65 3VA66	
-	-	-	-	-	-	-	-	-	-	3VA9673-0JG32	
-	-	-	-	-	-	-	-	-	-	3VA9673-0JC34 <b>new</b>	
-	-	-	-	-	-	-	-	-	-	3VA9674-0JG32	
-	-	-	-	-	-	-	-	-	-	3VA9674-0JC34 <b>new</b>	
-	-	-	-	-	-	-	-	-	-	3VA9673-0JJ43	
-	-	-	-	-	-	-	-	-	-	3VA9673-0JJ44 <b>new</b>	
-	-	-	-	-	-	-	-	-	-	3VA9674-0JJ43	
-	-	-	-	-	-	-	-	-	-	3VA9674-0JJ44 <b>new</b>	
-	-	-	-	-	-	-	-	-	-	3VA9673-0JC43	
-	-	-	-	-	-	-	-	-	-	3VA9673-0JC44 <b>new</b>	
-	-	-	-	-	-	-	-	-	-	3VA9674-0JC43	
-	-	-	-	-	-	-	-	-	-	3VA9674-0JC44 <b>new</b>	

# Connection technology






- ① For mounting onto the circuit breaker
- ② For mounting onto draw-out and plug-in units



For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2



## Circular conductor terminals, 6 cables

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	2P	① –	2 single terminals, 1 extended terminal cover	AWG 14	AWG 2
	3P	① –	3 single terminals, 1 extended terminal cover	AWG 14	AWG 2
	4P	① –	4 single terminals, 1 extended terminal cover	AWG 14	AWG 2

## Copper circular conductor terminals, 2 cables

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	3P	① –	3 single terminals, 1 extended terminal cover	2/0	600 kcmil
	4P	① –	4 single terminals, 1 extended terminal cover	2/0	600 kcmil

## Copper circular conductor terminals with control wire taps, 2 cables

	Number of poles	Connection options	Scope of supply	Copper/aluminum cable cross-section, stranded, class B	
				Min.	Max.
	3P	① –	3 single terminals, 1 extended terminal cover	2/0	600 kcmil
	4P	① –	4 single terminals, 1 extended terminal cover	2/0	600 kcmil



	3VA51	3VA52	3VA53 3VA54	3VA61 3VA62	3VA63 3VA64	3VA55 3VA65 3VA66
3VA9132-0JF60		–	–	–	–	–
3VA9133-0JF60		3VA9233-0JF60	–	3VA9243-0JF60	3VA9373-0JF60	–
3VA9134-0JF60		3VA9234-0JF60	–	3VA9244-0JF60	3VA9374-0JF60	–
–	–	–	3VA9473-0JE23	–	3VA9473-0JE23	–
–	–	–	3VA9474-0JE23	–	3VA9474-0JE23	–
–	–	–	3VA9473-0JL23	–	3VA9473-0JL23	–
–	–	–	3VA9474-0JL23	–	3VA9474-0JL23	–

# Connection technology



- ① For mounting onto the circuit breaker  
② For mounting onto draw-out and plug-in units

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

2



3VA51

## Terminal covers for fixed mounting, plug-in and draw-out units

	Version	Number of poles	Mounting location			
	Short	1P	①	–	–	3VA9671-0WF20
		3P	①	–	–	3VA9131-0WD10
		4P	①	–	–	3VA9131-0WD30
	Intermediate <sup>1)</sup>	3P	①	–	–	3VA9131-0WD40
		4P	①	–	–	–
	Extended	2P	①	–	–	–
		3P	①	–	–	3VA9131-0WF20
		4P	①	–	–	3VA9131-0WF30
	Broadened	3P	①	–	–	3VA9131-0WF40
		4P	①	–	–	–

## Terminal covers for plug-in and draw-out units (spare part)


- To provide circuit breaker touch protection
- For mounting to the molded case circuit breaker

	Number of poles	
	3P	–
	4P	–

## Insulating plates specially for fixed mounting

	Version	Number of poles	Mounting location			
	Standard	2P	①	–	–	3VA9131-0WJ20
		3P	①	–	–	3VA9131-0WJ30
		4P	①	–	–	3VA9131-0WJ40
	Broadened	3P	①	–	–	–
		4P	①	–	–	–

## Phase barriers for fixed mounting, plug-in and draw-out units

	Scope of supply	
	2 phase barriers	3VA9132-0WA00

<sup>1)</sup> Suitable for circular conductor terminals 2/3/4 cables

	3VA61	3VA53	3VA63	3VA55
3VA52	3VA62	3VA54	3VA64	3VA65
				3VA66
–	–	–	–	–
3VA9271-0WD30	3VA9271-0WD30	3VA9471-0WD30	3VA9471-0WD30	3VA9671-0WD30
3VA9271-0WD40	3VA9271-0WD40	3VA9471-0WD40	3VA9471-0WD40	3VA9671-0WD40
–	–	–	–	3VA9671-0WE30
–	–	–	–	3VA9671-0WE40
–	–	–	–	–
3VA9271-0WF30	3VA9271-0WF30	3VA9471-0WF30	3VA9471-0WF30	3VA9671-0WF30 <b>new</b>
3VA9271-0WF40	3VA9271-0WF40	3VA9471-0WF40	3VA9471-0WF40	3VA9671-0WF40 <b>new</b>
–	–	3VA9471-0WG30	3VA9471-0WG30	–
–	–	3VA9471-0WG40	3VA9471-0WG40	–
–	3VA9143-0KB01	–	3VA9343-0KB01	–
–	3VA9144-0KB01	–	3VA9344-0KB01	–
–	–	–	–	–
3VA9271-0WJ30	3VA9271-0WJ30	3VA9471-0WJ30	3VA9471-0WJ30	–
3VA9271-0WJ40	3VA9271-0WJ40	3VA9471-0WJ40	3VA9471-0WJ40	–
–	–	3VA9471-0WK30	3VA9471-0WK30	–
–	–	3VA9471-0WK40	3VA9471-0WK40	–
3VA9272-0WA00	3VA9272-0WA00	3VA9472-0WA00	3VA9472-0WA00	3VA9672-0WA00

# Plug-in and draw-out technology

The main differences between plug-in units and draw-out units are convenience of operation and the potential for functional expansion.

## Thanks to plug-in and draw-out technology:

- Molded case circuit breakers can be replaced quickly and easily for overhauls or servicing
- Electrical isolation and clearly visible isolating distance
- The socket can be interlocked to prevent the 3VA molded case circuit breaker from being plugged in or moved in
- Identical connection technology for all molded case circuit breakers, whether they are plug-in, draw-out or fixed-mounted units

## In addition, draw-out technology offers:




- Transmission of the position of the molded case circuit breaker via communication (CONNECT, TEST, DISCONNECT)
- The ability to test the auxiliary and control circuit connections in the test position of the draw-out unit, without contacted main conducting paths
- Transmission of the state of the molded case circuit breaker (ON, OFF, TRIP) via the COM060 communication module





## Note:

Plug-in and draw-out technology are only available for the 3VA6 molded case circuit breaker with electronic trip units. The plug-in and draw-out bases of circuit breaker sizes 250 A to 400 A (3VA61, 3VA62 and 3VA63) can be equipped with all available terminal types.

For circuit breaker size 600 A (3VA64), special plug-in and draw-out bases are available. Broadened connecting bars are supplied for this purpose. For temperature reasons, only this connection technology can be used for this size of circuit breaker. 100% rated breakers can never be used with plug-in or draw-out technology for temperature reasons.



For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

	3VA61	3VA62	3VA63	3VA64
<b>Draw-out units, complete kits</b>				
 <ul style="list-style-type: none"> <li>• <b>Scope of supply:</b> <ul style="list-style-type: none"> <li>– Draw-out socket</li> <li>– Draw-out unit, conversion kit</li> <li>– Mounting screw kit</li> </ul> </li> <li>• <b>Note:</b> The crank handle for the draw-out unit must be ordered separately.</li> </ul>				
	<b>Number of poles</b>			
	3P	3VA9143-OKD00		3VA9343-OKD00
4P	3VA9144-OKD00		3VA9344-OKD00	3VA9444-OKD00
<b>Draw-out units, conversion kits</b>				
 <ul style="list-style-type: none"> <li>• <b>Scope of supply:</b> <ul style="list-style-type: none"> <li>– Screw-fastened terminal covers for molded case circuit breakers</li> <li>– Side panels</li> <li>– Plug-in contacts</li> <li>– Cable cages</li> <li>– Autotrip plunger</li> </ul> </li> </ul>				
	<b>Number of poles</b>			
	3P	3VA9143-OKD10		3VA9343-OKD10
4P	3VA9344-OKD10		3VA9344-OKD10	
<b>Plug-in units, complete kits</b>				
 <ul style="list-style-type: none"> <li>• <b>Scope of supply:</b> <ul style="list-style-type: none"> <li>– Plug-in base</li> <li>– Plug-in unit, conversion kit</li> <li>– Mounting screw kit</li> </ul> </li> </ul>				
	<b>Number of poles</b>			
	3P	3VA9143-OKP00		3VA9343-OKP00
4P	3VA9144-OKP00		3VA9344-OKP00	3VA9444-OKP00

	3VA61	3VA62	3VA63	3VA64
<b>Plug-in units, conversion kits</b>				
	<ul style="list-style-type: none"> <li>• <b>Scope of supply:</b> <ul style="list-style-type: none"> <li>– Screw-fastened terminal covers for molded case circuit breakers</li> <li>– Plug-in contacts</li> <li>– Cable cages</li> <li>– Autotrip plunger</li> </ul> </li> </ul>			
	<b>Number of poles</b>			
	3P	3VA9143-OKP10	3VA9343-OKP10	
	4P	3VA9344-OKP10	3VA9344-OKP10	
<b>Cable cages for plug-in/draw-out units</b>				
	<ul style="list-style-type: none"> <li>• Cable duct for routing of the required cables from the internal accessories on the back of the circuit breaker</li> </ul>			
	<b>Number of poles</b>			
	3P/4P	3VA9167-OKB02	–	–
<b>Door feedthroughs</b>				
	<b>Number of poles</b>			
	3P/4P	3VA9147-OKT00	3VA9347-OKT00	
<b>Spare part autotrip plunger</b>				
	<b>Version</b>			
	Plug-in unit	3VA9267-OKP81	3VA9457-OKP81	3VA9457-OKP81
	Draw-out unit	3VA9267-OKD81	3VA9457-OKD81	3VA9457-OKD81

2

## Accessories

<b>Communication links for draw-out unit</b>				
	<b>Scope of supply</b>			<b>Article No.</b>
	Set of cables with three special position signaling switches, 3VA9987-OKC10 connecting cables			3VA9977-OKC00
<b>Position signaling switches for draw-out unit and plug-in unit</b>				
				<b>Article No.</b>
				3VA9977-OKB00
<b>Connecting cables</b>				
	<b>Purpose</b>			<b>Article No.</b>
	Connection of position signaling switches for communication with COM060			3VA9987-OKC10
<b>Crank handles for draw-out units</b>				
	<b>Version</b>	<b>Scope of supply</b>		<b>Article No.</b>
	Insulated	Including crank handle holder		3VA9987-OKD81
<b>Auxiliary circuit connectors</b>				
	<ul style="list-style-type: none"> <li>• Each auxiliary circuit connector is designed for 4 cables.</li> </ul>			<b>Article No.</b>
	<b>Version</b>			
	For all draw-out units			3VA9977-OKD80
	For all plug-in units			3VA9977-OKP80

# Plug-in and draw-out technology

For a complete and valid configuration of your molded case circuit breaker, please use our online configurator at [www.siemens.com/lowvoltage/3va-ul-configurator](http://www.siemens.com/lowvoltage/3va-ul-configurator)

## Cylinder locks



- **Scope of supply:**
  - 1 lock with 2 keys
- For locking or interlocking
- For installation in all rotary operators with a shaft stub
- For mounting in the adapter kit for the accessories compartment

Key	Lock number	Article No.
1	1	3VA9980-0VL10
3	3	3VA9980-0VL30
4	4	3VA9980-0VL40


## Cylinder lock adapters for draw-out units



- To prevent unauthorized withdrawal or insertion of the circuit breaker into the draw-out unit
- Circuit breaker can be locked in the CONNECT, TEST and DISCONNECT positions

Purpose	Article No.
For fitting a cylinder lock in the right-hand side wall of the draw-out unit	3VA9970-0LF40

# Communication

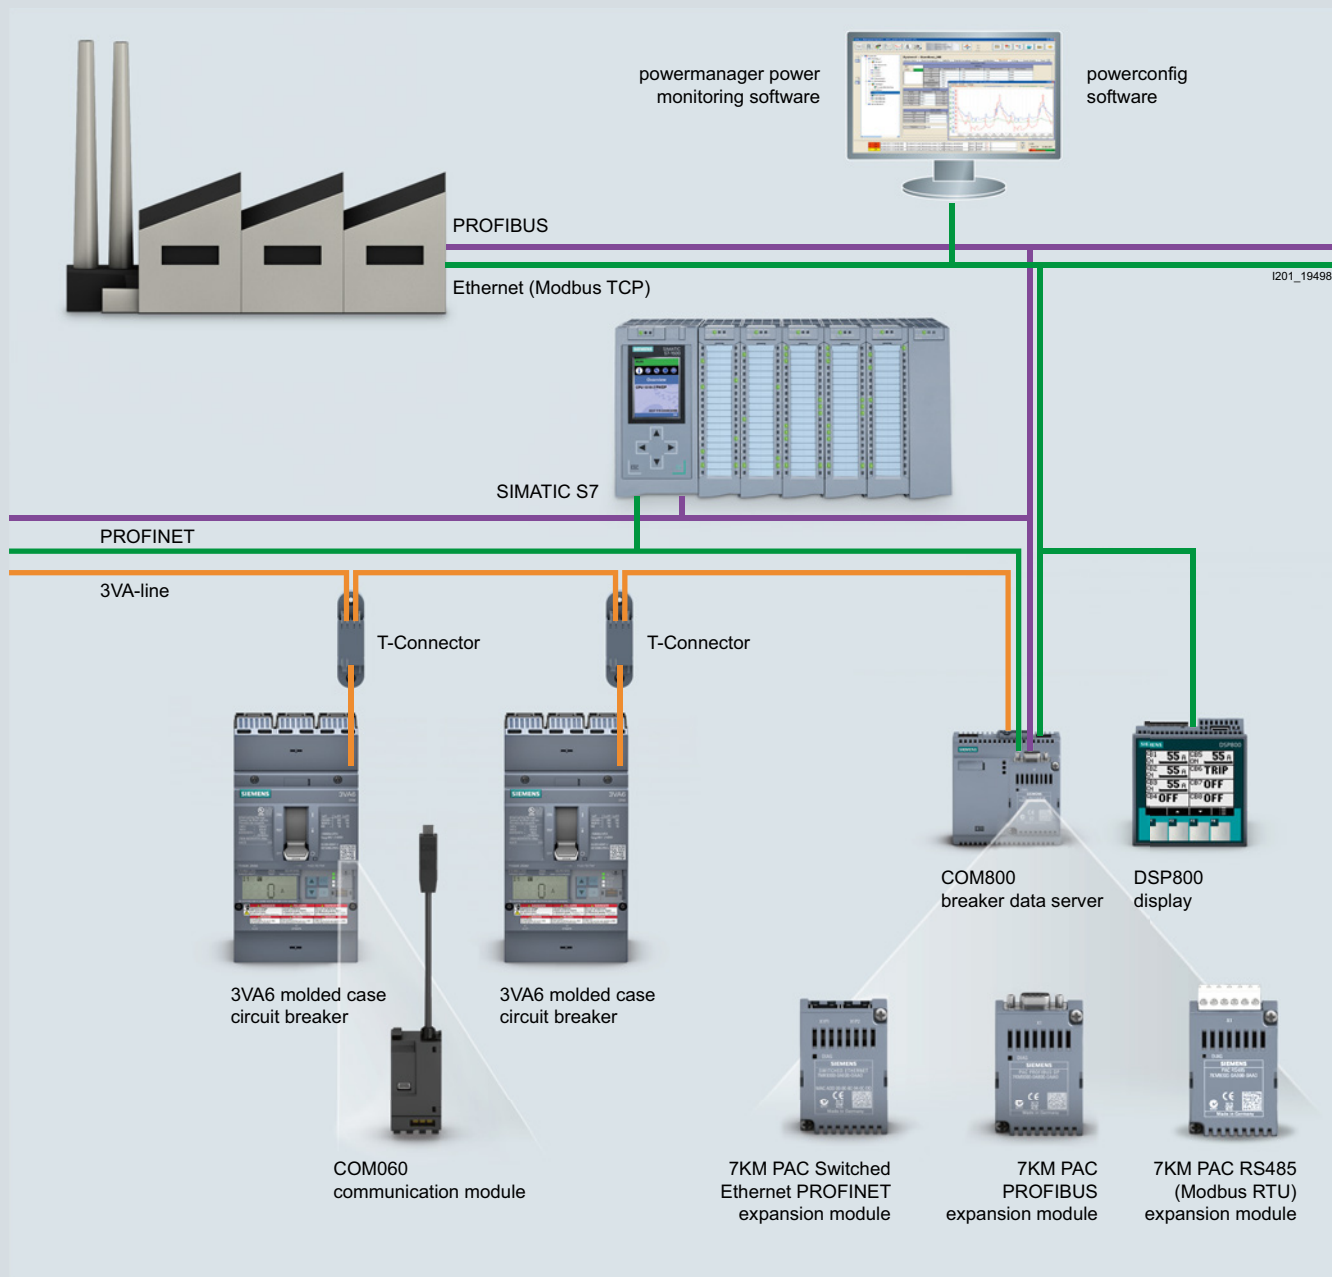

# Communication

2

Metering function <sup>1)</sup>			ETU 5-series	ETU 8-series	Display in ETU	Display DSP800	Communication COM800/ COM100
<b>Current</b>							
Phase and neutral conductor currents	$I_1, I_2, I_3, I_N$	A	■	■	□	□	■
Residual current to ground	$I_g$	A	■	■	□	□	■
Phase with highest load		A	■	■	□	□	■
Mean value over the three phase currents	$I_{\text{leading axis}} = (I_1 + I_2 + I_3)/3$	A	–	■	–	□	■
Asymmetry of the phase currents	$I_{\text{nba}}$	%	–	■	–	□	■
THD of the 3 phases	THDI <sub>1</sub> , THDI <sub>2</sub> , THDI <sub>3</sub>	%	–	■	–	□	■
<b>Voltage</b>							
Phase voltages incl. mean value	$U_{12}, U_{23}, U_{31}, U_{\text{phavg}}$	V	–	■	□	□	■
Voltages to N conductor incl. mean value	$U_{1N}, U_{2N}, U_{3N}, U_{\text{Navg}}$	V	–	■	–	□	■
Voltage unbalance		%	–	■	–	□	■
THD phase/phase and phase/N	THDI <sub>1</sub> , THDI <sub>2</sub> , THDI <sub>3</sub>	%	–	■	–	□	■
<b>Power</b>							
Active power, total and per phase	$P_1, P_2, P_3, P_{\text{tot}}$	kW	–	■	□ (P <sub>tot</sub> )	□	■
Apparent power, total and per phase	$S_1, S_2, S_3, S_{\text{tot}}$	kVA	–	■	–	□	■
Reactive power, total and per phase	$Q_1, Q_2, Q_3, Q_{\text{tot}}$	kVAr	–	■	□	□	■
Power factor of the fundamental	$P_{F1}, P_{F2}, P_{F3}, P_{F\text{avg}}$		–	■	□ (PF <sub>avg</sub> )	□	■
<b>Energy</b>							
Active energy, infeed and feedback	$E_p$	kWh	–	■	□	□	■
Reactive energy, infeed and feedback	$E_q$	kVArh	–	■	–	□	■
Apparent energy	$E_s$	kVAh	–	■	–	□	■
<b>Frequency</b>							
Present frequency	f	Hz	–	■	□	□	■
<b>Maximum pointer function</b>							
Min./max. current, voltage, power	With time stamp	–	–	–	–	–	■
<b>Condition monitoring <sup>2)</sup></b>							
Operating cycles counter	ON/OFF cycle		■	■	–	–	■
Operating hours		h	■	■	–	–	■
Trip counter	Differentiated in trip reasons		■	■	–	–	■
Health indicator <sup>3)</sup>	Incl. contact state	%	■	■	■	–	■
Remaining life time <sup>3)</sup>		Time	■	■	–	–	■

■ Available    □ Displayable    – Not available

<sup>1)</sup> Depending on ETU version

<sup>2)</sup> Only available with continuous external power supply and COM060 and COM800/100 communication interfaces

<sup>3)</sup> Firmware 4.4 or higher of ETU, COM060 and COM800/100 required

	3VA63
	3VA64
3VA61	3VA65
3VA62	3VA66

## COM060 communication modules



- For mounting in the right-hand accessories compartment of the 3VA6 molded case circuit breaker (including ETU power supply)
- Including a T-connector

### Purpose

Communication to the COM800/COM100 breaker data server via 3VA line

## 24 V modules








- 24 V DC
- For mounting in the right-hand accessories compartment of the 3VA6

### Purpose

Optional energy supply for the ETU, also includes continuous operation of the ETU display and the metering function of the ETU 8-series



## Breaker data server

COM800 breaker data servers		
	<b>Version</b> Central communication module for connection of up to eight 3VA6 molded case circuit breakers via the 3VA line, Ethernet 10/100 Mbps interface, module socket for inserting an optional PROFIBUS DP, PROFINET or RS485 module, 2 terminating resistors	<b>Article No.</b> 3VA9977-0TA10
COM100 breaker data servers		
	<b>Version</b> Central communication module for connection of a 3VA6 molded case circuit breaker via the 3VA line, Ethernet 10/100 Mbps interface, module socket for inserting an optional PROFIBUS DP, PROFINET or RS485 module, 2 terminating resistors	<b>Article No.</b> 3VA9977-0TA20
7KM PAC PROFIBUS DP expansion modules		
	<b>Purpose</b> Used for connecting the COM800/COM100 breaker data server, and the 3VA molded case circuit breakers connected to it, to PROFIBUS DPV1. Supplies the state and measured variables of the 3VA molded case circuit breaker for the PROFIBUS DP master. Receives information (e.g. commands) from the PROFIBUS DP master and transmits them to the 3VA molded case circuit breaker.	<b>Article No.</b> 7KM9300-0AB01-0AA0
7KM PAC Switched Ethernet PROFINET expansion modules		
	<b>Purpose</b> Used for connecting the COM800/COM100 breaker data server, and the connected 3VA molded case circuit breakers, to PROFINET via two Ethernet interfaces. Supplies the state and measured variables of the 3VA molded case circuit breakers to PROFINET via the PROFINET IO, PROFlenergy and Modbus TCP protocols.	<b>Article No.</b> 7KM9300-0AE02-0AA0
7KM PAC RS485 Modbus RTU expansion modules		
	<b>Purpose</b> Used for connecting the COM800/COM100 breaker data server, and the 3VA molded case circuit breakers connected to it, to Modbus RTU. Supplies the state and measured variables of the 3VA molded case circuit breaker for the Modbus RTU master. Receives information (e.g. commands) from the Modbus RTU master and transmits them to the 3VA molded case circuit breaker.	<b>Article No.</b> 7KM9300-0AM00-0AA0

# Communication

## Accessories for communication

T-connectors (spare part)			
	<b>Purpose</b>		<b>Article No.</b>
	Provides a stub connection to the COM060 and loops through to the next circuit breaker. Including connection adapter for mounting on the 3VA6 circuit breaker enclosure		3VA9987-0TG10
DIN rail adapters			
	<b>Purpose</b>		<b>Article No.</b>
	For snapping the T-connector onto a DIN rail		3VA9987-0TG11
Prefabricated connecting cables, T-connector – T-connector or T-connector – COM800/COM100			
	<b>Length</b>		<b>Article No.</b>
	0.4 m		3VA9987-0TC10
	1 m		3VA9987-0TC20
	2 m		3VA9987-0TC30
	4 m		3VA9987-0TC40
Prefabricated connecting cables for extending the COM060 – T-connector stub connection			
	<b>Length</b>		<b>Article No.</b>
	0.4 m		3VA9987-0TF20
	0.8 m		3VA9987-0TF10
Additional bus terminating resistors			
			<b>Article No.</b>
			3VA9987-0TE10
Voltage tap to external N conductors			
	<b>Purpose</b>		<b>Article No.</b>
	Cable for connection of the star point for the metering function of the 8-series ETU, length 1.5 m		3VA9987-0UC10
External current transformers as straight-through transformers			
	<b>Purpose</b>	<b>Rated current I<sub>n</sub></b>	<b>Article No.</b>
	Connection of an external current transformer for the neutral conductor for 3-pole 3VA6 molded case circuit breakers for 5-series and 8-series ETUs (ETU850, ETU856, ETU860), including connecting cables	25 ... 150 A	3VA9077-0NA10
		160 ... 350 A	3VA9177-0NA10
		400 ... 600 A	3VA9377-0NA10
		600 ... 1000 A	3VA9677-0NA10
Display			
Display DSP800 for connection to COM800/COM100			
	<b>Purpose</b>		<b>Article No.</b>
	For displaying status, measured values and parameters of up to 8 3VA6 molded case circuit breakers. Connection to the COM800/COM100 via Ethernet for displaying the information of the COM800/COM100 and the connected 3VA6 molded case circuit breakers.		3VA9977-0TD10

## External function box

### EFB300 external function boxes



- 4 digital outputs for information output
- 1 digital input
- ZSI functionality
- SO-Interface
- Including cable 1.5 m in length

#### Purpose

For connection to the ETU of 3VA6 molded case circuit breakers

#### Article No.

3VA9977-0UA10

### Connecting cables for EFB300



#### Length

1.5 m

3.0 m

#### Purpose

#### Article No.

3VA9987-0UB10

3VA9987-0UB20

## Maintenance mode box

### MMB300 maintenance mode boxes



- 2 digital outputs
- 1 digital input
- 1 3VA-line interface
- Including cable 1.5 m in length

#### Purpose

Series connection of up to eight 3VA6 molded case circuit breakers to one MMB300 maintenance mode box for activating the Dynamic Arc Sentry Mode (DAS Mode) of the molded case circuit breaker

#### Article No.

3VA9977-0UF10

## Test devices

### TD300 test devices



#### Purpose

For activation of the ETU and initiation of a test tripping operation

#### Connection

On the front interface of the ETU

#### Article No.

3VA9977-0MA10

### TD400 test devices <sup>1)</sup>



- Energy supply via batteries or the USB-C interface
- USB-C interface for connecting a PC with powerconfig
- Bluetooth interface for connection to a PC, smartphone or tablet
- ETU parameterization
- Including adapter and connecting cable to 3VA2 molded case circuit breaker and IEC 3WL (ETU Release 2)
- Including case

#### Purpose

Initiation of a test tripping operation

#### Connection

On the front interface of the ETU (3VA and IEC 3WL ETU release 2)

#### Article No.

3VW9011-0AT40

### TD500 test devices



- USB interface for connecting a PC with powerconfig
- Including external power supply
- Including connecting cable to 3VA2 molded case circuit breaker

#### Purpose

ETU parameterization  
Initiation of various test tripping operations (LSING)

#### Connection

On the front interface of the ETU

#### Article No.

3VA9977-0MB10

### External power supplies for TD500 (spare part)



#### Voltage

110 ... 240 V AC

#### Article No.

3VA9987-0MX10

### Connecting cables for connecting TD500 to 3VA6 molded case circuit breakers (spare part)



#### Article No.

3VA9977-0MY10

<sup>1)</sup> A country-specific radio license is required to operate the Bluetooth interface. Before activating the Bluetooth function, ensure that the license is available: [www.siemens.com/lowvoltage/certificates](http://www.siemens.com/lowvoltage/certificates)

# Locking, blocking and interlocking

2

		3VA51	3VA52	3VA61	3VA62
<b>Locking</b>					
<ul style="list-style-type: none"> <li>The locking provisions make it possible to lock the 3VA molded case circuit breakers in either the OFF or the ON operating position.</li> </ul>					
<b>Version</b>					
	Cylinder lock	Key 1 (lock number 1) Key 3 (lock number 3) Key 4 (lock number 4)		3VA9980-OVL10 3VA9980-OVL30 3VA9980-OVL40	
	Adapter kit for mounting the cylinder lock (type RONIS) in the accessories compartment of the molded case circuit breaker		3VA9137-0LF10	3VA9237-0LF10	3VA9147-0LF10
	Blocking device for handle		3VA9038-0LB10	3VA9378-0LB10	
<b>Interlocking</b>					
<ul style="list-style-type: none"> <li>Using interlocking technology, it is possible to mutually interlock two or more molded case circuit breakers.</li> <li>The interlock system is designed to ensure that no more than one molded case circuit breaker can be operated at a time.</li> <li>The following methods of interlocking can be used on 3VA molded case circuit breakers: <ul style="list-style-type: none"> <li>Front interlock</li> <li>Rear interlock</li> </ul> </li> </ul>					
<b>Version</b>					
	Cylinder lock	Key 1 (lock number 1) Key 3 (lock number 3) Key 4 (lock number 4)		3VA9980-OVL10 3VA9980-OVL30 3VA9980-OVL40	
	Sliding bar interlock for interlocking 2 circuit breakers		3VA9138-0VF30	3VA9238-0VF30	3VA9148-0VF30
	Module for handle interlock using a Bowden cable	One module for handle interlock is required for each switching device. A Bowden cable must be ordered separately.	3VA9137-0VF10	3VA9237-0VF10	3VA9147-0VF10
	Bowden cable	Length 0.6 m Length 1.0 m Length 1.5 m		3VA9980-OVC10 3VA9980-OVC20 3VA9980-OVC30	
	Rear interlock with rod	Circuit breaker, fixed-mounted		3VA9078-OVM10	
		Plug-in/draw-out technology		3VA9078-OVM30	
	Mounting frame for rear interlock with rod for fixed-mounted version	Profile rails (2 units)		3VA9078-OVK10	
		Mounting plate	3VA9138-OVK20	3VA9238-OVK20	3VA9248-OVK20

<sup>1)</sup> Contains mounting plate and profile rails

3VA53	
3VA54	3VA55
3VA63	3VA65
3VA64	3VA66

### Locking

Use in	Locking in OFF position	Locking in ON position	Front mounting	Rear mounting	Interlocked breakers
3VA9980-0VL10 3VA9980-0VL30 3VA9980-0VL40	■	■	■	–	0
3VA9347-0LF10 3VA9577-0LF10	■	■	■	–	–
3VA9378-0LB10 3VA9578-0LB10	■	■	■	–	0


### Interlocking

Use in	Locking in OFF position	Locking in ON position	Front mounting	Rear mounting	Interlocked breakers
3VA9980-0VL10 3VA9980-0VL30 3VA9980-0VL40	■	■	■	–	0
3VA9348-0VF30	–	–	■	–	3
3VA9347-0VF10 3VA9577-0VF10	–	–	■	–	3
3VA9980-0VC10 3VA9980-0VC20 3VA9980-0VC30					
3VA9078-0VM10 3VA9578-0VM10 <sup>1)</sup>	–	–	–	■	2
3VA9078-0VM30	–	–	–	–	–
3VA9078-0VK10	–	–	–	■	–
3VA9448-0VK20	–	–	–	–	–


# Cover frame and mounting

3VA51


## Cover frames for door cutouts for molded case circuit breakers

	Number of poles	Door cut-out with trip unit	
	3P		No
		Yes	3VA9033-0SB20
4P		No	3VA9034-0SB10
		Yes	3VA9034-0SB20


## Cover frames for MO320 motor operators

	Purpose	
	MO320 motor operator	3VA9033-0SB10
Motor operator with SEO520 stored energy operator	–	


## Cover frames for front mounted rotary operators

	
	3VA9033-0SB10


## Cover frames for door feedthroughs

	
	–


## Labeling plates for cover frame

	
	3VA9087-0SX10

## Adapters for 60 mm busbar system (8US)

		
	Number of poles	
<ul style="list-style-type: none"> <li>• Busbar adapter systems with 60-mm spacing between busbars</li> <li>• For mounting on the busbar adapter, box terminals for the infeed side must be ordered separately.</li> <li>• The connection technology for the outgoing side can be chosen freely.</li> </ul>	3P	8US1211-4SS00
	4P	–


## Mounting screw kits

	Purpose	Number of poles	
	For fixed-mounted breakers		1P
		3P	3VA9126-0SS10
		4P	3VA9124-0SS10
		3P and 4P	–
For plug-in and draw-out technology	–	–	–

		3VA53	
		3VA54	3VA55
	3VA61	3VA63	3VA65
3VA52	3VA62	3VA64	3VA66
3VA9143-0SB10	3VA9143-0SB10	3VA9373-0SB10	3VA9583-0SB10
3VA9233-0SB20	3VA9143-0SB20	3VA9343-0SB20	3VA9583-0SB20
3VA9144-0SB10	3VA9144-0SB10	3VA9374-0SB10	3VA9584-0SB10
3VA9234-0SB20	3VA9144-0SB20	3VA9344-0SB20	3VA9584-0SB20
3VA9237-0SB30	3VA9237-0SB30	3VA9377-0SB30	–
3VA9147-0SB30	3VA9147-0SB30	–	–
3VA9143-0SB10	3VA9143-0SB10	3VA9373-0SB10	3VA9583-0SB50
3VA9233-0SB20	3VA9233-0SB20	3VA9333-0SB20	–
	3VA9087-0SX10		–
8US1213-4AP03	8US1213-4AP03	8US1213-4AH04	–
8US1313-4AH03 <b>new</b>	8US1313-4AH03 <b>new</b>	8US1313-4AM04 <b>new</b>	–
–	–	–	–
3VA9126-0SS10	3VA9126-0SS10	–	–
3VA9124-0SS10	3VA9124-0SS10	–	–
–	–	3VA9328-0SS10	–
–	3VA9124-0SS10	3VA9328-0SS10	–

# 3VL up to 1600 A, according to UL 489

2

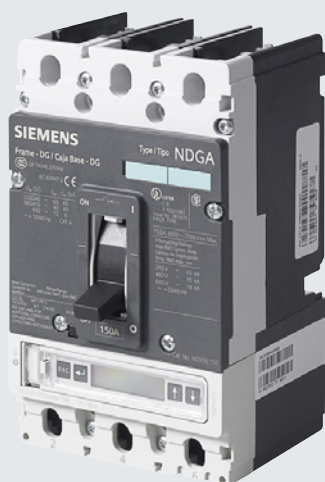

3VL molded case circuit breakers



## Product Discontinuation

### Documents available for downloading:

You can find comprehensive information on the 3VL molded case circuit breaker in the catalog extract

3VL molded case circuit breakers according to UL 489  
(109778213)

VL150X UL,  
CG frameVL150 UL,  
DG frameVL250 UL,  
FG frame

		VL150X UL, CG frame			VL150 UL, DG frame			VL250 UL, FG frame			
Number of poles		3-pole			3-pole			3-pole			
Rated current $I_n^{1)}$		20 A ... 150 A			50 A ... 150 A			100 A ... 250 A			
Frequency		50/60 Hz			50/60 Hz			50/60 Hz			
<b>Electrical characteristics according to UL 489</b>											
Rated operational voltage $U_e$	50/60 Hz AC	480 V, 600 V/347 V			480 V, 600 V/347 V			480 V, 600 V/347 V			
	DC <sup>2)</sup>	250 V			500 V			500 V			
<b>Breaking capacity</b>			<b>N</b>	<b>H</b>	<b>L</b>	<b>N</b>	<b>H</b>	<b>L</b>	<b>N</b>	<b>H</b>	<b>L</b>
Breaking capacity	Up to 240 V AC	kA	65	100	–	65	100	200	65	100	200
	Up to 480 V AC	kA	35	65	–	35	65	100	35	65	100
	Up to 600 V AC	kA	–	–	–	–	–	–	–	–	–
	Up to 600 Y/347 V AC	kA	10	10	–	18	18	18	18	18	18
	Up to 250 V DC <sup>3)</sup>	kA	30	30	–	30	30	30	30	30	30
	Up to 500 V DC <sup>3)4)</sup>	kA	–	–	–	18	18	18	18	25	30
Breaking capacity $I_{cu}/I_{cs}$ rms value according to IEC 60947-2	Up to 240 V AC	kA	65/65	10/75	–	65/65	100/75	200/150	65/65	100/75	200/150
	Up to 415 V AC	kA	40/40	70/70	–	40/40	70/70	100/75	40/40	70/70	100/75
	Up to 690 V AC	kA	8/4 <sup>5)</sup>	10/5 <sup>5)</sup>	–	12/6	12/6	12/6	12/6	12/6	12/6
	Up to 250 V DC <sup>3)</sup>	kA	30/30	30/30	–	30/30	30/30	30/30	30/30	30/30	30/30
<b>Dimensions</b>											
	A	mm	105			105			105		
	B	mm	157			175			175		
	C	mm	81			81			81		
	D	mm	107			107			107		

<sup>1)</sup> 80% rated current applications acc. to UL 489,  
100% rated current applications acc. to IEC 60947-2.

<sup>2)</sup> Rated DC voltage applies only to molded case circuit breakers with a thermal-magnetic trip unit.

<sup>3)</sup> For switching DC, the maximum permissible direct voltage per conducting path must be considered.

<sup>4)</sup> 500 V DC nominal / 600 V DC max. for use in ungrounded UPS DC applications (acc. to UL 489, Supplement SC)

<sup>5)</sup> Rated current  $I_n \geq 25$  A.




**VL400 UL,  
JG frame**
**VL400X UL,  
LG frame**
**VL800 UL,  
MG frame**
**VL1200 UL,  
NG frame**
**VL1600 UL,  
PG frame**

VL400 UL, JG frame			VL400X UL, LG frame			VL800 UL, MG frame			VL1200 UL, NG frame			VL1600 UL, PG frame		
3-pole			3-pole			3-pole			3-pole			3-pole		
250 A ... 400 A			400 A ... 600 A			600 A ... 800 A			800 A ... 1200 A			1200 A ... 1600 A		
50/60 Hz			50/60 Hz			50/60 Hz			50/60 Hz			50/60 Hz		
600 V			600 V			600 V			600 V			600 V		
500 V			500 V			500 V			500 V			500 V		
N	H	L	N	H	L	N	H	L	N	H	L	N	H	L
65	100	200	65	100	200	65	100	200	65	100	200	65	100	200
35	65	100	35	65	100	35	65	100	35	65	100	35	65	100
25	25	25	18	18	18	25	35	50	25	35	65	25	35	65
–	–	–	–	–	–	–	–	–	–	–	–	–	–	–
30	30	30	30	30	30	22	25	42	22	25	42	22	25	42
25	35	35	25	35	35	35	50	65	35	50	65	35	50	65
65/65	100/75	200/150	65/65	100/75	200/150	65/65	100/75	200/150	65/35	100/50	200/100	65/35	100/50	200/100
45/45	70/70	100/75	45/45	70/70	100/75	50/50	70/70	100/75	50/25	70/35	100/50	50/25	70/35	100/50
12/6	15/8	15/8	12/6	15/8	15/8	20/10	20/10	20/10	20/10	30/15	35/17	20/10	30/15	35/17
30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30	30/30
139			139			190			229			229		
279			279			406			406			406		
102			102			118			157			157		
138			138			151			209			209		



# Appendix



Link directory	A/2
Conditions of sale and delivery	A/4
Article number index	A/6
Index	A/7
Notes	A/8

A

# Link directory

## Catalog LV 18

### General information

Information on low-voltage power distribution and electrical installation technology	<a href="http://www.siemens.com/lowvoltage">www.siemens.com/lowvoltage</a>
Tender specifications	<a href="http://www.siemens.com/lowvoltage/tenderspecifications">www.siemens.com/lowvoltage/tenderspecifications</a>
Conversion tool	<a href="http://www.siemens.com/conversion-tool">www.siemens.com/conversion-tool</a>
Image database	<a href="http://www.siemens.com/lowvoltage/picturedb">www.siemens.com/lowvoltage/picturedb</a>
CAX download manager	<a href="http://www.siemens.com/lowvoltage/cax">www.siemens.com/lowvoltage/cax</a>
Newsletter system	<a href="http://www.siemens.com/lowvoltage/newsletter">www.siemens.com/lowvoltage/newsletter</a>
Siemens YouTube channel	<a href="http://www.youtube.com/Siemens">www.youtube.com/Siemens</a>
Brochures / catalogs	<a href="http://www.siemens.com/lowvoltage/catalogs">www.siemens.com/lowvoltage/catalogs</a>
Operating instructions / manuals	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a>
Siemens Industry Online Support (SIOS)	<a href="http://www.siemens.com/lowvoltage/product-support">www.siemens.com/lowvoltage/product-support</a>
Siemens Industry Online Support app	<a href="http://www.siemens.com/support-app">www.siemens.com/support-app</a>
My Documentation Manager (MDM)	<a href="http://www.siemens.com/lowvoltage/mdm">www.siemens.com/lowvoltage/mdm</a>
Configurators	<a href="http://www.siemens.com/lowvoltage/configurators">www.siemens.com/lowvoltage/configurators</a>
Siemens Industry Mall – product catalog and online ordering system	<a href="http://www.siemens.com/lowvoltage/mall">www.siemens.com/lowvoltage/mall</a>
Direct forwarding to the Industry Mall	<a href="http://www.siemens.com/product?Article No.">www.siemens.com/product?Article No.</a>
Training	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a>
Local contacts	<a href="http://www.siemens.com/lowvoltage/contact">www.siemens.com/lowvoltage/contact</a> <a href="http://www.siemens.com/lowvoltage/components/contact">www.siemens.com/lowvoltage/components/contact</a> <a href="http://www.siemens.com/lowvoltage/systems/contact">www.siemens.com/lowvoltage/systems/contact</a> <a href="http://www.siemens.com/lowvoltage/software/contact">www.siemens.com/lowvoltage/software/contact</a>
Technical Support	<a href="http://www.siemens.com/lowvoltage/support-request">www.siemens.com/lowvoltage/support-request</a>
Information on services	<a href="http://www.siemens.com/service-catalog">www.siemens.com/service-catalog</a>
Manual for the generation, transmission and distribution of electrical energy	<a href="http://www.siemens.com/power-engineering-guide">www.siemens.com/power-engineering-guide</a>
Control panels for the North American market	<a href="http://www.siemens.com/northamerican-standards">www.siemens.com/northamerican-standards</a>
Control panel building	<a href="http://www.siemens.com/controlpanel">www.siemens.com/controlpanel</a>
Energy savings and amortization	<a href="http://www.automation.siemens.com/sinasave">www.automation.siemens.com/sinasave</a>
Energy Suite	<a href="http://www.siemens.com/energysuite">www.siemens.com/energysuite</a>
SITOP power supplies	<a href="http://www.siemens.com/sitop">www.siemens.com/sitop</a>
Power distribution with Totally Integrated Power	<a href="http://www.siemens.com/tip">www.siemens.com/tip</a>

## Information + ordering

### Technical overviews

Air circuit breakers	<a href="http://www.siemens.com/lowvoltage/produkt-support">www.siemens.com/lowvoltage/produkt-support</a> (109766020)
Molded case circuit breakers	<a href="http://www.siemens.com/lowvoltage/produkt-support">www.siemens.com/lowvoltage/produkt-support</a> (109767421)

### All the important things at a glance

Air circuit breakers	<a href="http://www.siemens.com/3WL">www.siemens.com/3WL</a>
Molded case circuit breakers	<a href="http://www.siemens.com/3VA">www.siemens.com/3VA</a>

### Your product in detail

Technical basic information – 3VA molded case circuit breakers	<a href="http://www.siemens.com/lowvoltage/produkt-support">www.siemens.com/lowvoltage/produkt-support</a> (109766672)
--	--

### Siemens YouTube channel

3WL air circuit breakers (general)	<a href="https://bit.ly/2ZH1rXH">bit.ly/2ZH1rXH</a>
3VA molded case circuit breakers (general)	<a href="https://bit.ly/2xNxIFA">bit.ly/2xNxIFA</a>

### Everything you need for your order

3WL air circuit breakers/non-automatic air circuit breakers for AC up to 5000 A, UL	<a href="https://sie.ag/2ScRZK7">sie.ag/2ScRZK7</a>
3VA molded case circuit breakers, UL / IEC	<a href="https://sie.ag/2yPsA2e">sie.ag/2yPsA2e</a>

### Configurators

3WL air circuit breakers	<a href="http://www.siemens.com/lowvoltage/3wl-configurator">www.siemens.com/lowvoltage/3wl-configurator</a>
3VA molded case circuit breakers	<a href="http://www.siemens.com/lowvoltage/3va-ul-configurator">www.siemens.com/lowvoltage/3va-ul-configurator</a>

## Commissioning + operation

### Tools / software

SENTRON powerconfig	<a href="http://www.siemens.com/powerconfig">www.siemens.com/powerconfig</a>
---------------------	--

### Manuals

Configuration manual – 3WL5 air circuit breakers / non-automatic air circuit breakers	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (109775570)
System manual – 3WL/3VL circuit breakers with communication capability – Modbus	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (39850157)
System manual – 3WL/3VL circuit breakers with communication capability – PROFIBUS	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (12560390)
Communication manual – 3WL air circuit breakers via COM35 – PROFINET IO, Modbus TCP	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (109757987)
Configuration manual – 3VA selectivity	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (109743975)
Communication manual – 3VA molded case circuit breakers with IEC and UL certification	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (98746267)
Equipment manual – 3VA molded case circuit breakers with UL and IEC certification	<a href="http://www.siemens.com/lowvoltage/manuals">www.siemens.com/lowvoltage/manuals</a> (109758561)

### Classroom or online training

Video tutorial on the 3WL air circuit breaker	<a href="http://www.lowvoltage.siemens.com/wcms/3wl-tutorial">www.lowvoltage.siemens.com/wcms/3wl-tutorial</a>
Protection systems in low-voltage power distribution	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a> (WT-LVAPS)
3WL air circuit breakers, sizes 1-3	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a> (WT-LVA3WL)
3VA molded case circuit breakers	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a> (WT-LVA3VA)
Communication with SENTRON components	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a> (LV-COM)
Maintenance and operation of 3WL circuit breakers	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a> (LV-CBMAIN)
Project planning and selection of SENTRON circuit breakers	<a href="http://www.siemens.com/sitrain-lowvoltage">www.siemens.com/sitrain-lowvoltage</a> (LV-CBPROJ)

A

# Conditions of sale and delivery

## 1. General Provisions

By using this catalog you can purchase products (hardware, software and services) described therein from Siemens Aktiengesellschaft subject to the following Terms and Conditions of Sale and Delivery (hereinafter referred to as „T&C“). Please note that the scope, the quality and the conditions for supplies and services, including software products, by any Siemens entity having a registered office outside Germany, shall be subject exclusively to the General Terms and Conditions of the respective Siemens entity. The following T&C apply exclusively for orders placed with Siemens Aktiengesellschaft, Germany.

### 1.1 For customers with a seat or registered office in European Union

For customers with a seat or registered office in European Union, the following terms and conditions apply subordinate to T&C:

- for products, which include specific terms and conditions in the description text, these specific terms and conditions shall apply and subordinate thereto,
- for stand-alone software products and software products forming a part of a product or project, the „General License Conditions for Software Products for Automation and Drives for Customers with a Seat or registered Office in Germany“<sup>1)</sup> and/or
- for consulting services the „Allgemeine Geschäftsbedingungen für Beratungsleistungen der Division DF – Deutschland“ (available only in German) and/or
- for other services, the „Supplementary Terms and Conditions for Services (‘BL’)<sup>1)</sup> and/or
- for other supplies the „General Conditions for the Supply of Products and Services of the Electrical and Electronics Industry“<sup>1)</sup>.

In case such supplies should contain Open Source Software, the conditions of which shall prevail over the „General Conditions for the Supply of Products and Services of the Electrical and Electronics Industry“<sup>1)</sup>, a notice will be contained in the scope of delivery in which the applicable conditions for Open Source Software are specified. This shall apply mutatis mutandis for notices referring to other third party software components.

### 1.2 For customers with a seat or registered office outside European Union

For customers with a seat or registered office outside European Union, the following terms and conditions apply subordinate to T&C:

- for products, which include specific terms and conditions in the description text, these specific terms and conditions shall apply and subordinate thereto,
- for consulting services the „Standard Terms and Conditions for Consulting Services of the Division DF for Customers with a Seat or Registered Office Outside of Germany“<sup>1)</sup> and/or
- for other services the „International Terms & Conditions for Services“<sup>1)</sup> supplemented by „Software Licensing Conditions“<sup>1)</sup> and/or
- for other supplies of hard- and software the „International Terms & Conditions for Products“<sup>1)</sup> supplemented by „Software Licensing Conditions“<sup>1)</sup>

### 1.3 For customers with master or framework agreement

To the extent our supplies and/or services offered are covered by an existing master or framework agreement, the terms and conditions of that agreement shall apply instead of T&C.

## 2. Additional Terms and Conditions

The dimensions are in mm. In Germany, according to the German law on units in measuring technology, data in inches apply only to devices for export.

Illustrations are not binding.

Insofar as there are no remarks on the individual pages of this catalog – especially with regard to data, dimensions and weights given – these are subject to change without prior notice.

<sup>1)</sup> The text of the Terms and Conditions of Siemens AG can be downloaded at [https://mall.industry.siemens.com/legal/ww/en/terms\\_of\\_trade\\_en.pdf](https://mall.industry.siemens.com/legal/ww/en/terms_of_trade_en.pdf)

### 3. Export Regulations

We shall not be obligated to fulfill any agreement if such fulfillment is prevented by any impediments arising out of national or international foreign trade or customs requirements or any embargoes and/or other sanctions.

Export may be subject to license. We shall indicate in the delivery details whether licenses are required under German, European and US export lists.

Our products are controlled by the U.S. Government (when labeled with „ECCN“ unequal „N“) and authorized for export only to the country of ultimate destination for use by the ultimate consignee or end-user(s) herein identified. They may not be resold, transferred, or otherwise disposed of, to any other country or to any person other than the authorized ultimate consignee or end-user(s), either in their original form or after being incorporated into other items, without first obtaining approval from the U.S. Government or as otherwise authorized by U.S. law and regulations. Products labeled with „AL“ unequal „N“ are subject to European / national export authorization.

The export indications can be viewed in advance in the description of the respective goods on the Industry Mall, our online catalog system. Only the export labels „AL“ and „ECCN“ indicated on order confirmations, delivery notes and invoices are authoritative.

Products without label, with label „AL:N“ / „ECCN:N“, or label „AL:9X9999“ / „ECCN: 9X9999“ may require authorization from responsible authorities depending on the final end-use, or the destination.

If you transfer goods (hardware and/or software and/or technology as well as corresponding documentation, regardless of the mode of provision) delivered by us or works and services (including all kinds of technical support) performed by us to a third party worldwide, you shall comply with all applicable national and international (re-)export control regulations. In any event of such transfer of goods, works and services you shall comply with the (re-) export control regulations of the Federal Republic of Germany, of the European Union and of the United States of America.

Prior to any transfer of goods, works and services provided by us to a third party you shall in particular check and guarantee by appropriate measures that

- there will be no infringement of an embargo imposed by the European Union, by the United States of America and/ or by the United Nations by such transfer, by brokering of contracts concerning those goods, works and services or by provision of other economic resources in connection with those goods, works and services, also considering the limitations of domestic business and prohibitions of by-passing those embargos;
- such goods, works and services are not intended for use in connection with armaments, nuclear technology or weapons, if and to the extent such use is subject to prohibition or authorization, unless required authorization is provided;
- the regulations of all applicable Sanctioned Party Lists of the European Union and the United States of America concerning the trading with entities, persons and organizations listed therein are considered.

If required to enable authorities or us to conduct export control checks, you, upon request by us, shall promptly provide us with all information pertaining to the particular end customer, the particular destination and the particular intended use of goods, works and services provided by us, as well as any export control restrictions existing.

You acknowledge that under the EU embargo regulations against Iran, Syria and Russia respectively the sale of certain listed goods and related services is subject to authorization by the competent export control authorities of the European Union. If (1) the goods or services ordered by you are destined for Iran, Syria or Russia, and (2) the contract for our supplies and/or services is subject to prior authorization of the competent export control authorities of the European Union, the contract between you and us shall come into force in this respect only upon granting of such authorization.

The products listed in this catalog may be subject to European/ German and/or US export regulations. Any export requiring approval is therefore subject to authorization by the relevant authorities. Errors excepted and subject to change without prior notice.

# Article number index

Article No.	Page
<b>3V</b>	
3VA90	2/31, 2/62, 2/64 – 2/67
3VA91	2/28 – 2/30, 2/32 – 2/33, 2/35, 2/37, 2/39, 2/41, 2/45, 2/47, 2/53 – 2/57, 2/62, 2/64, 2/66 – 2/67
3VA92	2/28 – 2/29, 2/32 – 2/33, 2/35, 2/37, 2/39, 2/41, 2/45, 2/47, 2/49, 2/53, 2/55, 2/57, 2/64, 2/67
3VA93	2/37, 2/39, 2/53, 2/55 – 2/57, 2/62, 2/64 – 2/65, 2/67
3VA94	2/28 – 2/30, 2/32 – 2/33, 2/35, 2/37, 2/39, 2/41, 2/43, 2/45, 2/47, 2/49, 2/53, 2/55 – 2/57, 2/65
3VA95	2/32, 2/47, 2/49, 2/65, 2/67
3VA96	2/28 – 2/32, 2/37, 2/41, 2/43, 2/47 – 2/49, 2/51, 2/54 – 2/55, 2/62
3VA98	2/32
3VA99	2/26 – 2/27, 2/29 – 2/32, 2/34, 2/57 – 2/58, 2/61 – 2/65
3VW90	1/40, 2/63
<b>3W</b>	
3WL51	1/5, 1/10 – 1/11
3WL52	1/5, 1/10 – 1/11, 1/26
3WL53	1/26
3WL91	1/37 – 1/47
3WL93	1/37
<b>7K</b>	
7KM93	2/61
<b>8U</b>	
8UC94	2/30
8UD17	2/29
8UD19	2/30 – 2/31
8US12	2/66 – 2/67
8US13	2/67



# Index

Keyword	Page
<b>0–9</b>	
3VA5 switching devices up to 800 A	2/8 – 2/10
3VA51 – 3VA66	2/20 – 2/67
3VA6 switching devices up to 1000 A	2/12 – 2/14
3VL up to 1600 A, according to UL 489	2/68
3VL	2/68 – 2/69
3WL5 system overview	1/18
3WL5	1/18 – 1/47
<b>A</b>	
Accessories and spare parts	1/37 – 1/46
Accessory options	1/26 – 1/32
All the information you need	1/2 – 1/3, 2/2 – 2/3
Appendix	A/1 – A/8
Applications	I/8
Article number index	A/6
<b>B</b>	
Brief code comparison of UL vs. IEC standards	I/7
Brief code comparison of	I/7
<b>C</b>	
Communication	2/59 – 2/62
Conditions of sale and delivery	A/4 – A/5
Connection technology	2/36 – 2/42, 2/46 – 2/54
Connection	1/16
Cover frame and mounting	2/66
<b>E</b>	
Electronic trip units ETU	1/14
<b>G</b>	
Guide frames for AC	1/36
<b>I</b>	
Index	A/7
Internal accessories	2/26
Introduction	I/2 – I/9
<b>L</b>	
Link directory	A/2 – A/3
Locking, blocking and interlocking	2/64
<b>M</b>	
Manual operators	2/28 – 2/32
Molded case circuit breakers for all applications	2/4 – 2/5
Molded case circuit breakers	2/4
Motor operators	2/34
<b>N</b>	
Notes	A/8 – A/10

Keyword	Page
<b>O</b>	
Online configurator highlights	1/20 – 2/18
Operating mechanism, auxiliary release,	1/17
Overcurrent protection according to network standards	I/6
Overview of the key US standards	I/4 – I/5
<b>P</b>	
Plug-in and draw-out technology	2/56 – 2/58
Product approvals in control panel according to UL / NEC	I/9
<b>Q</b>	
Quick selection guide	1/4 – 1/17, 2/6 – 2/19
<b>S</b>	
Structure of the article numbers	1/22 – 1/24, 2/22 – 2/24
Switching devices and accessories	2/6
Switching devices for AC and DC	1/4
Switching devices for AC	1/6 – 1/8
Switching devices for DC	1/10 – 1/12
System overview	2/20
<b>T</b>	
The fast route to the product	I/2 – I/3
Trip units	2/16



# Catalogs and further information



## LV 10 Low-Voltage Power Distribution and Electrical Installation Technology SENTRON • SIVACON • ALPHA

Protection, Switching, Measuring and  
Monitoring Devices, Switchboards and  
Distribution Systems

PDF (E86060-K8280-A101-B3-7600)



## LV 14 Power Monitoring Made Simple SENTRON

E86060-K1814-A101-A7-7600



## LV 18 Air Circuit Breakers and Molded Case Circuit Breakers with UL Certification SENTRON

PDF (E86060-K8280-E347-A6-7600)



## ET D1 Switches and Socket Outlets DELTA

PDF



## IC 10 Industrial Controls SIRIUS

PDF (E86060-K1010-A101-B2-7600)



## Industry Mall

Information and Ordering Platform  
on the Internet:

[www.siemens.com/industrymall](http://www.siemens.com/industrymall)



**Siemens TIA Selection Tool**  
for the selection, configuration and ordering  
of TIA products and devices

[www.siemens.com/tst](http://www.siemens.com/tst)



## SITRAIN

Digital Industry Academy

[www.siemens.com/sitrain](http://www.siemens.com/sitrain)

The catalogs listed above and additional catalogs are  
available in PDF format at Siemens Industry Online Support  
[www.siemens.com/lowvoltage/catalogs](http://www.siemens.com/lowvoltage/catalogs)

Further information on low-voltage power distribution  
and electrical installation technology is available on the  
Internet at [www.siemens.com/lowvoltage](http://www.siemens.com/lowvoltage)

## Get more information

[www.siemens.com/lowvoltage](http://www.siemens.com/lowvoltage)

Published by  
Siemens AG

For the U.S. published by  
Siemens Industry Inc.

Smart Infrastructure  
Electrical Products  
Siemensstraße 10  
93055 Regensburg, Germany

100 Technology Drive  
Alpharetta, GA 30005  
United States

PDF (E86060-K8280-E347-A6-7600)  
KG 0621 136 En  
Produced in Germany  
© Siemens 2021

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract.

All product designations may be trademarks or other rights of Siemens AG, its affiliated companies or other companies whose use by third parties for their own purposes could violate the rights of the respective owner.

## Security information

Siemens provides products and solutions with industrial security functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial security concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the Internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial security measures that may be implemented, please visit <https://www.siemens.com/industrialsecurity>

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Security RSS Feed under <https://www.siemens.com/industrialsecurity>